


SCHWINGGESCHWINDIGKEIT

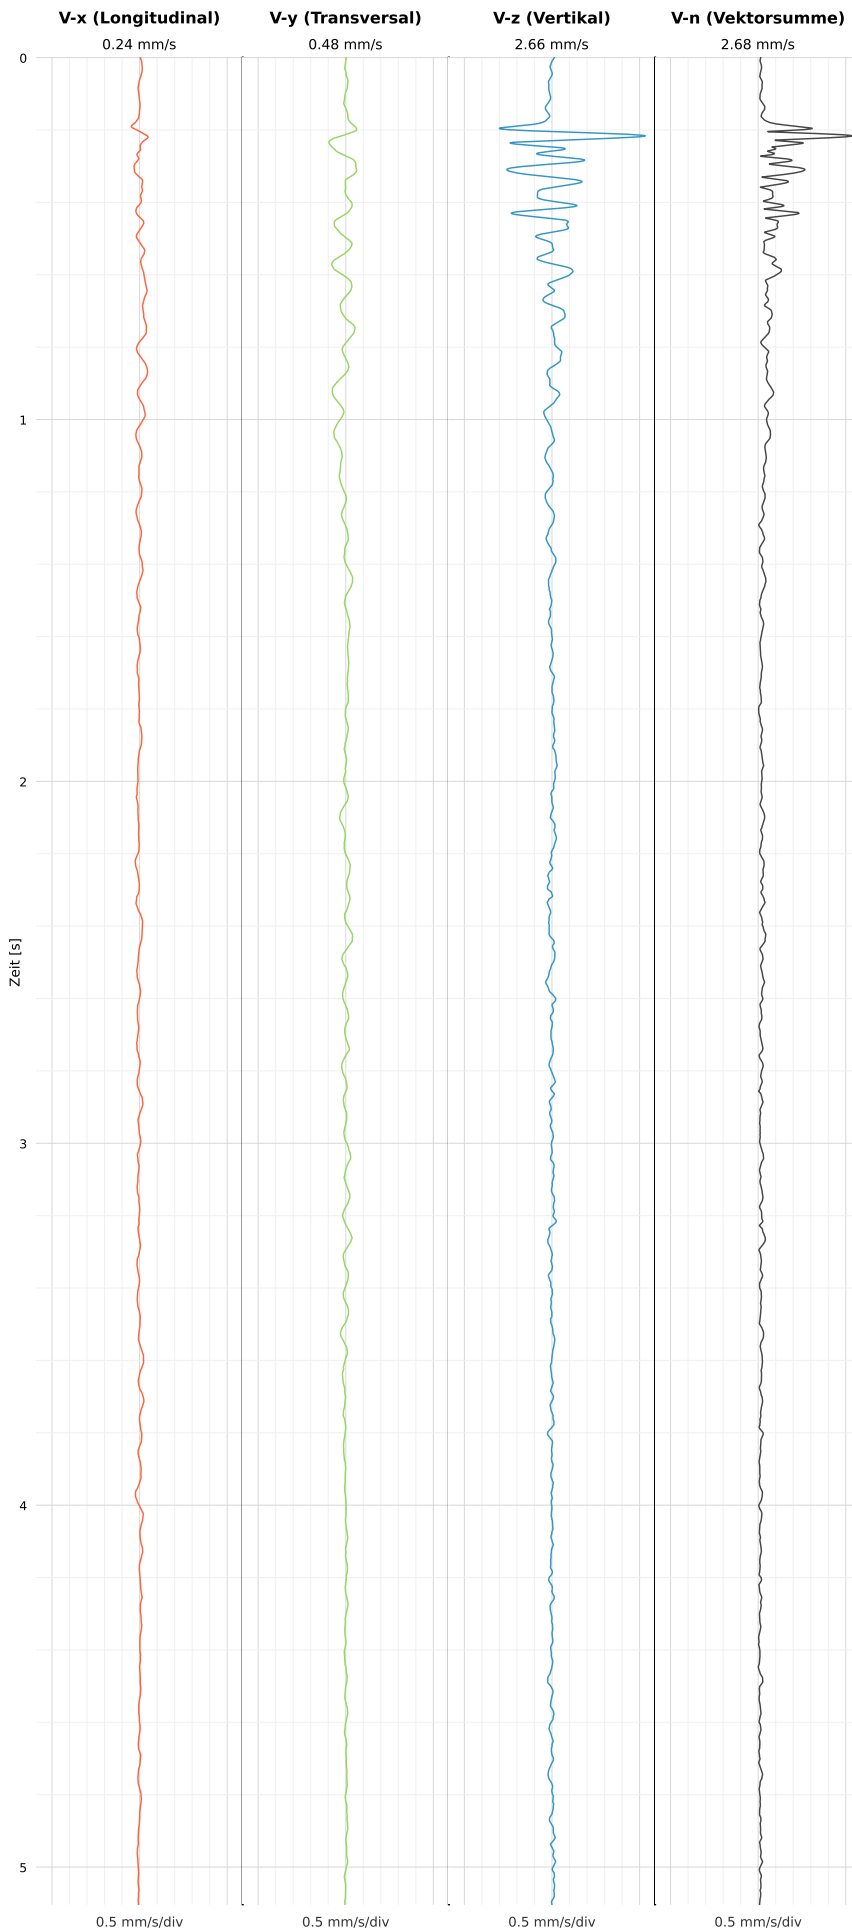


DATEI: 2492-PG-14-12052026-190005_raw.csv

Aufzeichnungsdauer: 5.10 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	21:00:05
Event-ID	2492-PG-14-12052026-190005
Status	Ereignis
X	0.24 mm/s @ 1.8 Hz
Y	0.48 mm/s @ 1.2 Hz
Z	2.66 mm/s @ 8.8 Hz
Vn	2.68 mm/s @ 8.8 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

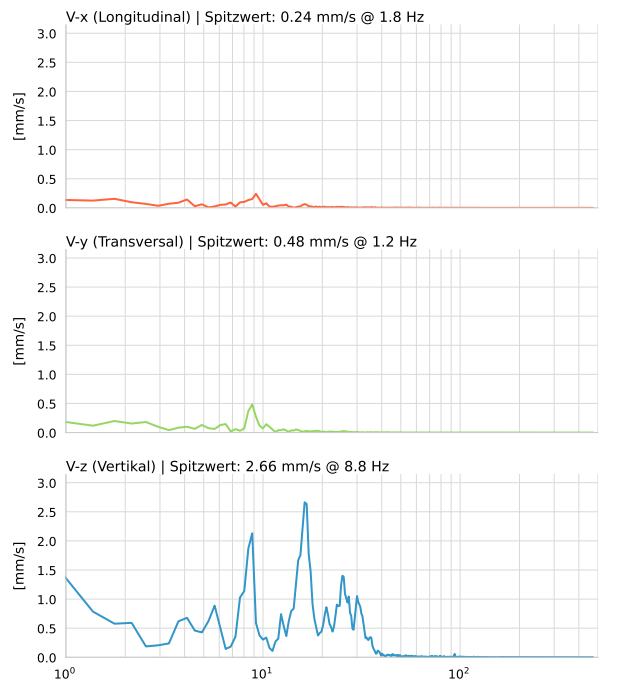

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	1.8 Hz	3.3 Hz	8.8 Hz	16.7 Hz
Y	1.2 Hz	3.3 Hz	8.8 Hz	13.1 Hz
Z	8.8 Hz	12.3 Hz	17.4 Hz	26.8 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

