


## SCHWINGGESCHWINDIGKEIT

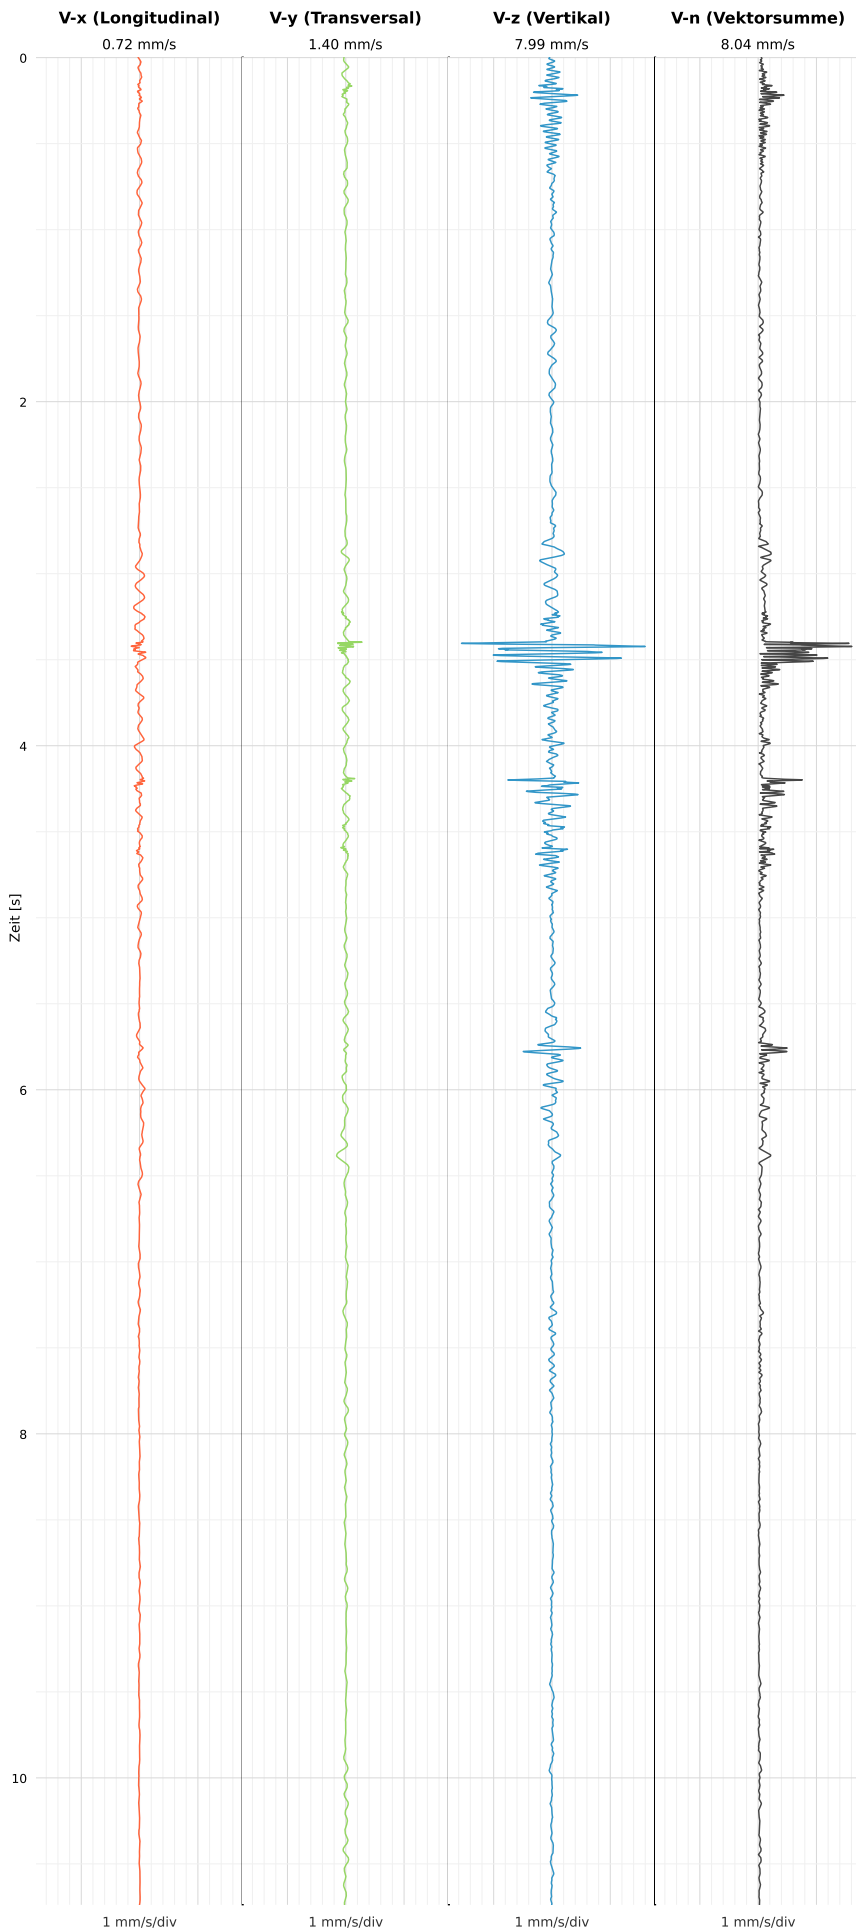


DATEI: 2492-PG-14-12052026-194430\_raw.csv

Aufzeichnungsdauer: 10.74 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	21:44:30
Event-ID	2492-PG-14-12052026-194430
Status	Hinweis
X	0.72 mm/s @ 8.4 Hz
Y	1.40 mm/s @ 8.8 Hz
Z	7.99 mm/s @ 30.4 Hz
Vn	8.04 mm/s @ 30.4 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

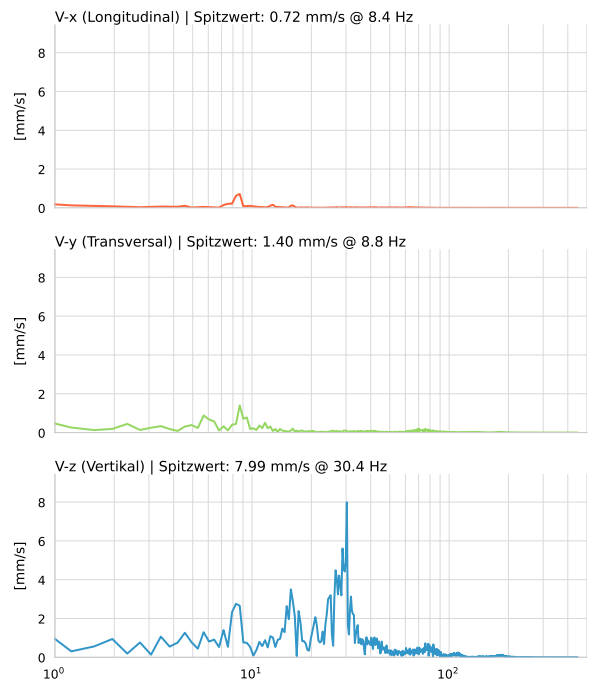

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.4 Hz	7.9 Hz	12.8 Hz	47.0 Hz
Y	8.8 Hz	8.7 Hz	32.9 Hz	80.9 Hz
Z	30.4 Hz	20.6 Hz	29.2 Hz	45.5 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

