


## SCHWINGGESCHWINDIGKEIT

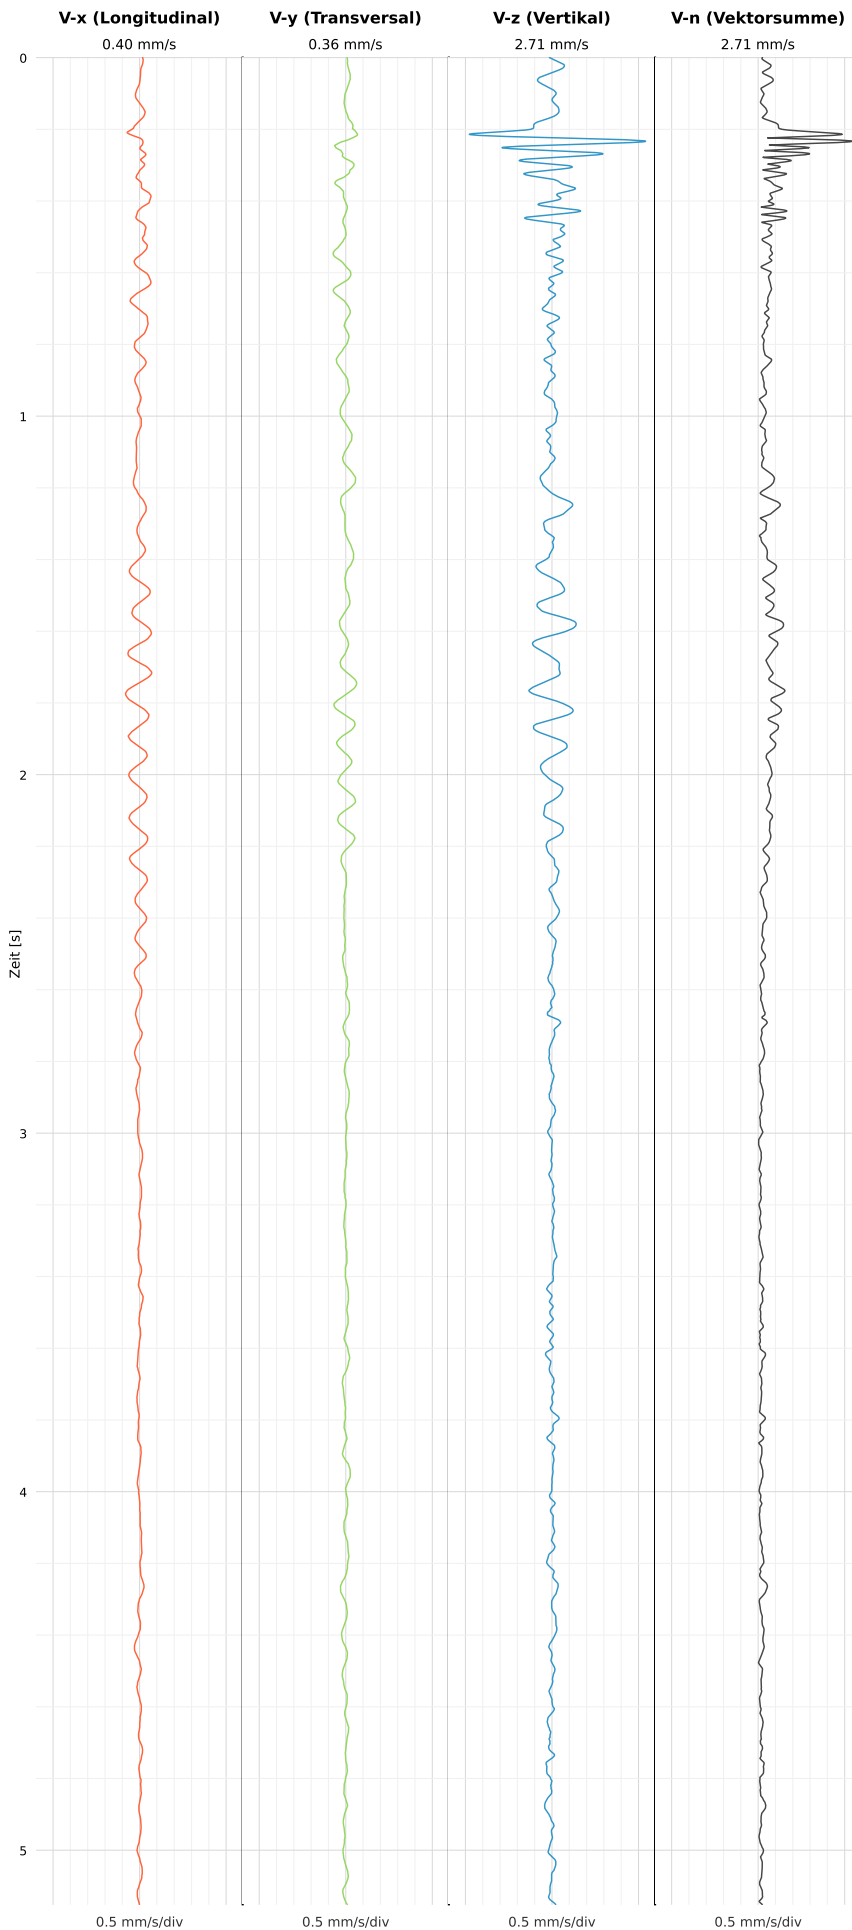


DATEI: 2492-PG-14-12052026-202429\_raw.csv

Aufzeichnungsdauer: 5.15 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	22:24:29
Event-ID	2492-PG-14-12052026-202429
Status	Ereignis
X	0.40 mm/s @ 8.9 Hz
Y	0.36 mm/s @ 8.9 Hz
Z	2.71 mm/s @ 8.9 Hz
Vn	2.71 mm/s @ 8.9 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

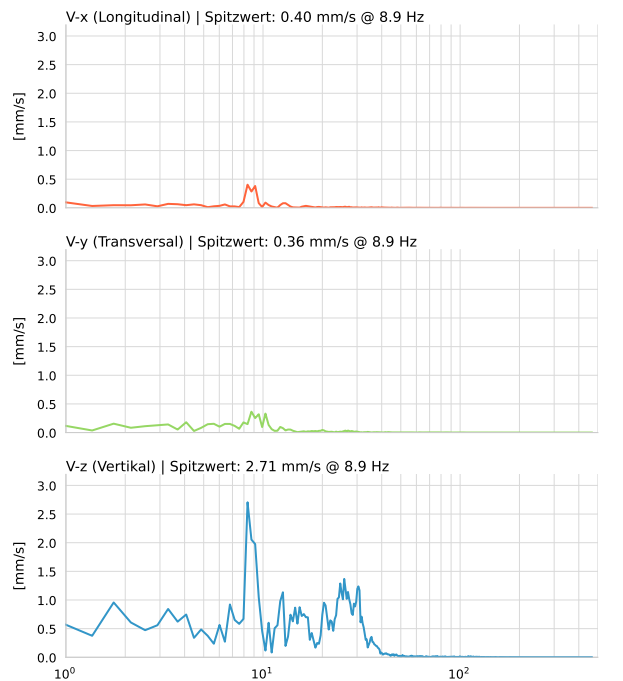

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.9 Hz	7.2 Hz	9.1 Hz	16.9 Hz
Y	8.9 Hz	5.2 Hz	9.1 Hz	13.4 Hz
Z	8.9 Hz	9.1 Hz	20.8 Hz	28.5 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

