


SCHWINGGESCHWINDIGKEIT

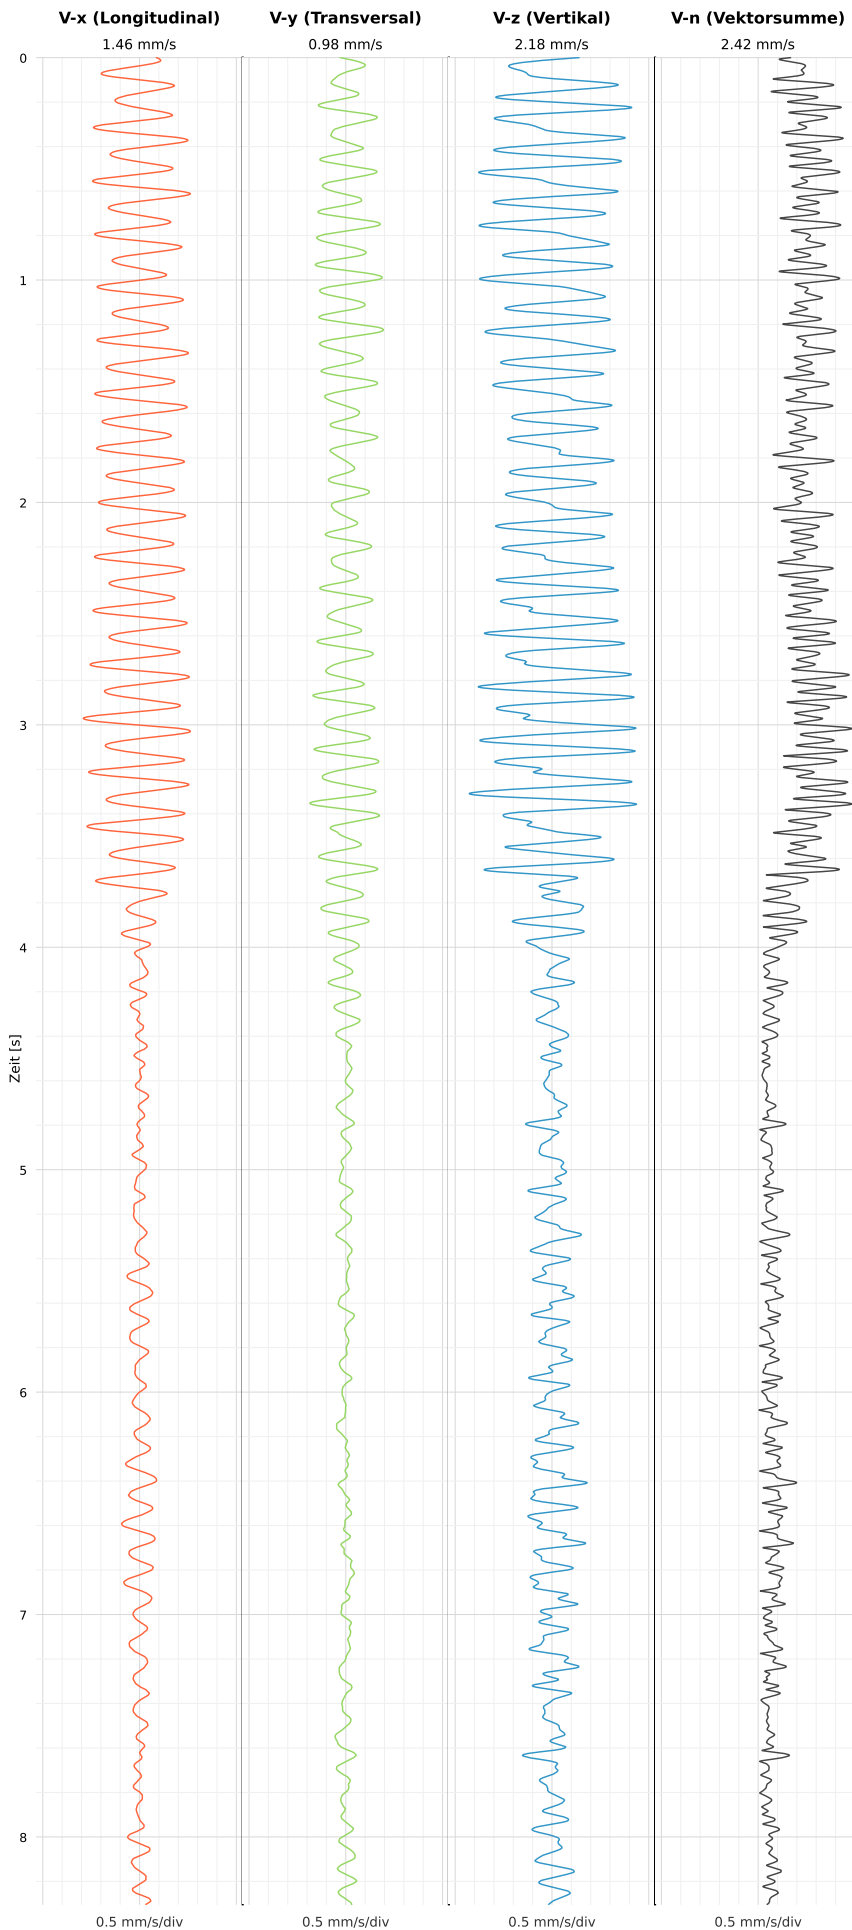


DATEI: 2492-PG-14-12052026-202830_raw.csv

Aufzeichnungsdauer: 8.30 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	22:28:30
Event-ID	2492-PG-14-12052026-202830
Status	Ereignis
X	1.46 mm/s @ 8.3 Hz
Y	0.98 mm/s @ 8.3 Hz
Z	2.18 mm/s @ 8.3 Hz
Vn	2.42 mm/s @ 8.3 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

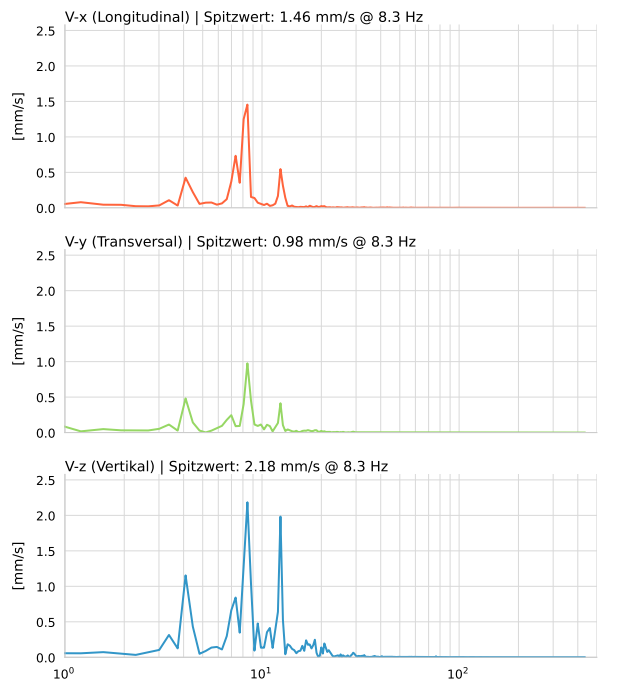

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.3 Hz	7.3 Hz	8.4 Hz	12.4 Hz
Y	8.3 Hz	7.0 Hz	8.4 Hz	12.4 Hz
Z	8.3 Hz	7.7 Hz	9.9 Hz	14.2 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

