


SCHWINGGESCHWINDIGKEIT

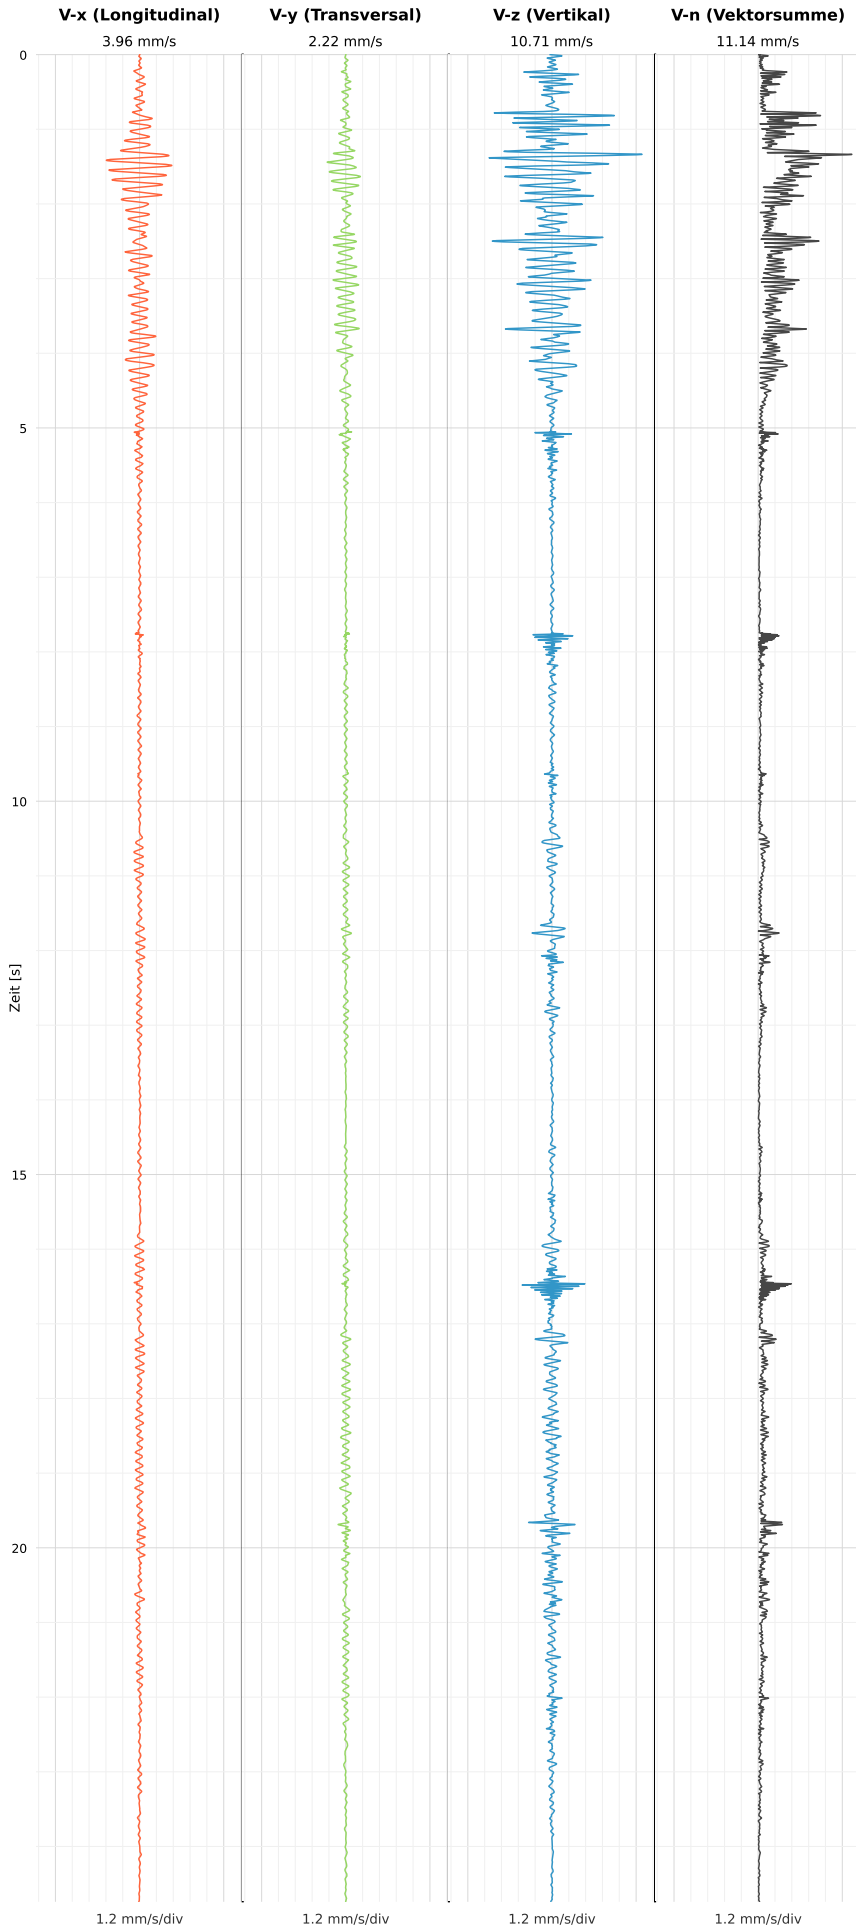


DATEI: 2492-PG-14-12052026-213106_raw.csv

Aufzeichnungsdauer: 24.74 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	23:31:06
Event-ID	2492-PG-14-12052026-213106
Status	Kritisch
X	3.96 mm/s @ 7.9 Hz
Y	2.22 mm/s @ 8.7 Hz
Z	10.71 mm/s @ 8.8 Hz
Vn	11.14 mm/s @ 8.8 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

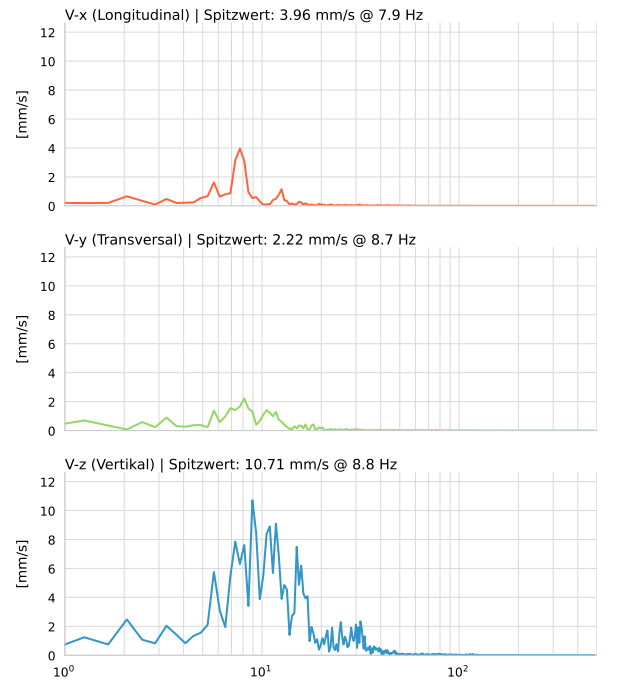

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	7.9 Hz	6.5 Hz	7.7 Hz	12.2 Hz
Y	8.7 Hz	6.9 Hz	9.7 Hz	14.6 Hz
Z	8.8 Hz	8.9 Hz	12.2 Hz	19.4 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

