


SCHWINGGESCHWINDIGKEIT

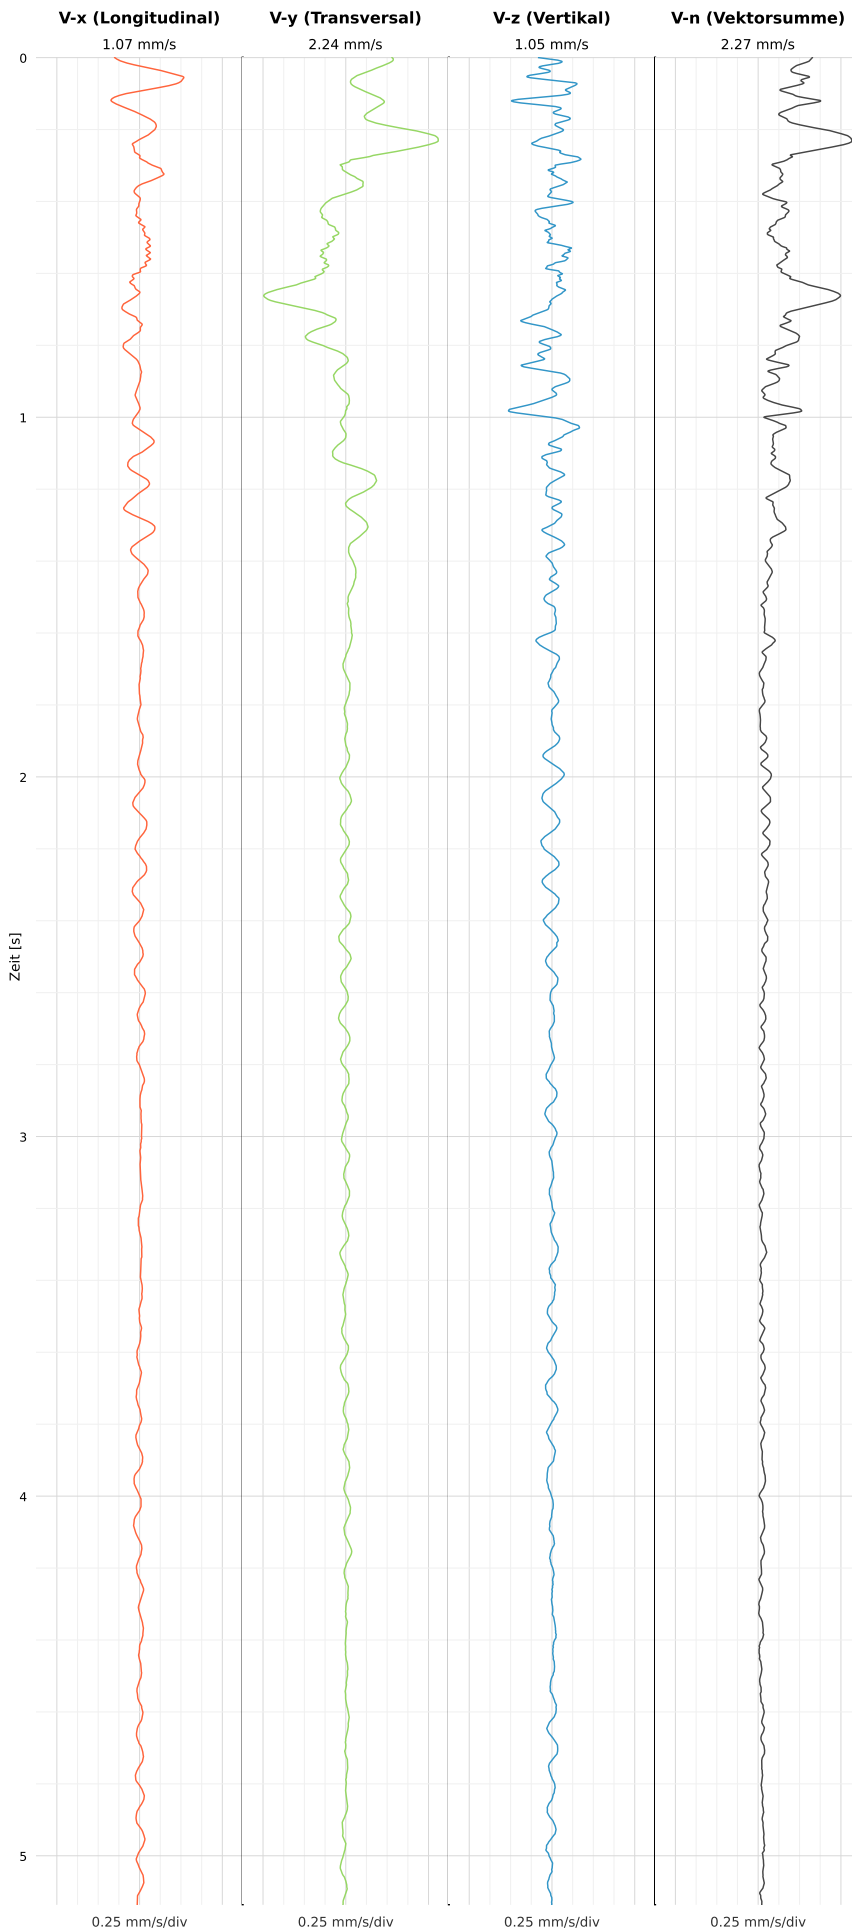


DATEI: 2492-PG-14-12052026-222423_raw.csv

Aufzeichnungsdauer: 5.14 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	00:24:23
Event-ID	2492-PG-14-12052026-222423
Status	Ereignis
X	1.07 mm/s @ 8.6 Hz
Y	2.24 mm/s @ 9.2 Hz
Z	1.05 mm/s @ 9.2 Hz
Vn	2.27 mm/s @ 9.2 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

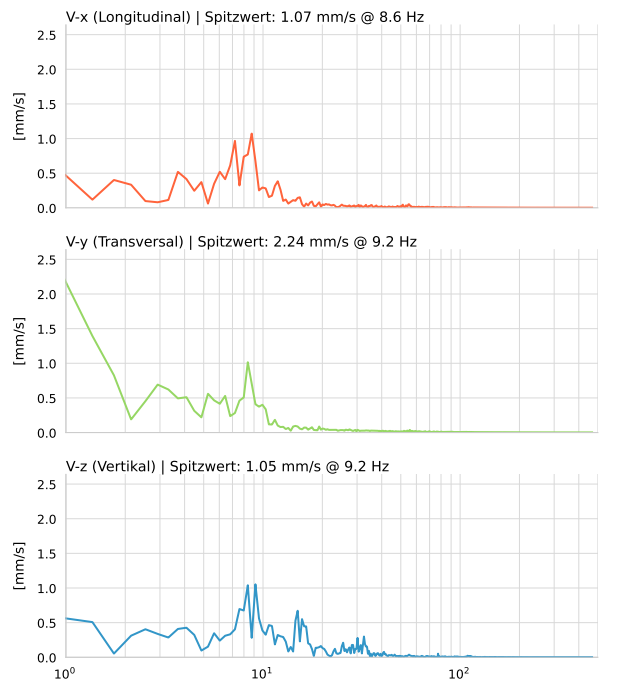

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.6 Hz	6.4 Hz	9.2 Hz	32.5 Hz
Y	9.2 Hz	1.8 Hz	7.6 Hz	27.8 Hz
Z	9.2 Hz	8.0 Hz	13.4 Hz	29.4 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

