


## SCHWINGGESCHWINDIGKEIT

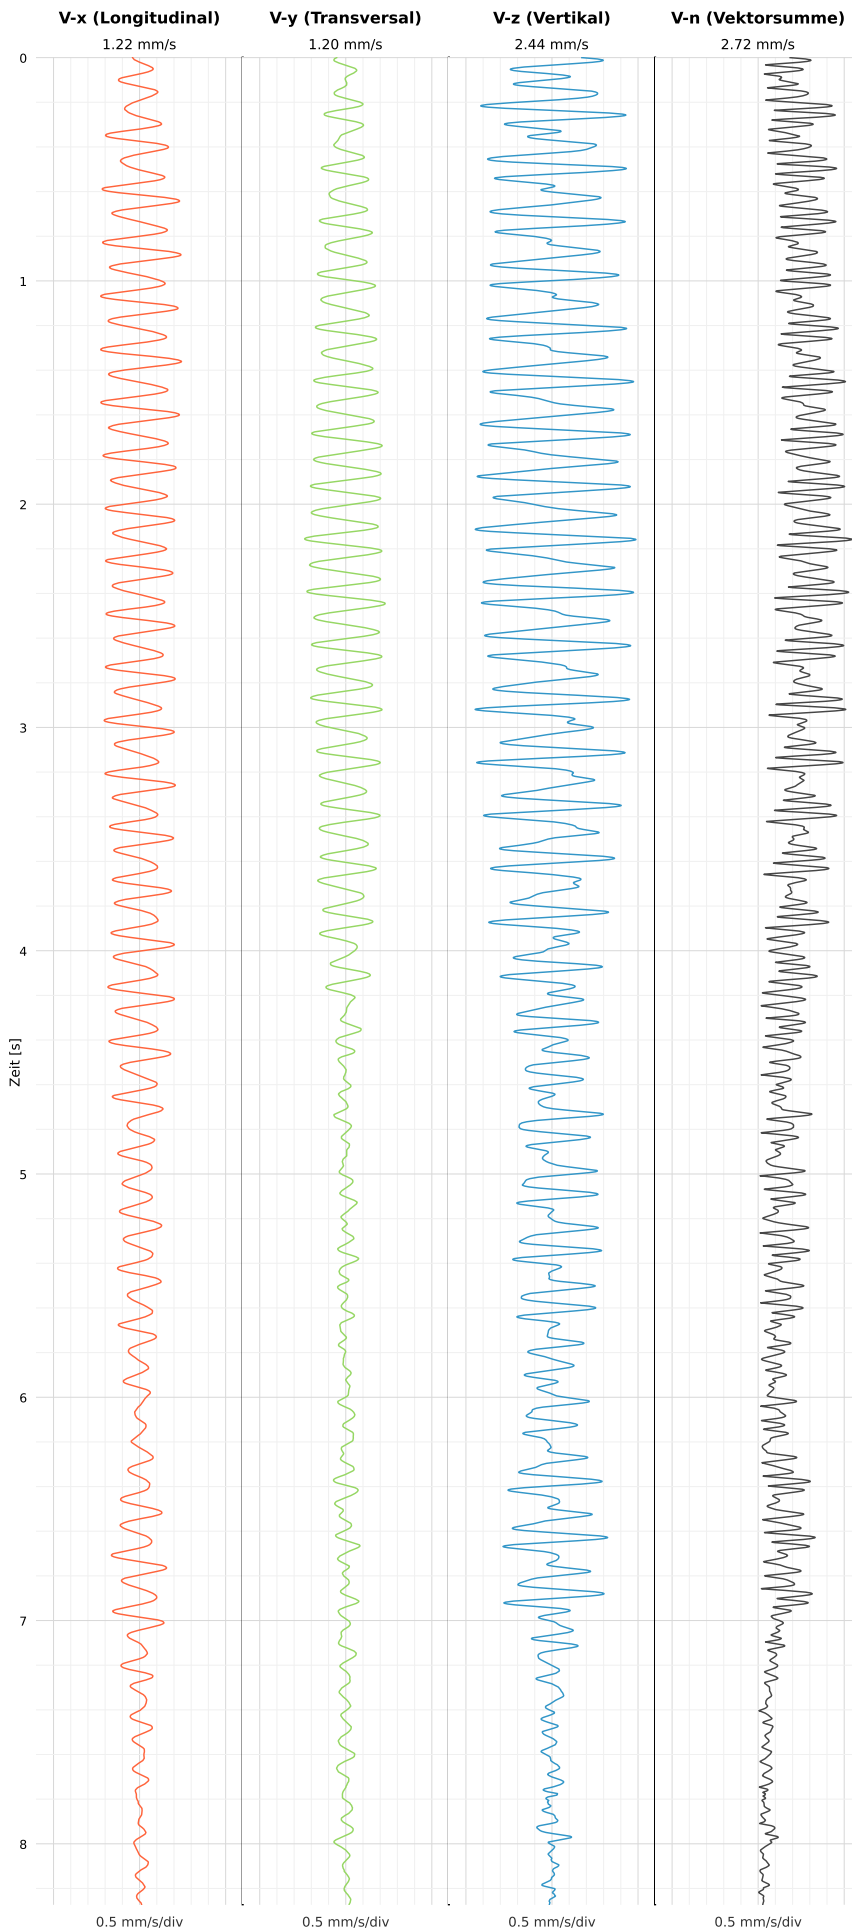


DATEI: 2492-PG-14-12052026-223726\_raw.csv

Aufzeichnungsdauer: 8.27 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	00:37:26
Event-ID	2492-PG-14-12052026-223726
Status	Ereignis
X	1.22 mm/s @ 8.3 Hz
Y	1.20 mm/s @ 8.5 Hz
Z	2.44 mm/s @ 8.5 Hz
Vn	2.72 mm/s @ 8.5 Hz

### SPEKTRALANALYSE - KOMPONENTEN FFT

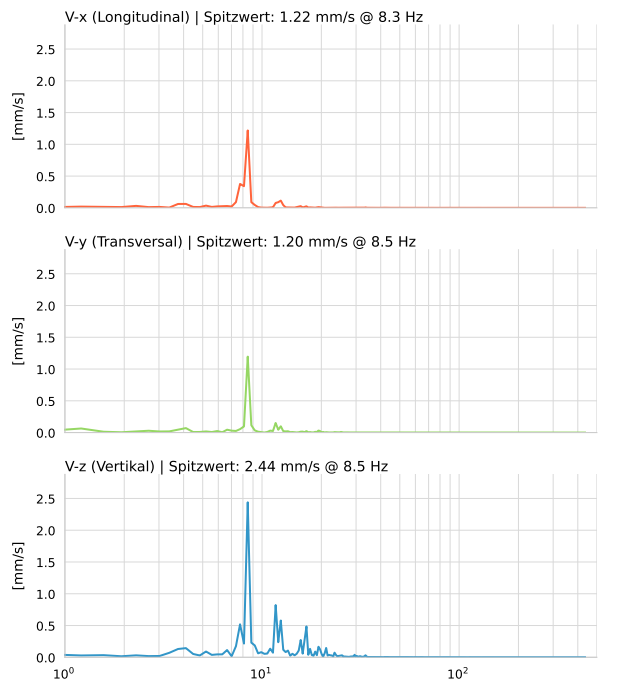

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.3 Hz	7.7 Hz	8.5 Hz	11.4 Hz
Y	8.5 Hz	8.5 Hz	8.5 Hz	12.5 Hz
Z	8.5 Hz	8.5 Hz	11.7 Hz	16.8 Hz

### SPEKTRALANALYSE - FFT (DIN 4150-3)

