


## SCHWINGGESCHWINDIGKEIT



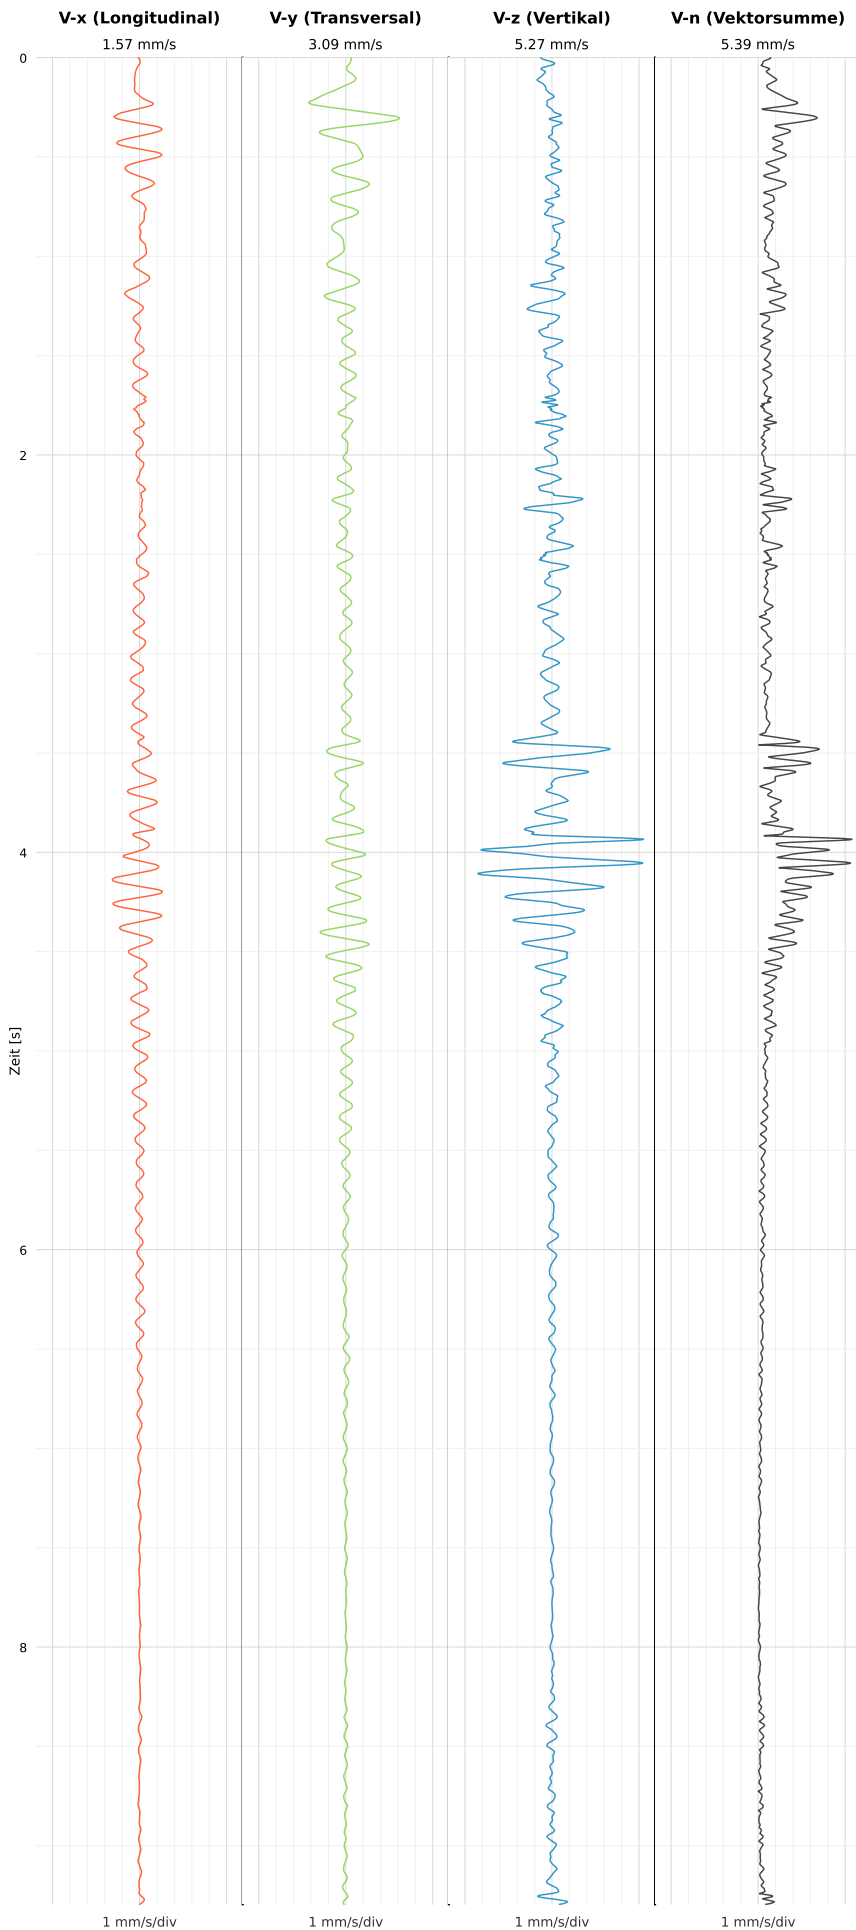


DATEI: 2492-PG-14-12052026-230344\_raw.csv

Aufzeichnungsdauer: 9.30 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	01:03:44
Event-ID	2492-PG-14-12052026-230344
Status	Kritisch
X	1.57 mm/s @ 8.6 Hz
Y	3.09 mm/s @ 8.7 Hz
Z	5.27 mm/s @ 8.7 Hz
Vn	5.39 mm/s @ 8.7 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

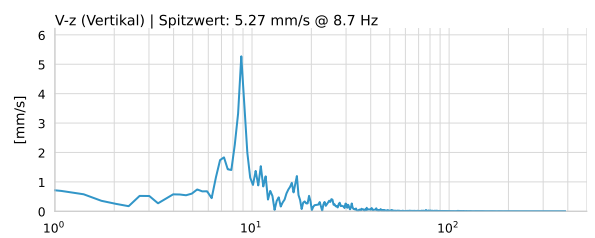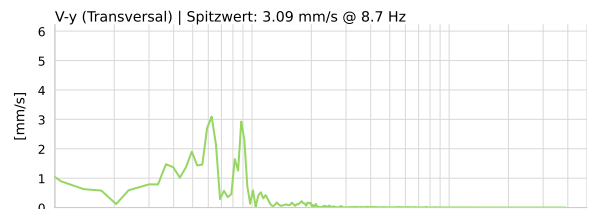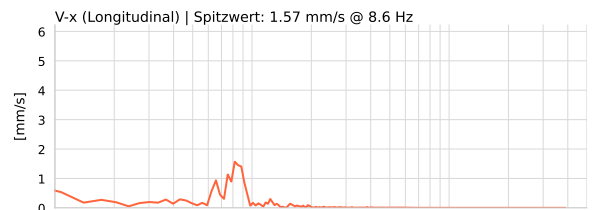

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.6 Hz	6.2 Hz	8.2 Hz	9.5 Hz
Y	8.7 Hz	4.6 Hz	6.2 Hz	9.1 Hz
Z	8.7 Hz	8.2 Hz	9.8 Hz	18.2 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

