


SCHWINGGESCHWINDIGKEIT

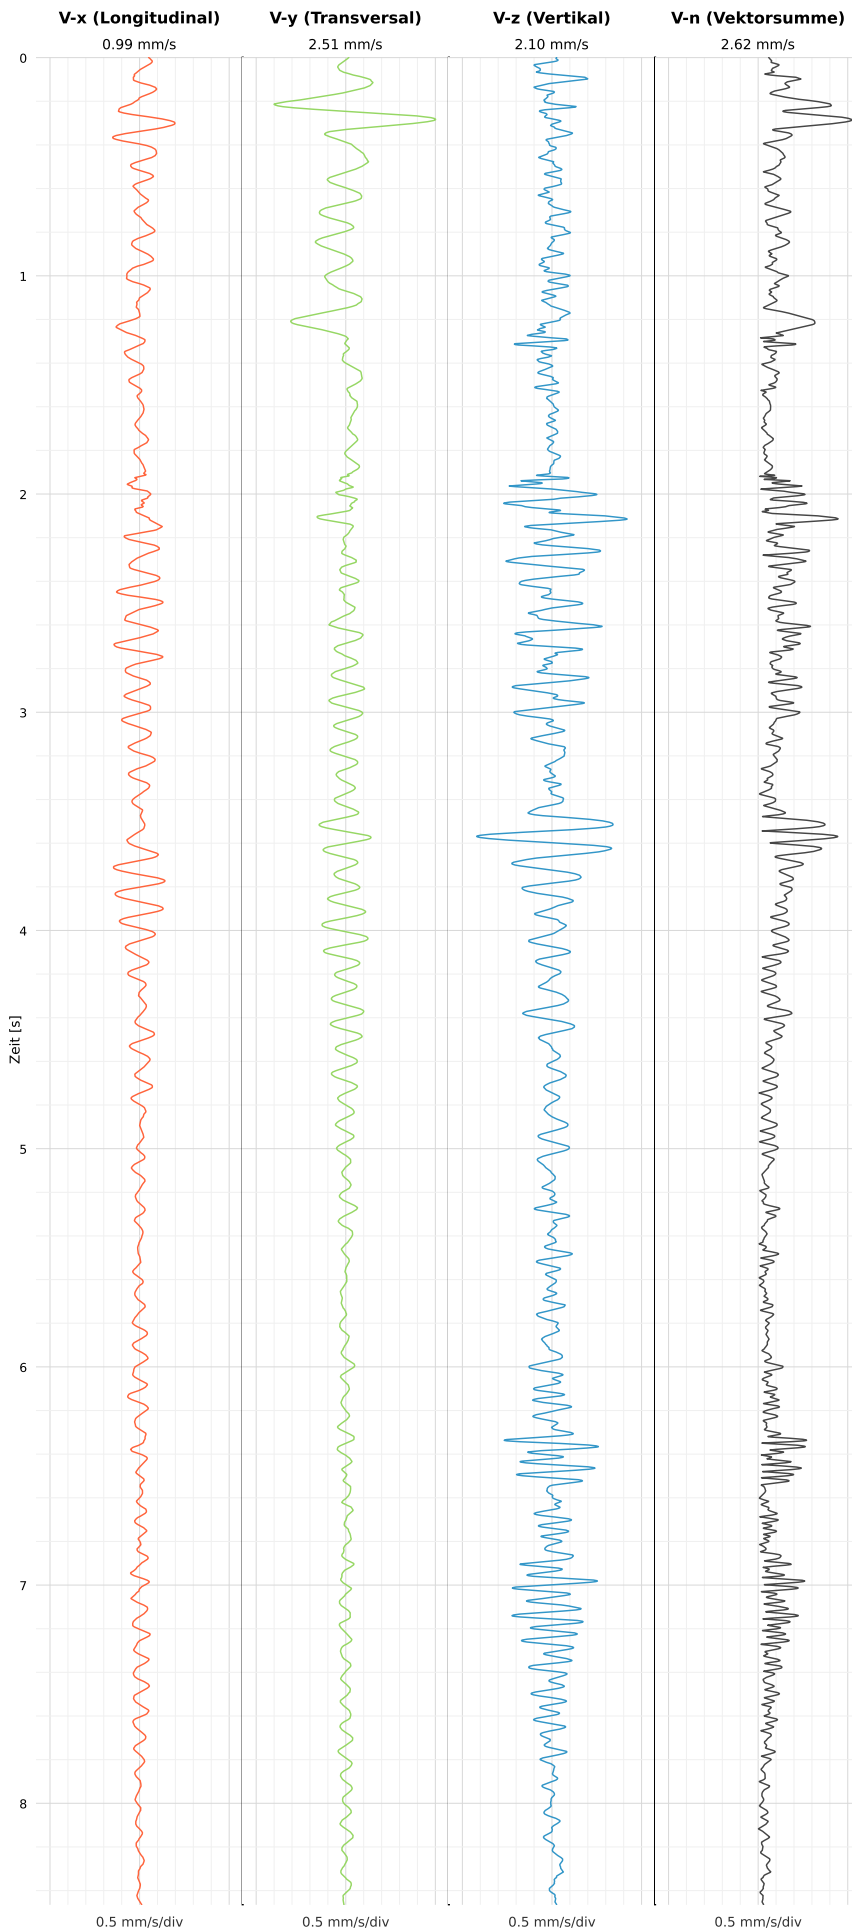


DATEI: 2492-PG-14-12052026-234551_raw.csv

Aufzeichnungsdauer: 8.46 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	01:45:51
Event-ID	2492-PG-14-12052026-234551
Status	Ereignis
X	0.99 mm/s @ 8.7 Hz
Y	2.51 mm/s @ 8.7 Hz
Z	2.10 mm/s @ 8.7 Hz
Vn	2.62 mm/s @ 8.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

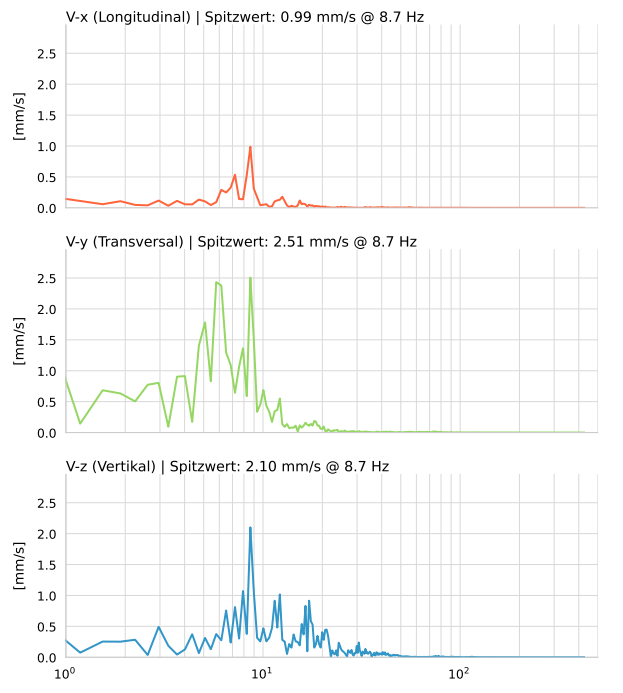

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.7 Hz	6.5 Hz	8.6 Hz	12.5 Hz
Y	8.7 Hz	4.7 Hz	6.5 Hz	9.0 Hz
Z	8.7 Hz	8.6 Hz	12.5 Hz	20.7 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

