


## SCHWINGGESCHWINDIGKEIT

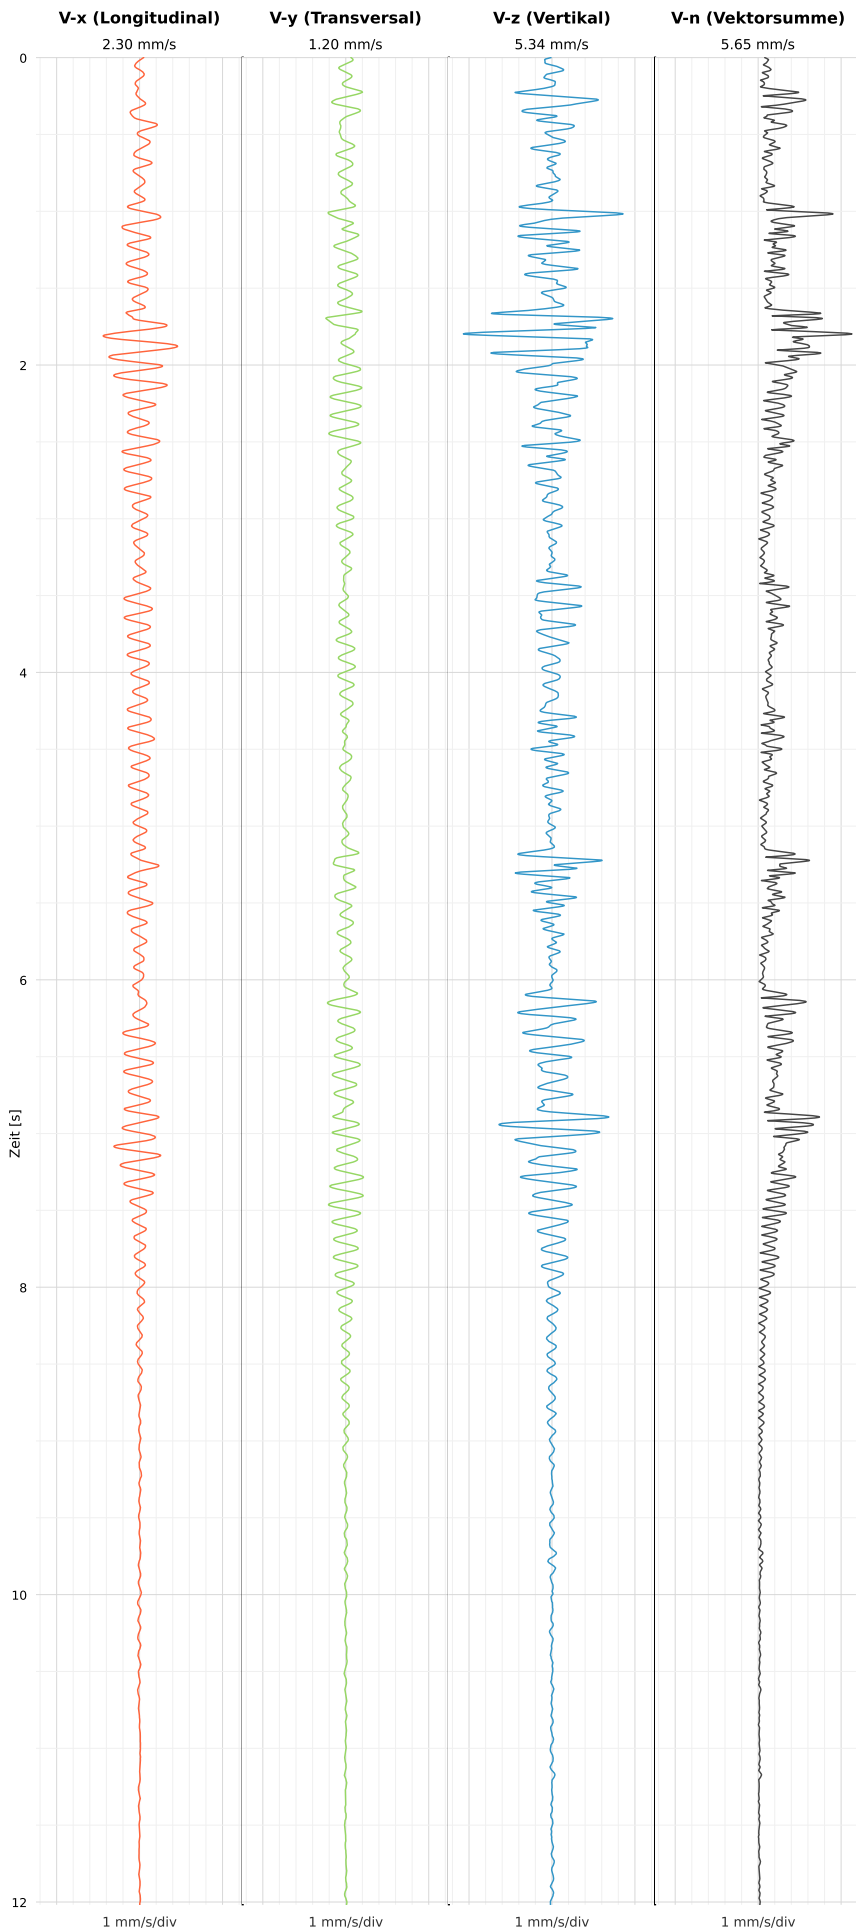


DATEI: 2492-PG-14-12052026-234622\_raw.csv

Aufzeichnungsdauer: 12.02 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	01:46:22
Event-ID	2492-PG-14-12052026-234622
Status	Kritisch
X	2.30 mm/s @ 8.4 Hz
Y	1.20 mm/s @ 8.4 Hz
Z	5.34 mm/s @ 8.6 Hz
Vn	5.65 mm/s @ 8.6 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

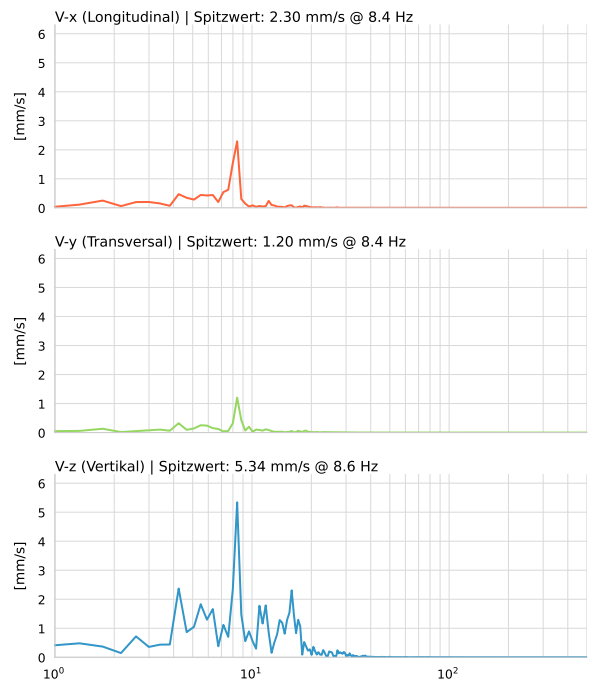

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.4 Hz	5.9 Hz	8.0 Hz	8.4 Hz
Y	8.4 Hz	5.9 Hz	8.4 Hz	10.9 Hz
Z	8.6 Hz	7.2 Hz	10.9 Hz	15.9 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

