


SCHWINGGESCHWINDIGKEIT

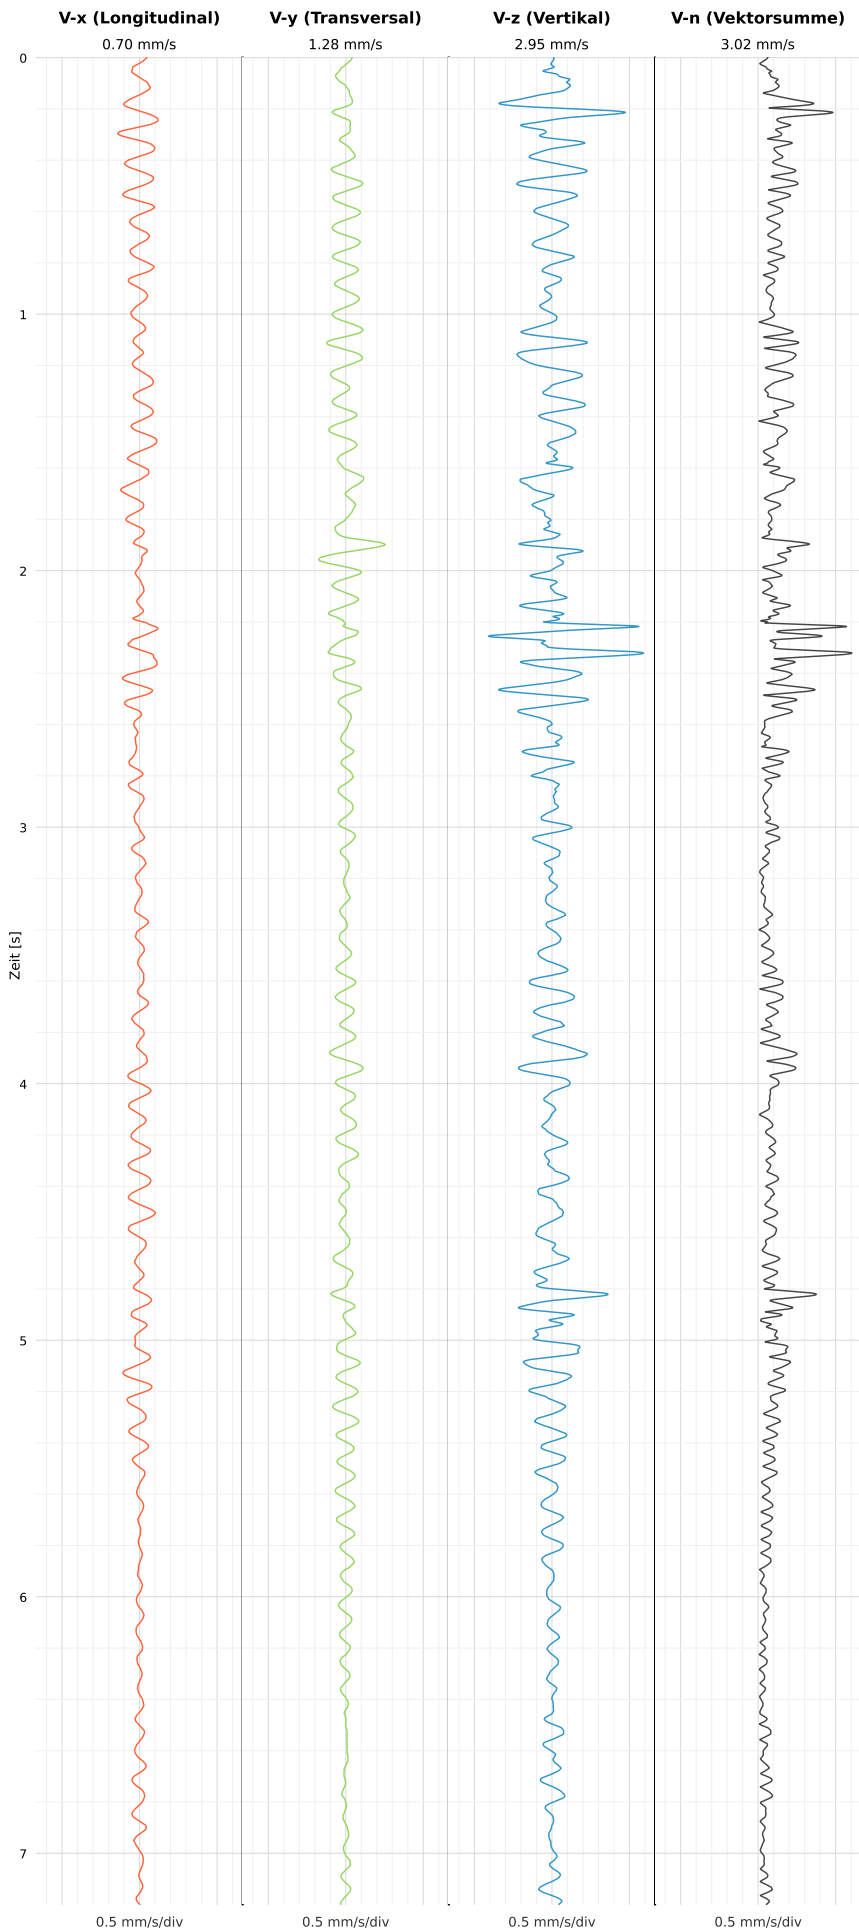


DATEI: 2492-PG-14-13052026-085008_raw.csv

Aufzeichnungsdauer: 7.20 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	10:50:08
Event-ID	2492-PG-14-13052026-085008
Status	Ereignis
X	0.70 mm/s @ 8.8 Hz
Y	1.28 mm/s @ 8.8 Hz
Z	2.95 mm/s @ 8.8 Hz
Vn	3.02 mm/s @ 8.8 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

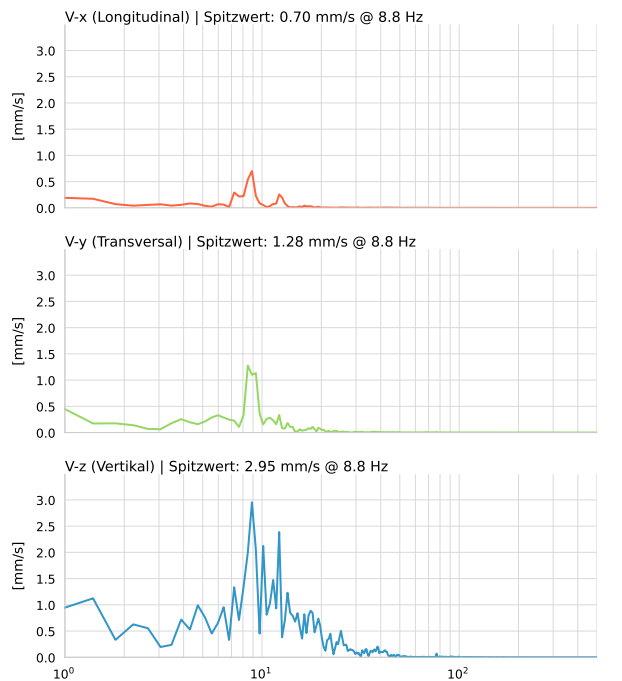

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.8 Hz	7.2 Hz	8.9 Hz	12.6 Hz
Y	8.8 Hz	6.8 Hz	8.9 Hz	13.5 Hz
Z	8.8 Hz	8.5 Hz	11.8 Hz	18.5 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

