


SCHWINGGESCHWINDIGKEIT

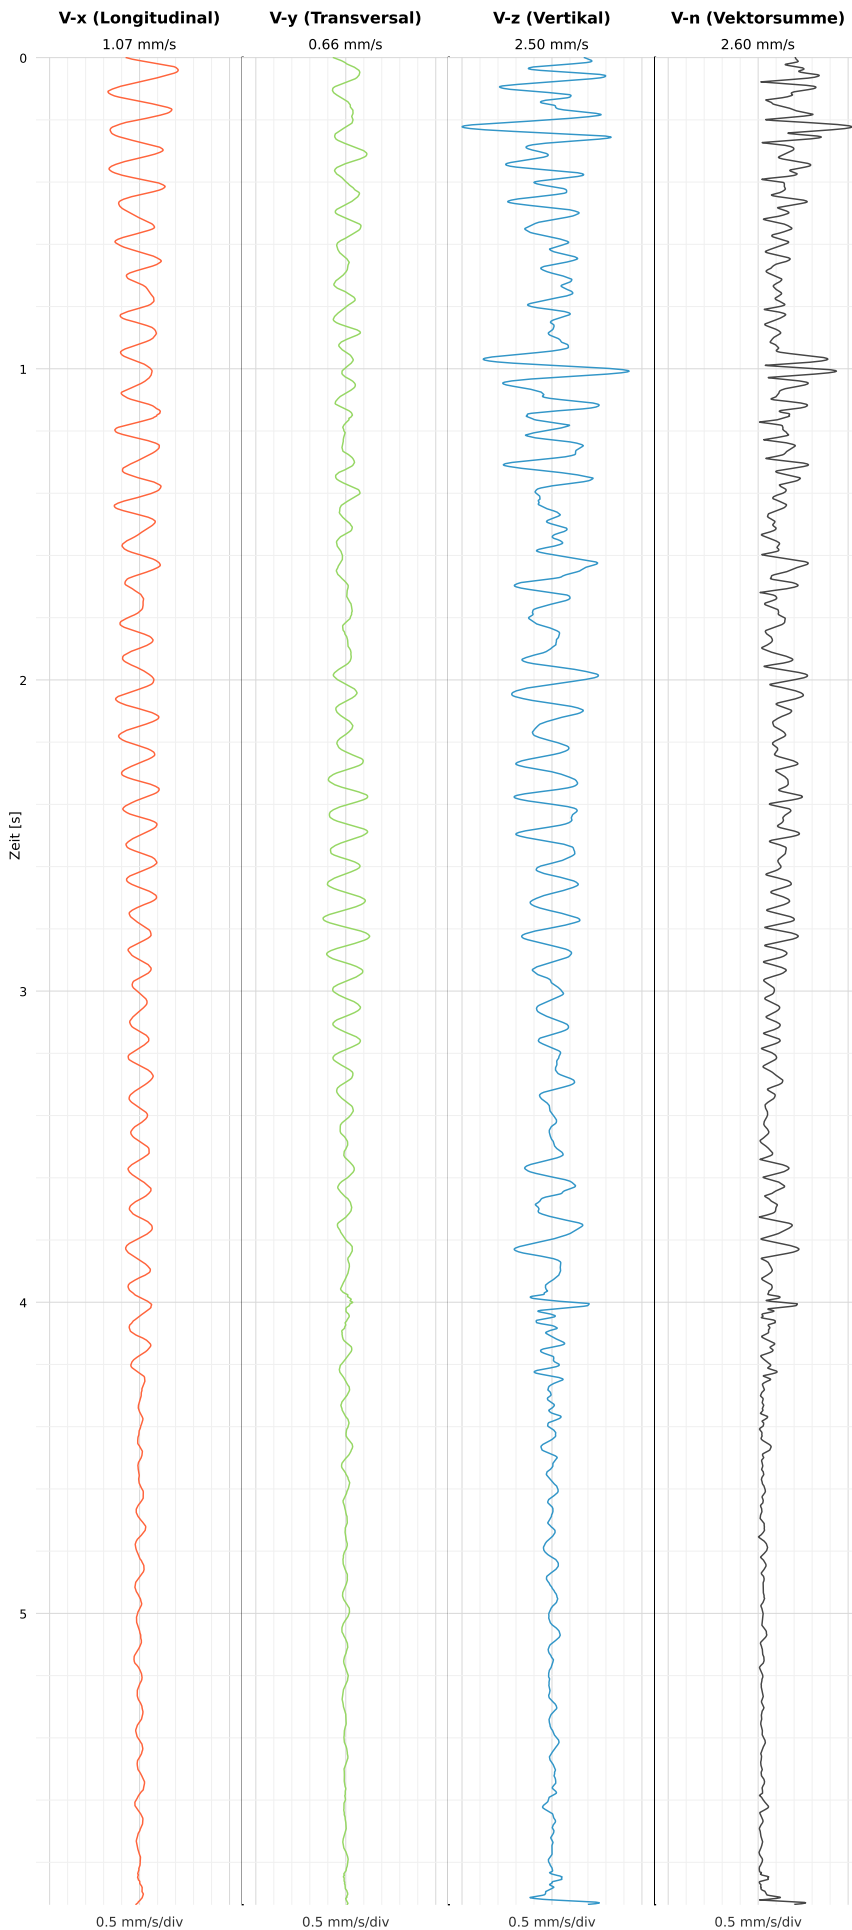


DATEI: 2492-PG-14-13052026-091646_raw.csv

Aufzeichnungsdauer: 5.94 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	11:16:46
Event-ID	2492-PG-14-13052026-091646
Status	Ereignis
X	1.07 mm/s @ 8.4 Hz
Y	0.66 mm/s @ 9.1 Hz
Z	2.50 mm/s @ 9.1 Hz
Vn	2.60 mm/s @ 9.1 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

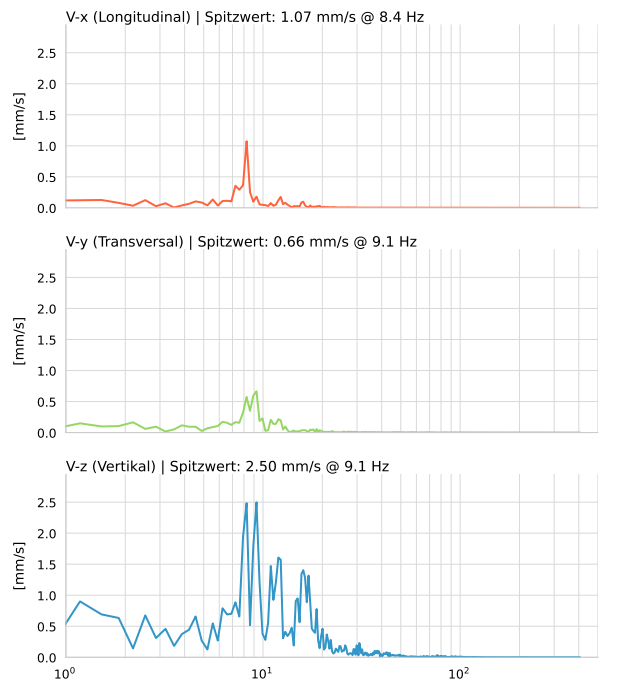

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.4 Hz	7.2 Hz	8.3 Hz	13.0 Hz
Y	9.1 Hz	7.6 Hz	9.3 Hz	15.7 Hz
Z	9.1 Hz	8.3 Hz	12.0 Hz	17.0 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

