


SCHWINGGESCHWINDIGKEIT

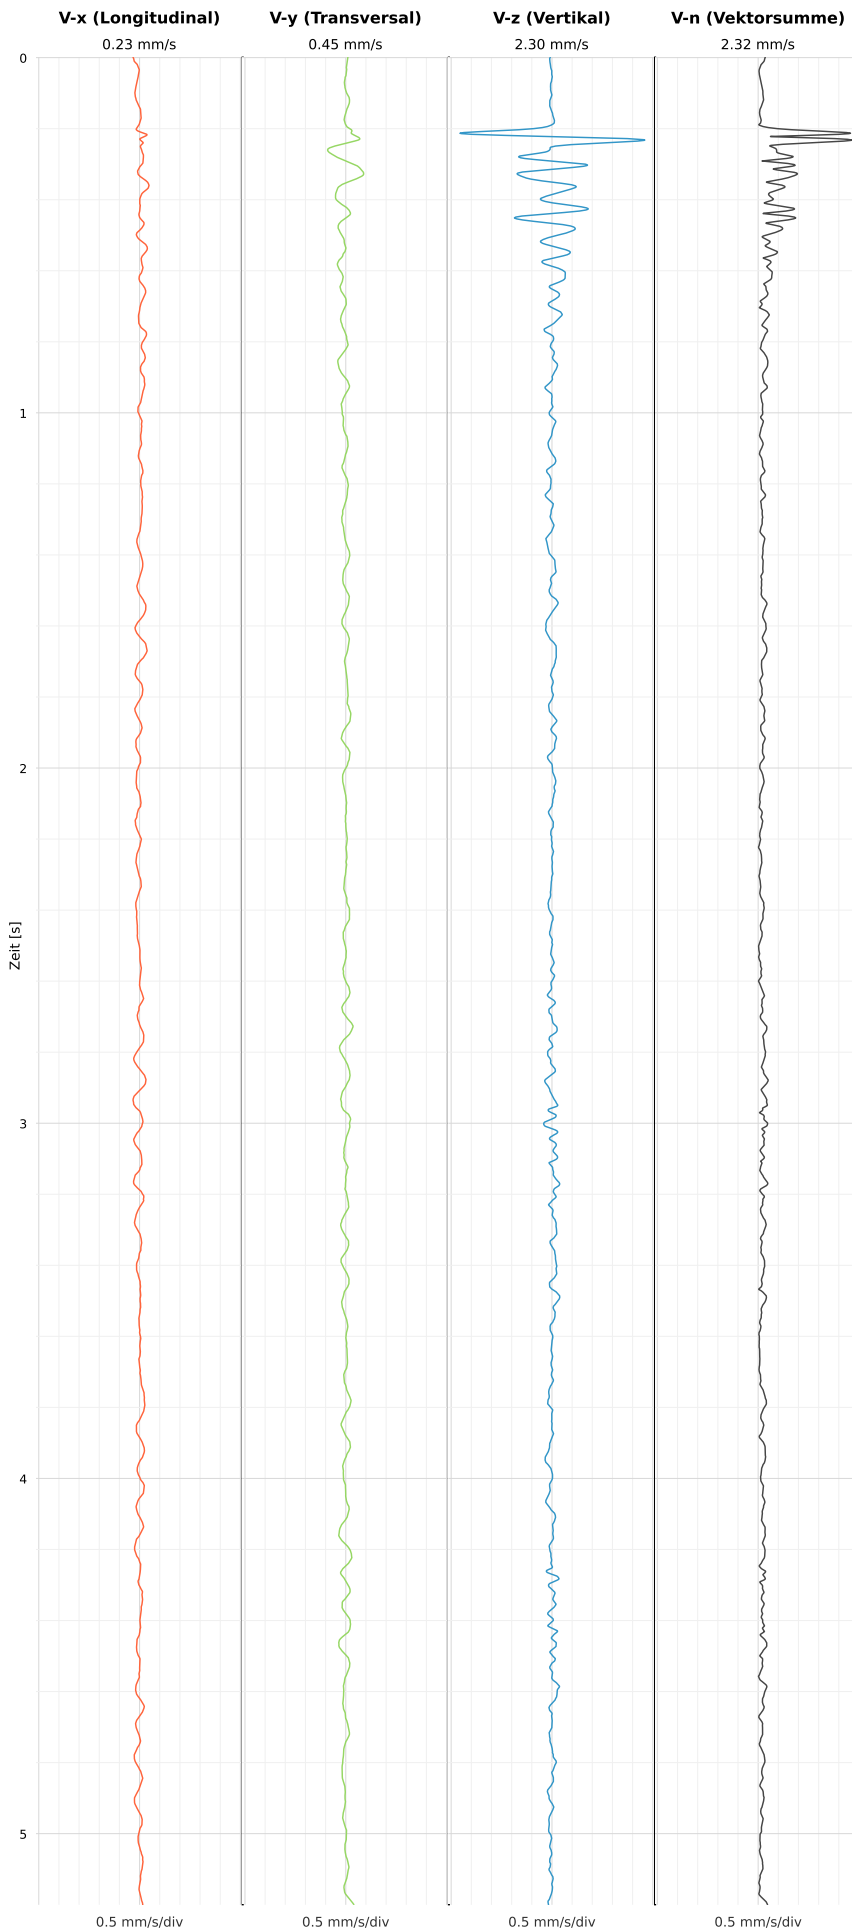


DATEI: 2492-PG-14-13052026-091941_raw.csv

Aufzeichnungsdauer: 5.20 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	11:19:41
Event-ID	2492-PG-14-13052026-091941
Status	Ereignis
X	0.23 mm/s @ 8.8 Hz
Y	0.45 mm/s @ 6.7 Hz
Z	2.30 mm/s @ 8.7 Hz
Vn	2.32 mm/s @ 8.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

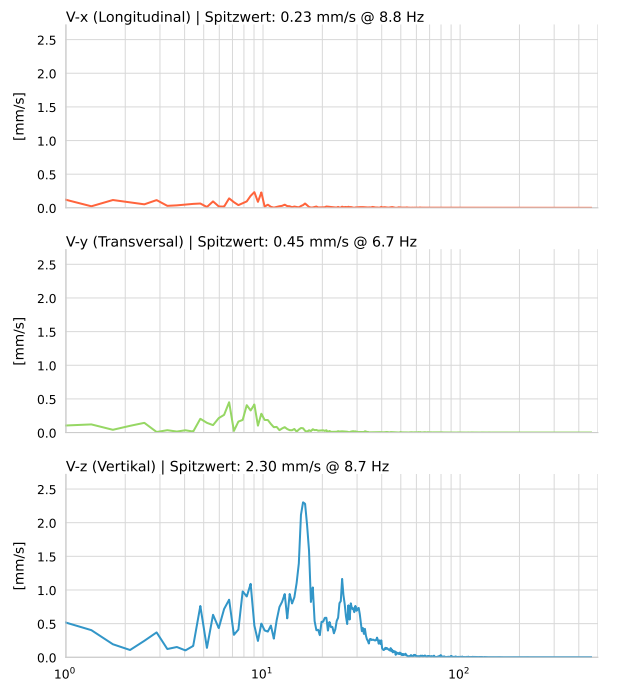

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.8 Hz	5.6 Hz	9.8 Hz	34.8 Hz
Y	6.7 Hz	6.3 Hz	9.0 Hz	16.7 Hz
Z	8.7 Hz	13.7 Hz	17.9 Hz	28.7 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

