


## SCHWINGGESCHWINDIGKEIT

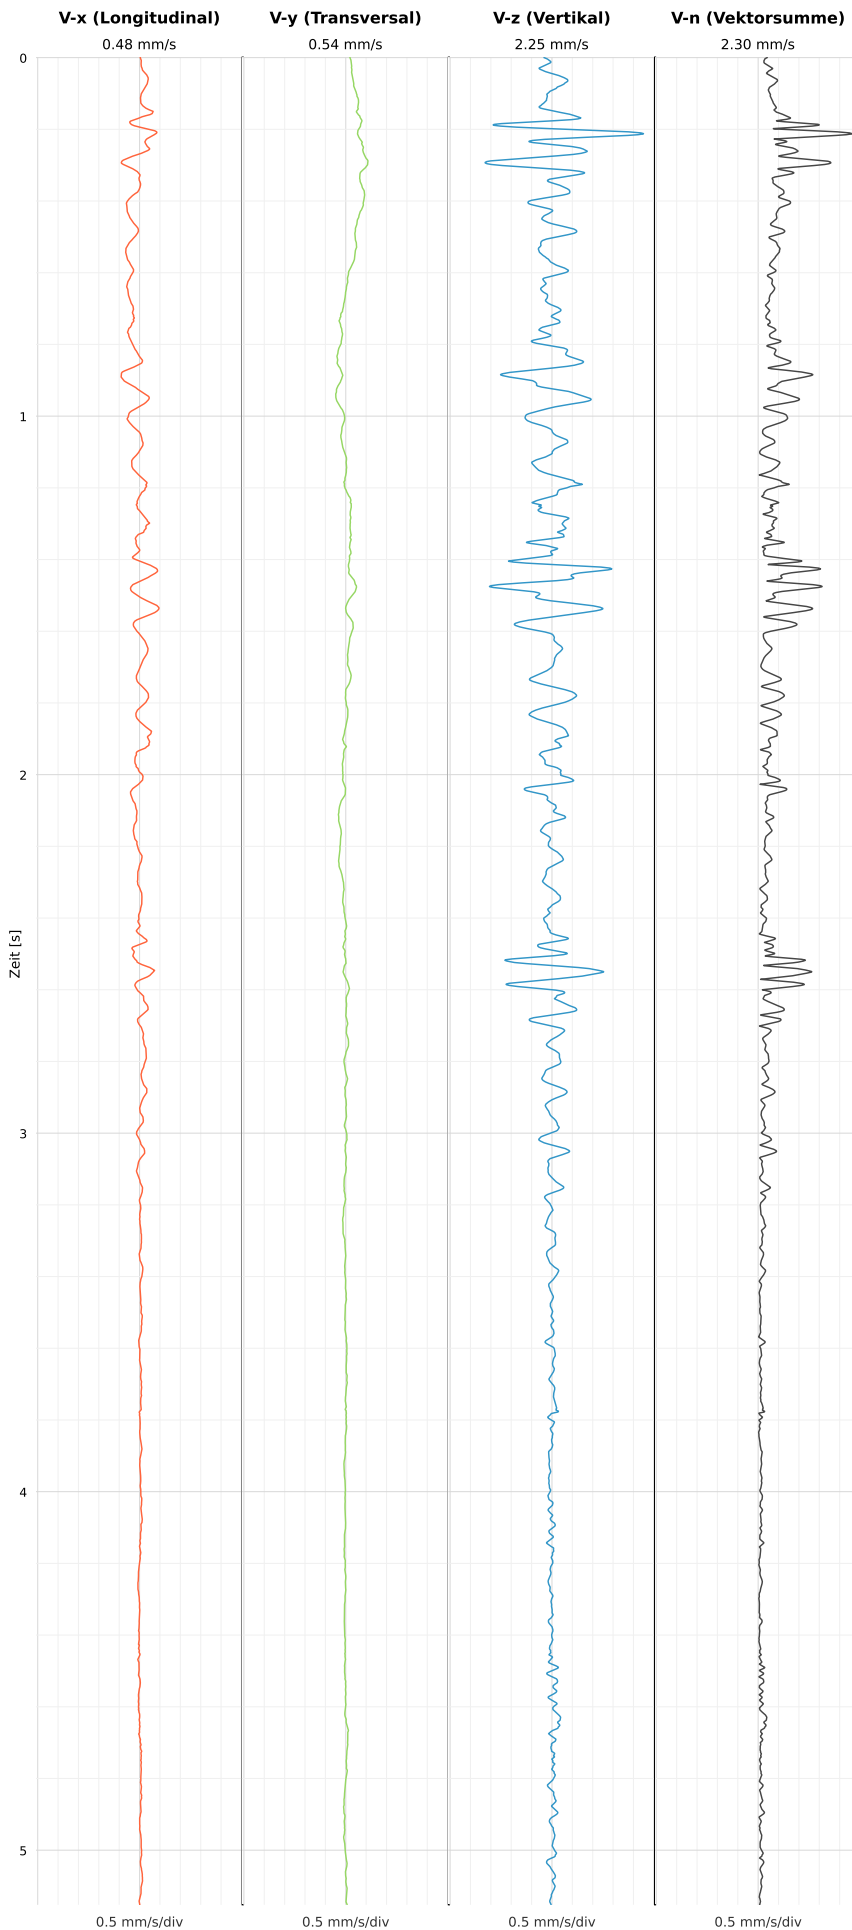


**DATEI: 2492-PG-14-13052026-125124\_raw.csv**

Aufzeichnungsdauer: 5.15 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	14:51:24
Event-ID	2492-PG-14-13052026-125124
Status	Ereignis
X	0.48 mm/s @ 8.7 Hz
Y	0.54 mm/s @ 8.7 Hz
Z	2.25 mm/s @ 8.7 Hz
Vn	2.30 mm/s @ 8.7 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

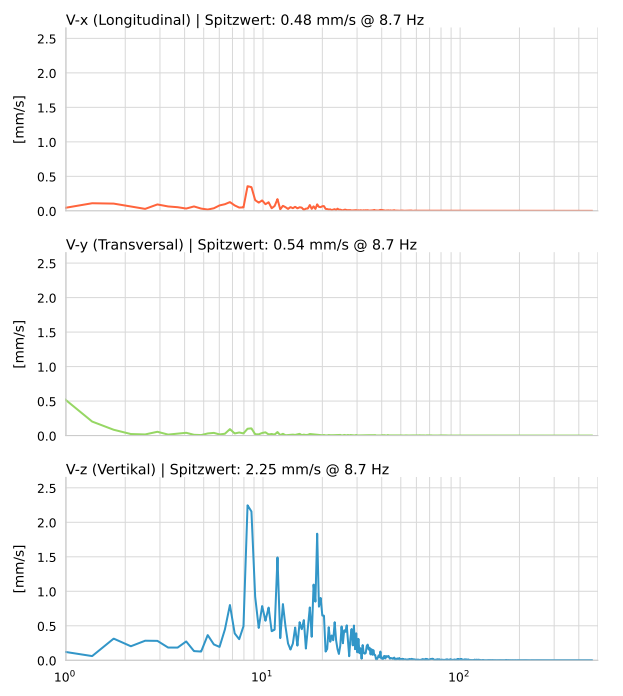

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.7 Hz	4.5 Hz	9.5 Hz	18.1 Hz
Y	8.7 Hz	0.6 Hz	2.9 Hz	14.2 Hz
Z	8.7 Hz	9.1 Hz	17.3 Hz	25.0 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

