


## SCHWINGGESCHWINDIGKEIT

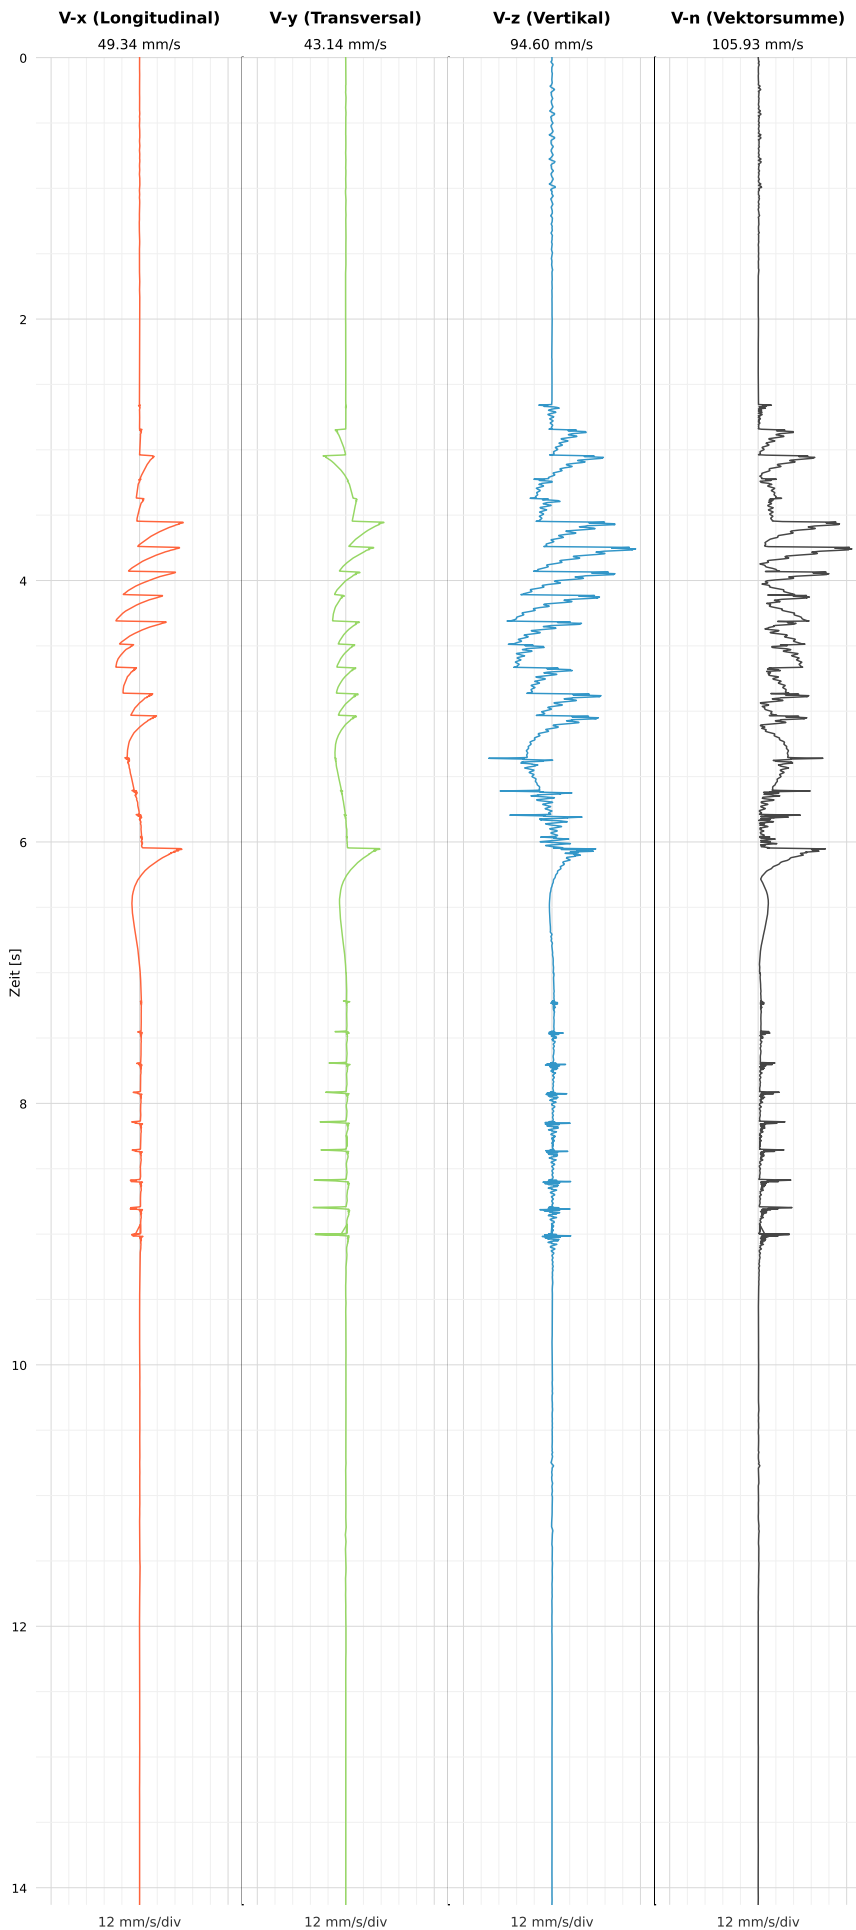


DATEI: 2492-PG-8-12052026-191006\_raw.csv

Aufzeichnungsdauer: 14.13 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	21:10:06
Event-ID	2492-PG-8-12052026-191006
Status	Kritisch
X	49.34 mm/s @ 1.1 Hz
Y	43.14 mm/s @ 1.2 Hz
Z	94.60 mm/s @ 1.1 Hz
Vn	105.93 mm/s @ 1.1 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

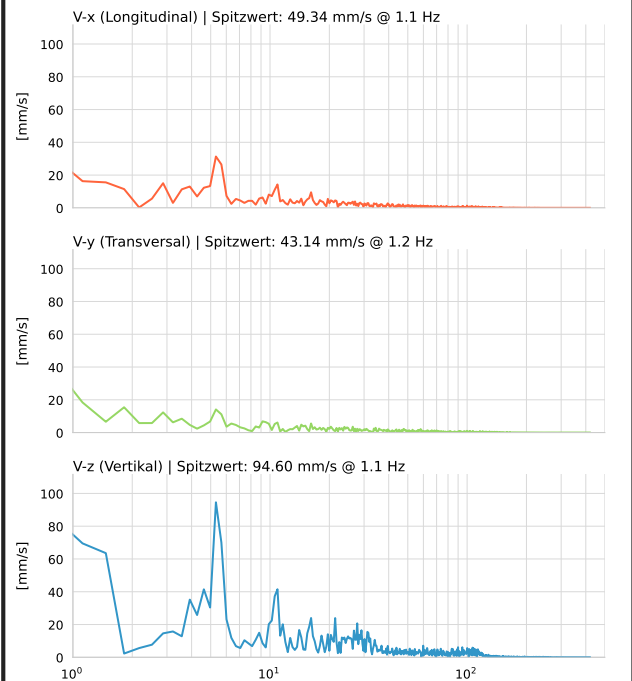

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	1.1 Hz	4.6 Hz	14.1 Hz	41.3 Hz
Y	1.2 Hz	3.6 Hz	16.9 Hz	52.2 Hz
Z	1.1 Hz	5.3 Hz	21.1 Hz	57.8 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

