


SCHWINGGESCHWINDIGKEIT

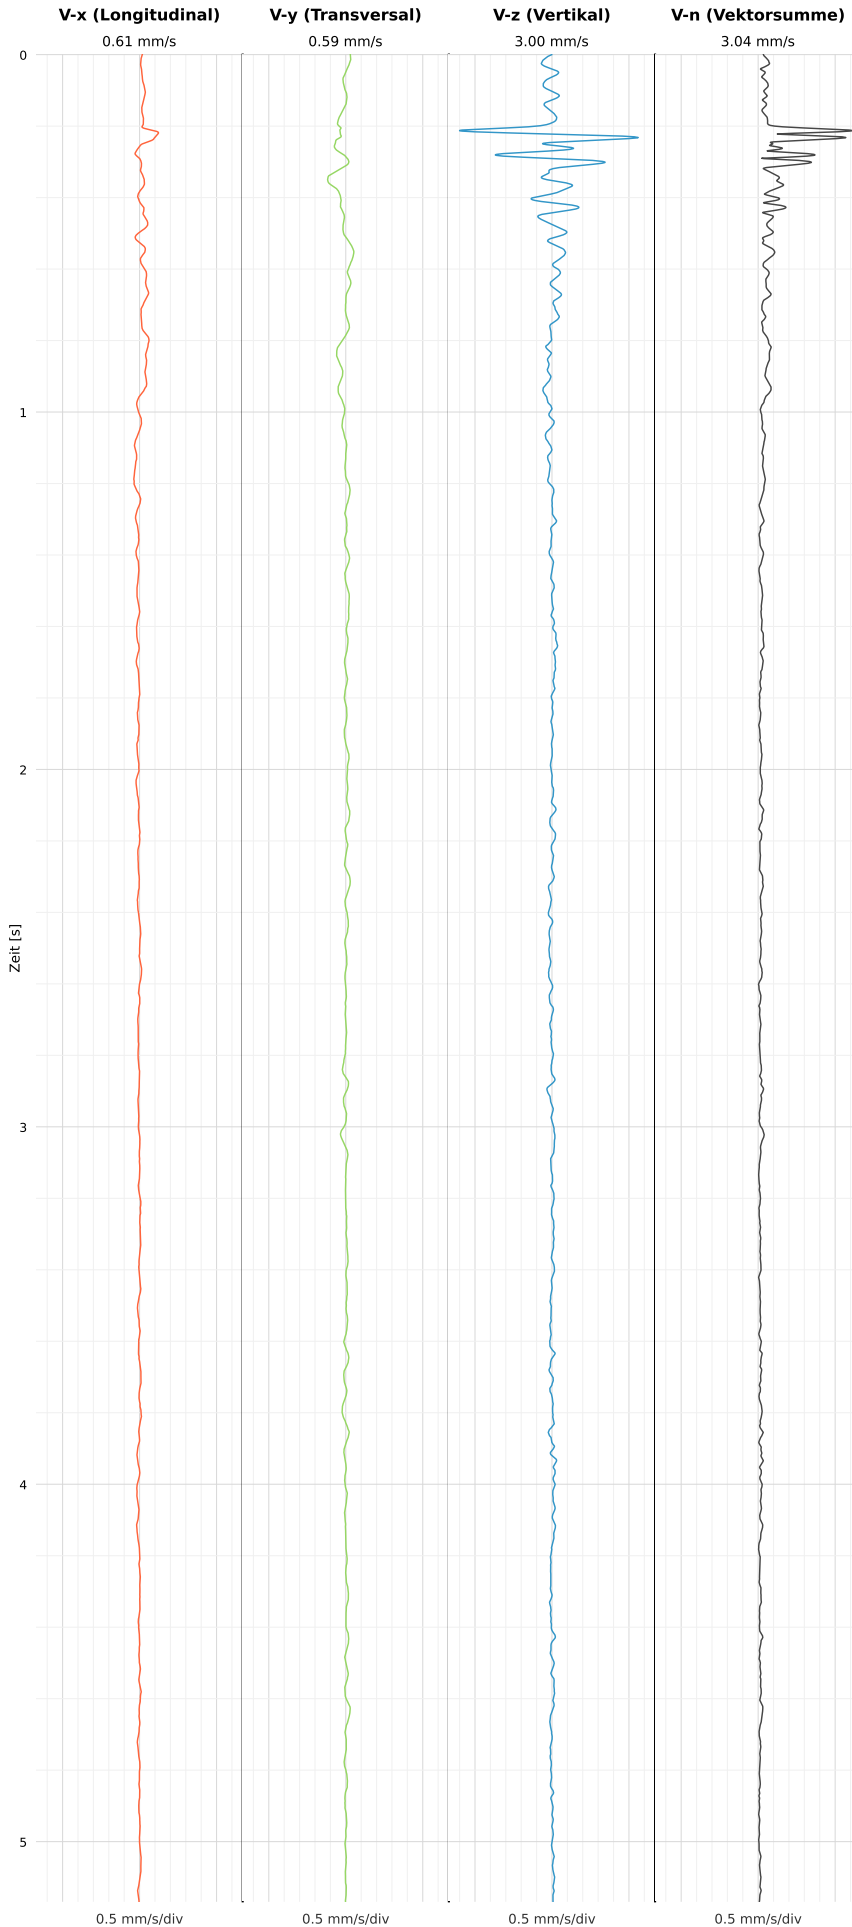


DATEI: 2492-PG-8-12052026-192128_raw.csv

Aufzeichnungsdauer: 5.17 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	21:21:28
Event-ID	2492-PG-8-12052026-192128
Status	Ereignis
X	0.61 mm/s @ 1.2 Hz
Y	0.59 mm/s @ 9.1 Hz
Z	3.00 mm/s @ 1.2 Hz
Vn	3.04 mm/s @ 1.2 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

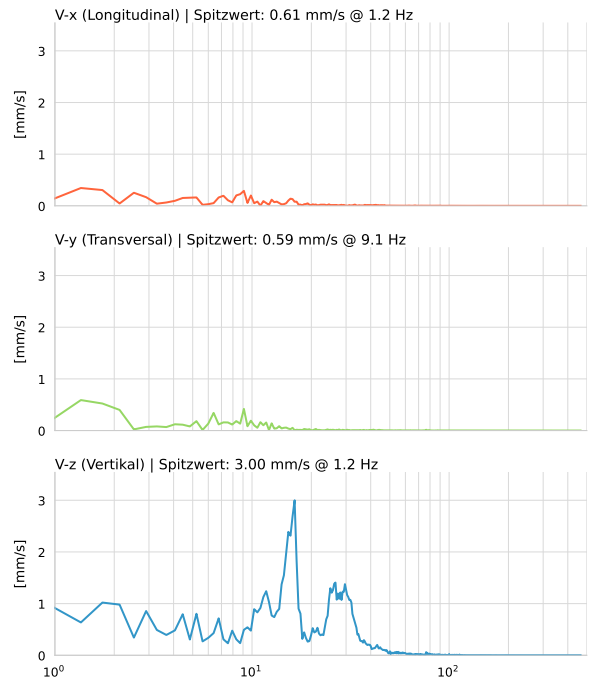

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	1.2 Hz	2.5 Hz	8.7 Hz	17.6 Hz
Y	9.1 Hz	2.1 Hz	7.9 Hz	15.3 Hz
Z	1.2 Hz	13.4 Hz	19.5 Hz	29.6 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

