


## SCHWINGGESCHWINDIGKEIT

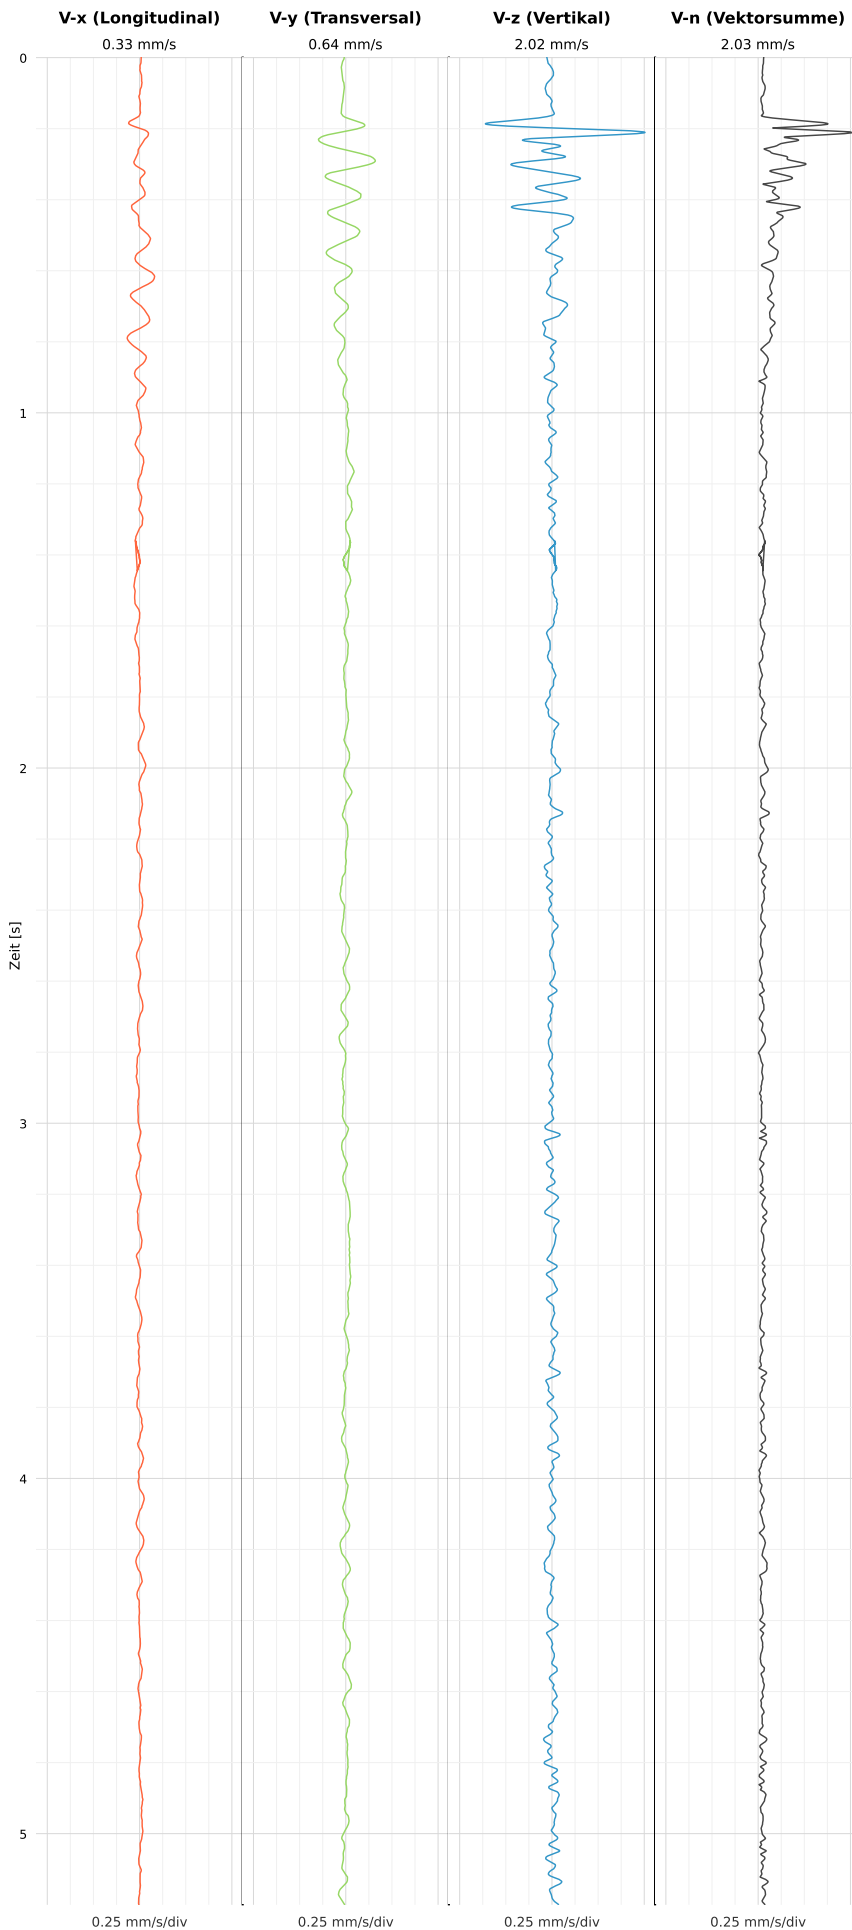


DATEI: 2492-PG-8-12052026-192502\_raw.csv

Aufzeichnungsdauer: 5.20 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	21:25:02
Event-ID	2492-PG-8-12052026-192502
Status	Ereignis
X	0.33 mm/s @ 9.7 Hz
Y	0.64 mm/s @ 9.7 Hz
Z	2.02 mm/s @ 16.5 Hz
Vn	2.03 mm/s @ 16.5 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

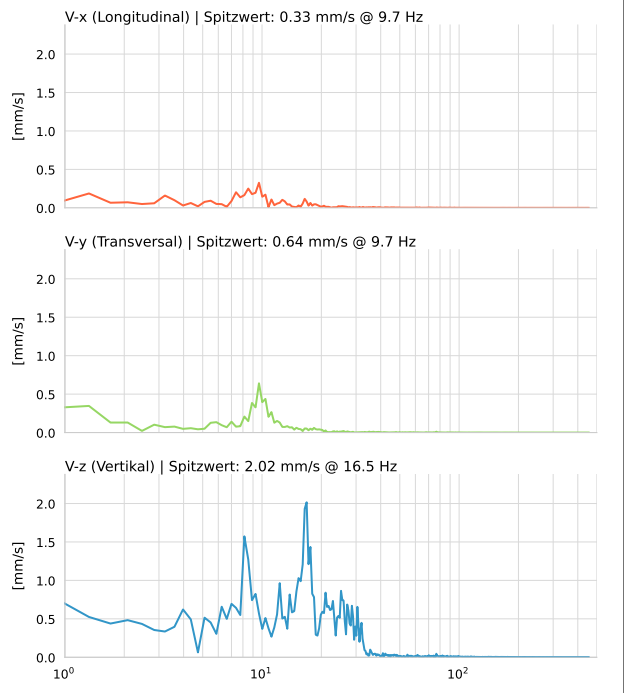

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	9.7 Hz	5.9 Hz	9.6 Hz	17.2 Hz
Y	9.7 Hz	5.9 Hz	9.6 Hz	12.7 Hz
Z	16.5 Hz	10.0 Hz	16.8 Hz	25.5 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

