


SCHWINGGESCHWINDIGKEIT

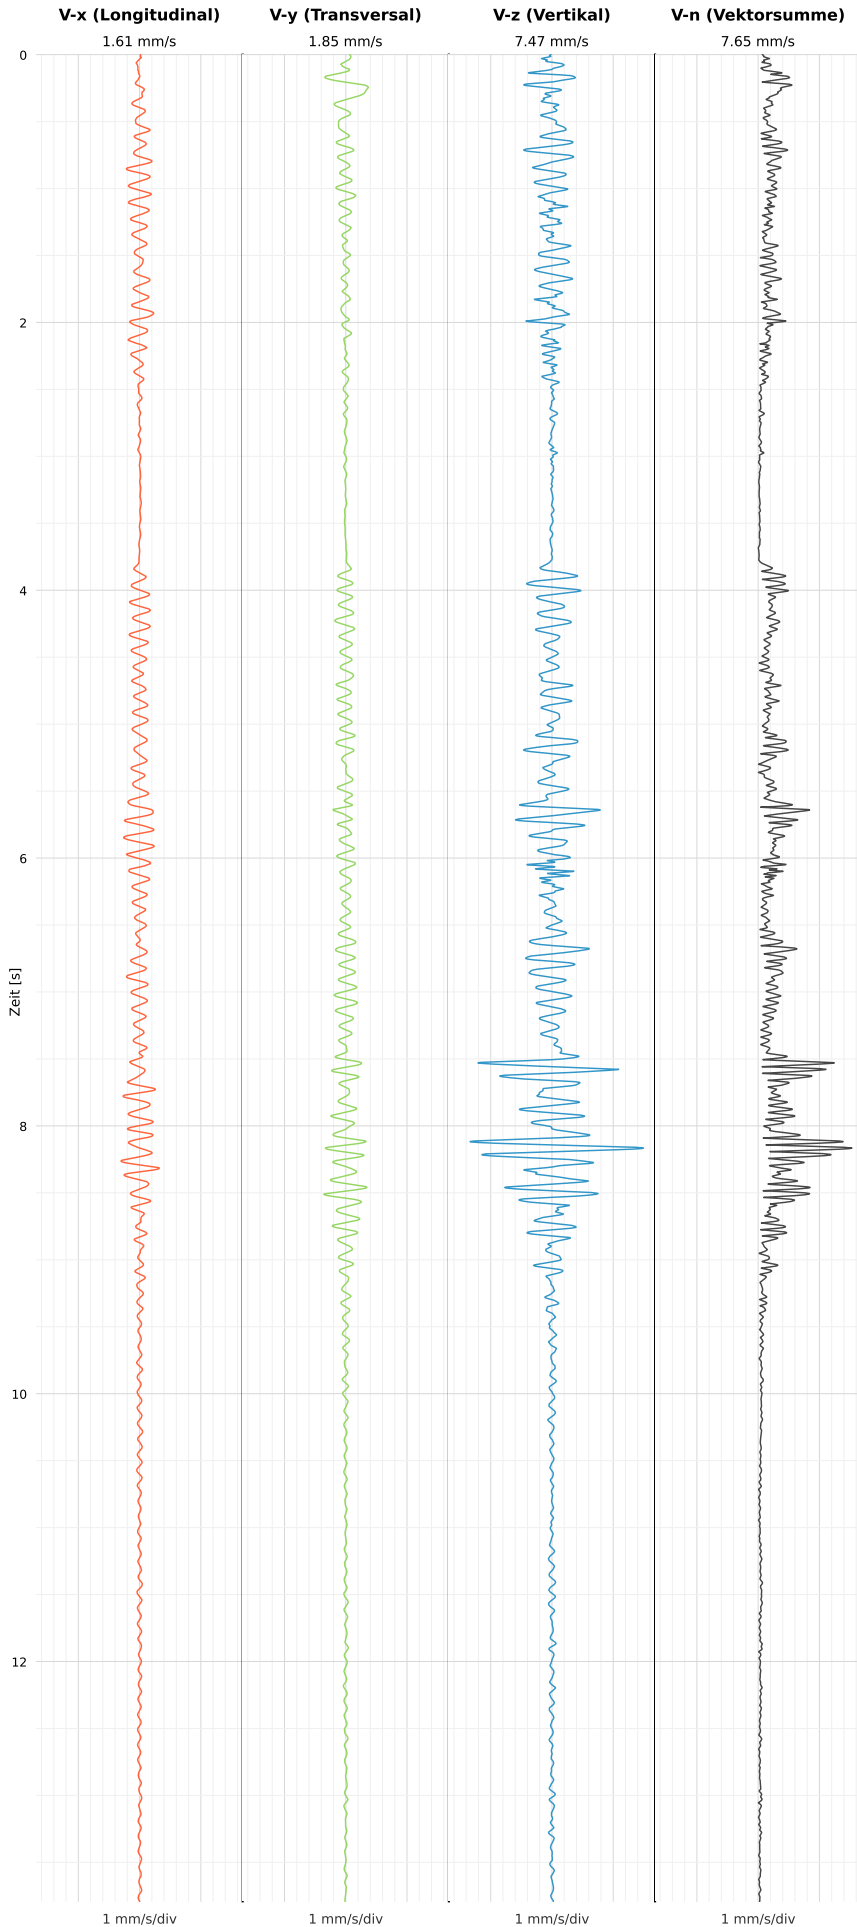


DATEI: 2492-PG-8-12052026-192536_raw.csv

Aufzeichnungsdauer: 13.79 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	21:25:36
Event-ID	2492-PG-8-12052026-192536
Status	Kritisch
X	1.61 mm/s @ 8.6 Hz
Y	1.85 mm/s @ 8.6 Hz
Z	7.47 mm/s @ 8.7 Hz
Vn	7.65 mm/s @ 8.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

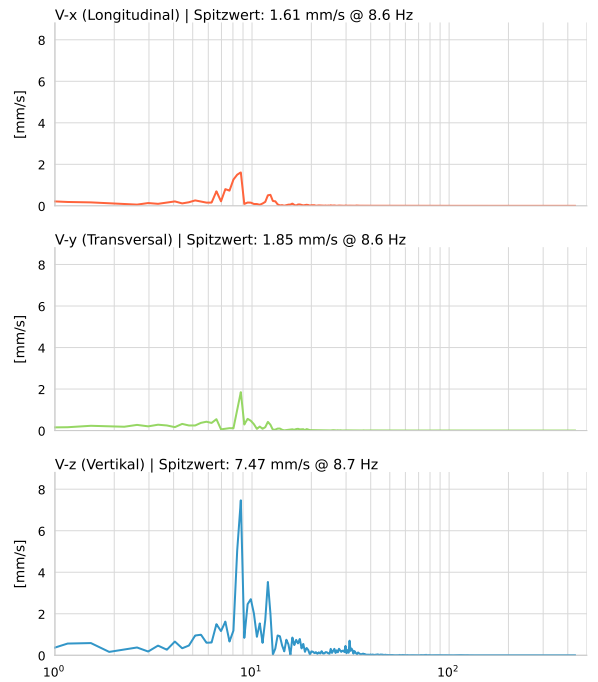

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.6 Hz	6.6 Hz	8.4 Hz	11.7 Hz
Y	8.6 Hz	5.5 Hz	8.8 Hz	10.9 Hz
Z	8.7 Hz	8.4 Hz	9.9 Hz	15.3 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

