


SCHWINGGESCHWINDIGKEIT

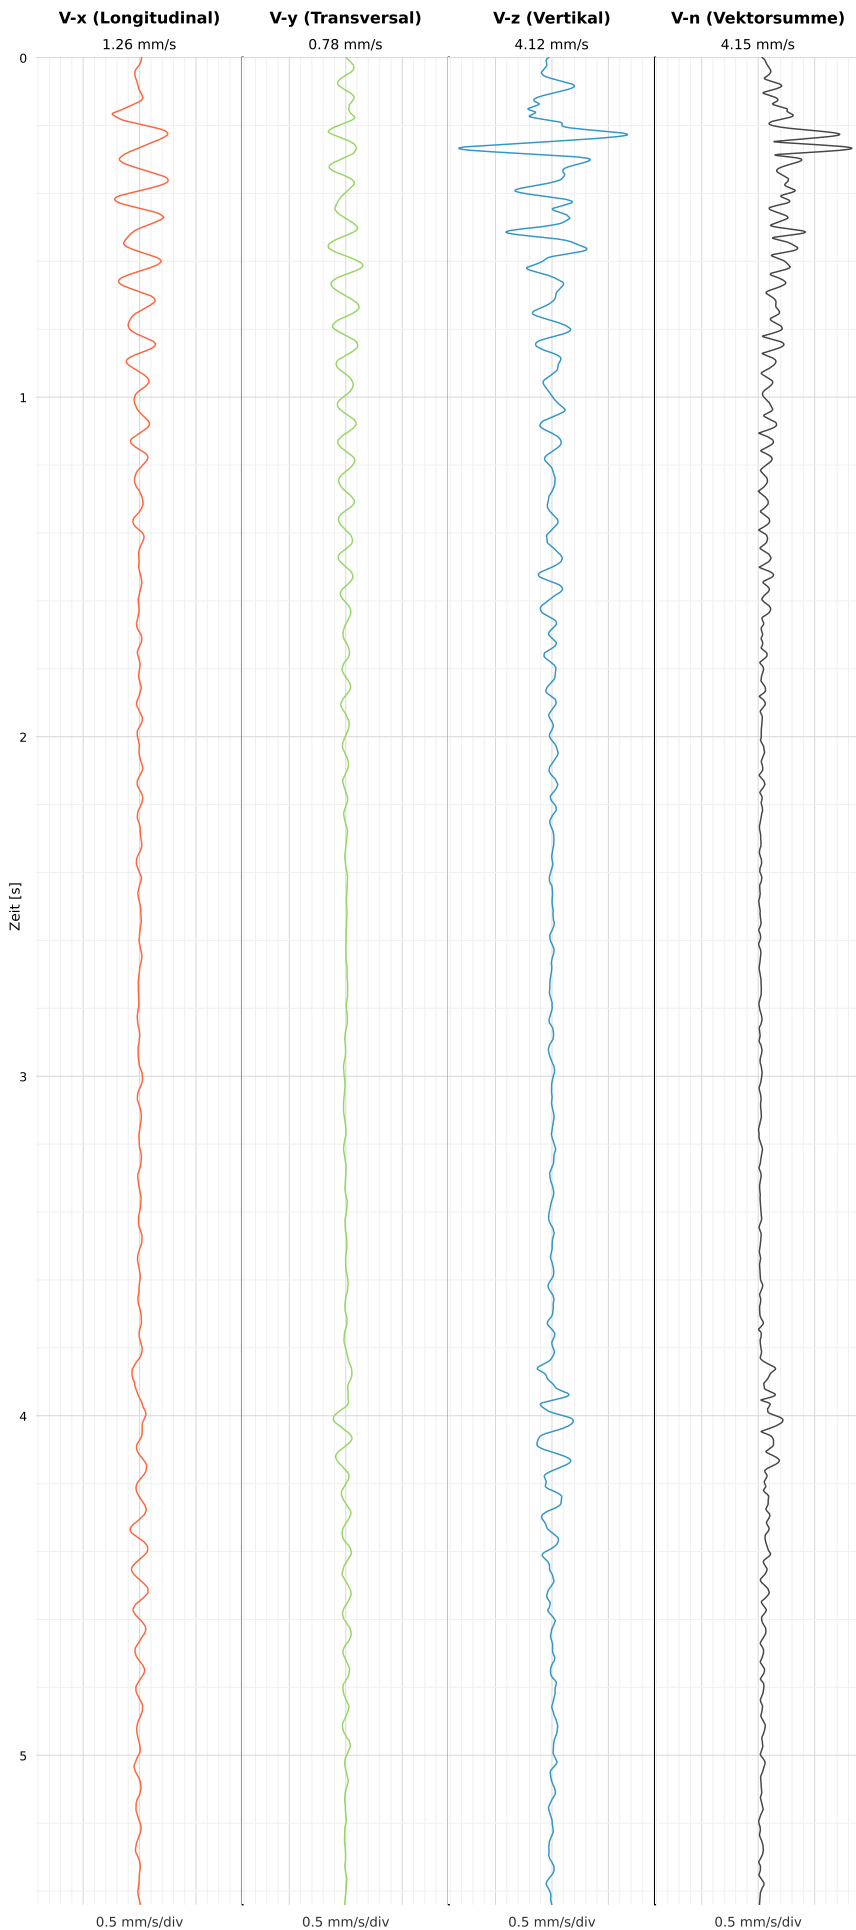


DATEI: 2492-PG-8-12052026-192605_raw.csv

Aufzeichnungsdauer: 5.44 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	21:26:05
Event-ID	2492-PG-8-12052026-192605
Status	Hinweis
X	1.26 mm/s @ 8.6 Hz
Y	0.78 mm/s @ 9.0 Hz
Z	4.12 mm/s @ 9.0 Hz
Vn	4.15 mm/s @ 9.0 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

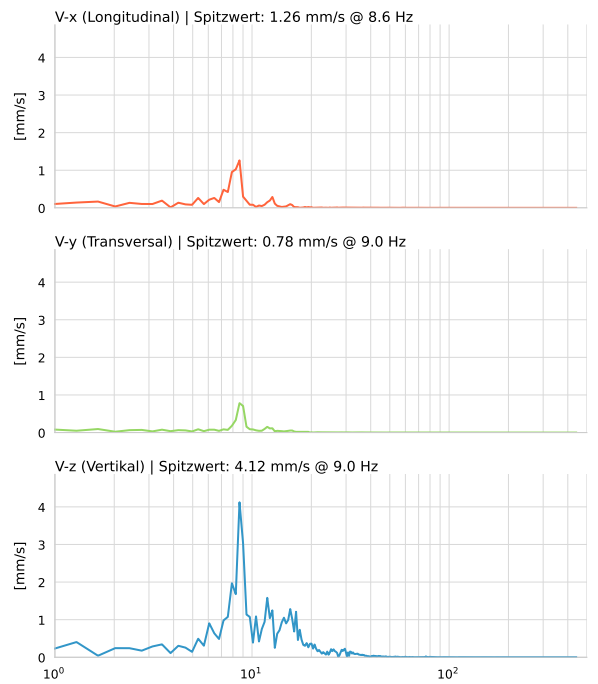

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.6 Hz	6.8 Hz	8.3 Hz	9.7 Hz
Y	9.0 Hz	7.9 Hz	9.0 Hz	12.3 Hz
Z	9.0 Hz	8.6 Hz	11.9 Hz	16.7 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

