


SCHWINGGESCHWINDIGKEIT

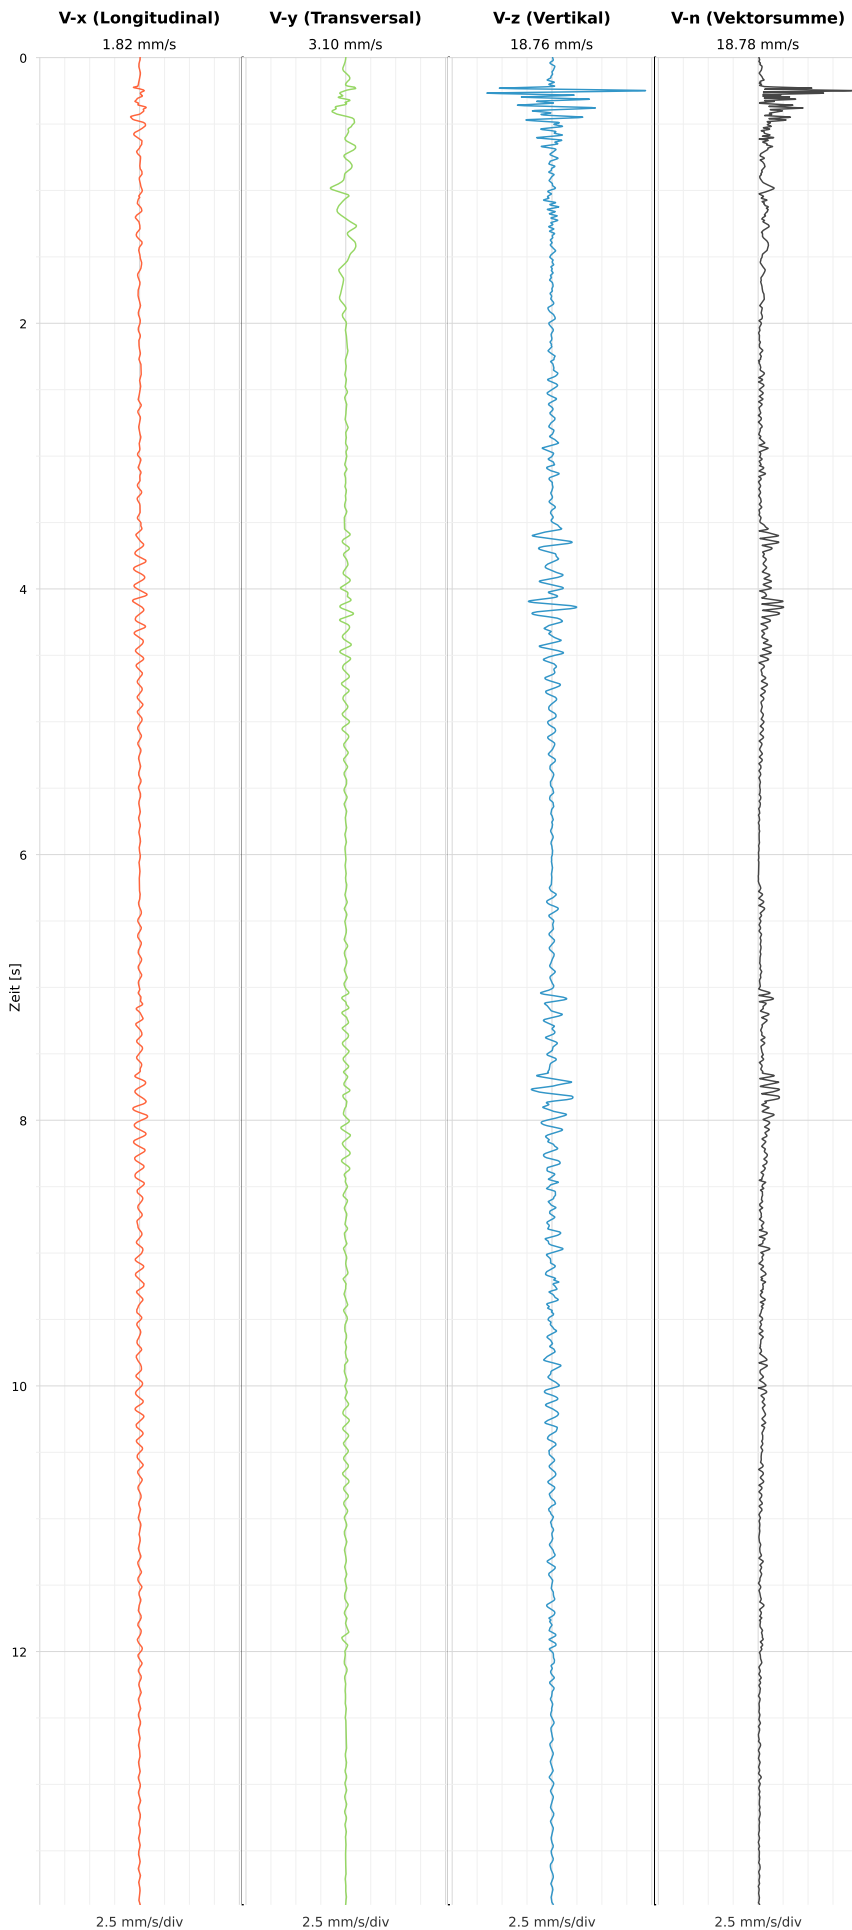


DATEI: 2492-PG-8-12052026-201112_raw.csv

Aufzeichnungsdauer: 13.90 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	22:11:12
Event-ID	2492-PG-8-12052026-201112
Status	Kritisch
X	1.82 mm/s @ 7.9 Hz
Y	3.10 mm/s @ 8.9 Hz
Z	18.76 mm/s @ 7.9 Hz
Vn	18.78 mm/s @ 7.9 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

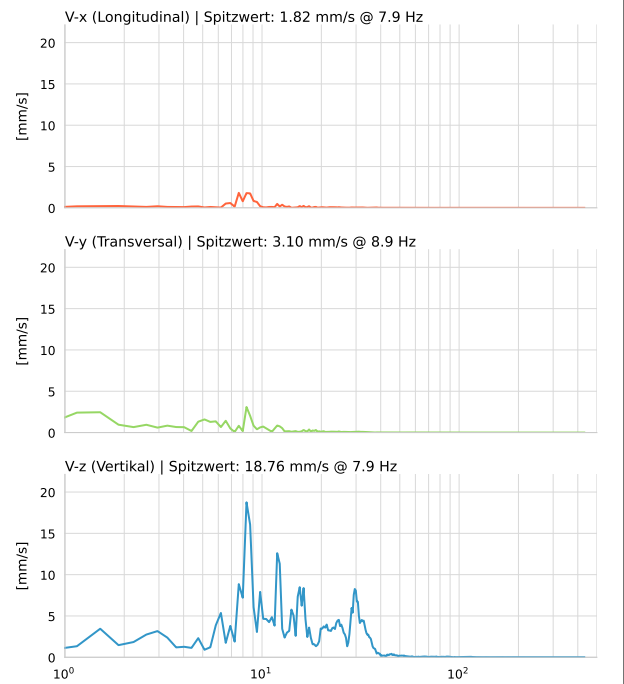

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	7.9 Hz	7.6 Hz	8.7 Hz	15.5 Hz
Y	8.9 Hz	3.7 Hz	7.6 Hz	11.9 Hz
Z	7.9 Hz	9.8 Hz	17.3 Hz	29.2 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

