


## SCHWINGGESCHWINDIGKEIT

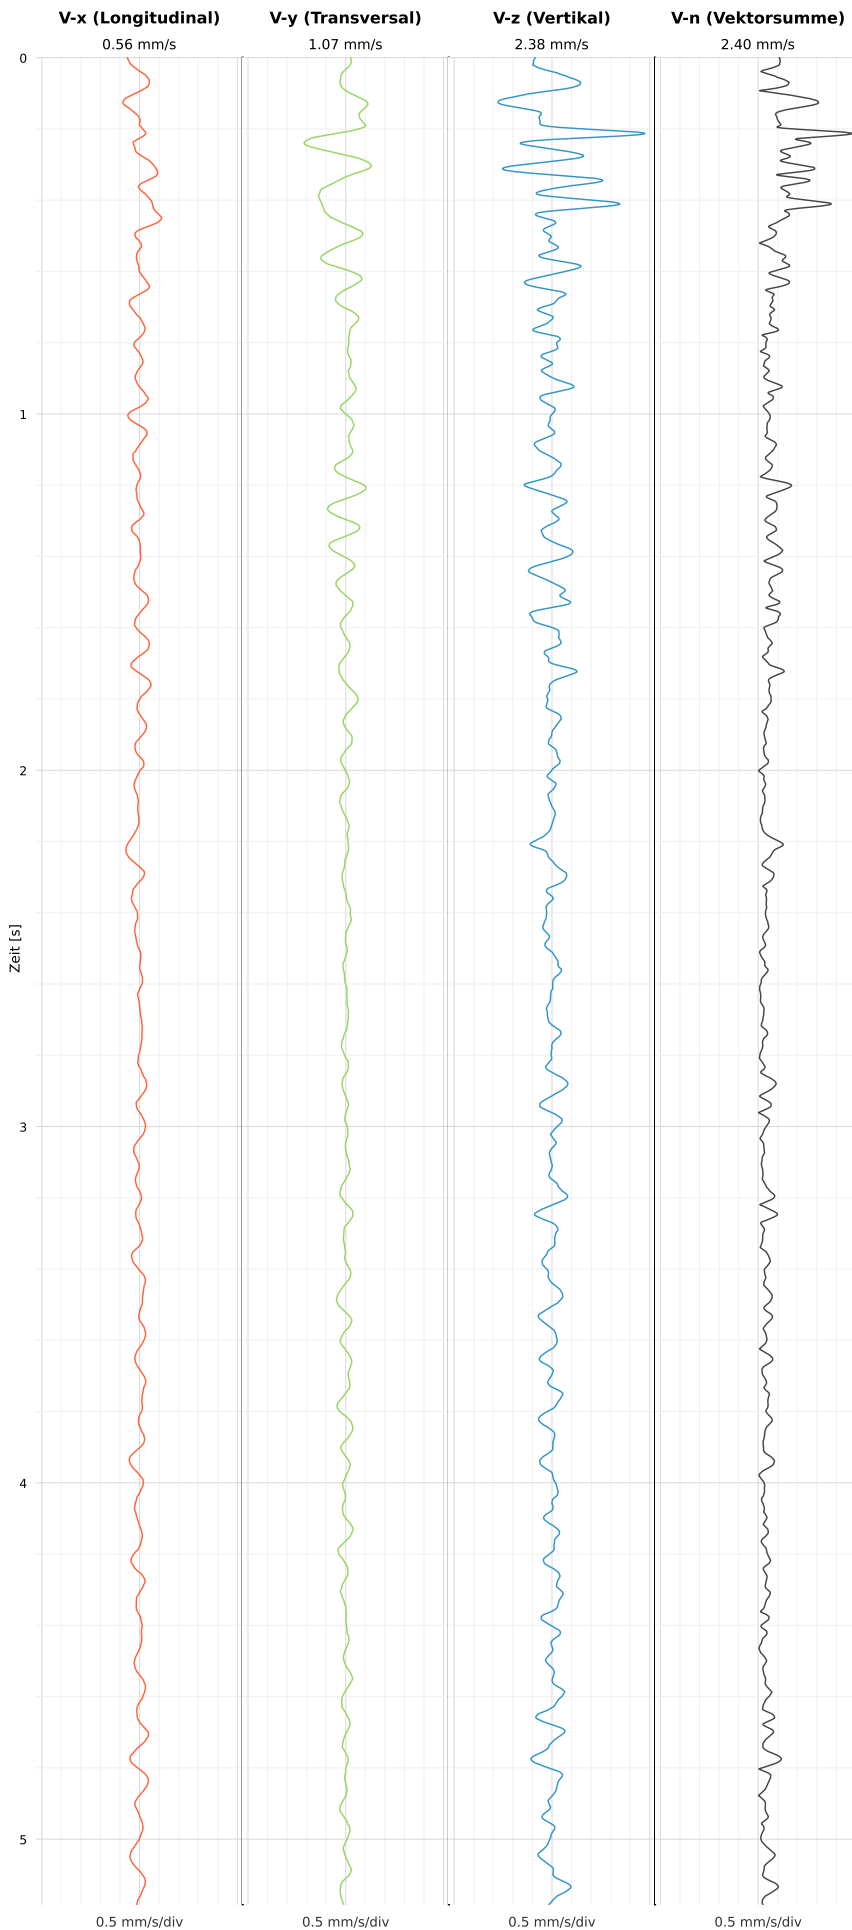


DATEI: 2492-PG-8-12052026-201218\_raw.csv

Aufzeichnungsdauer: 5.18 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	22:12:18
Event-ID	2492-PG-8-12052026-201218
Status	Ereignis
X	0.56 mm/s @ 1.2 Hz
Y	1.07 mm/s @ 9.8 Hz
Z	2.38 mm/s @ 6.8 Hz
Vn	2.40 mm/s @ 6.8 Hz

### SPEKTRALANALYSE - KOMPONENTEN FFT

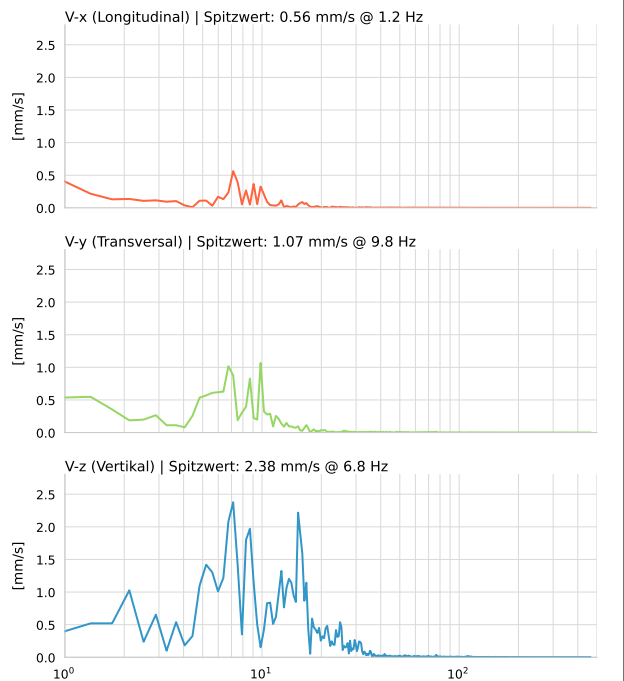

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	1.2 Hz	4.8 Hz	8.3 Hz	15.6 Hz
Y	9.8 Hz	5.2 Hz	7.1 Hz	11.0 Hz
Z	6.8 Hz	7.1 Hz	12.9 Hz	18.3 Hz

### SPEKTRALANALYSE - FFT (DIN 4150-3)

