


SCHWINGGESCHWINDIGKEIT

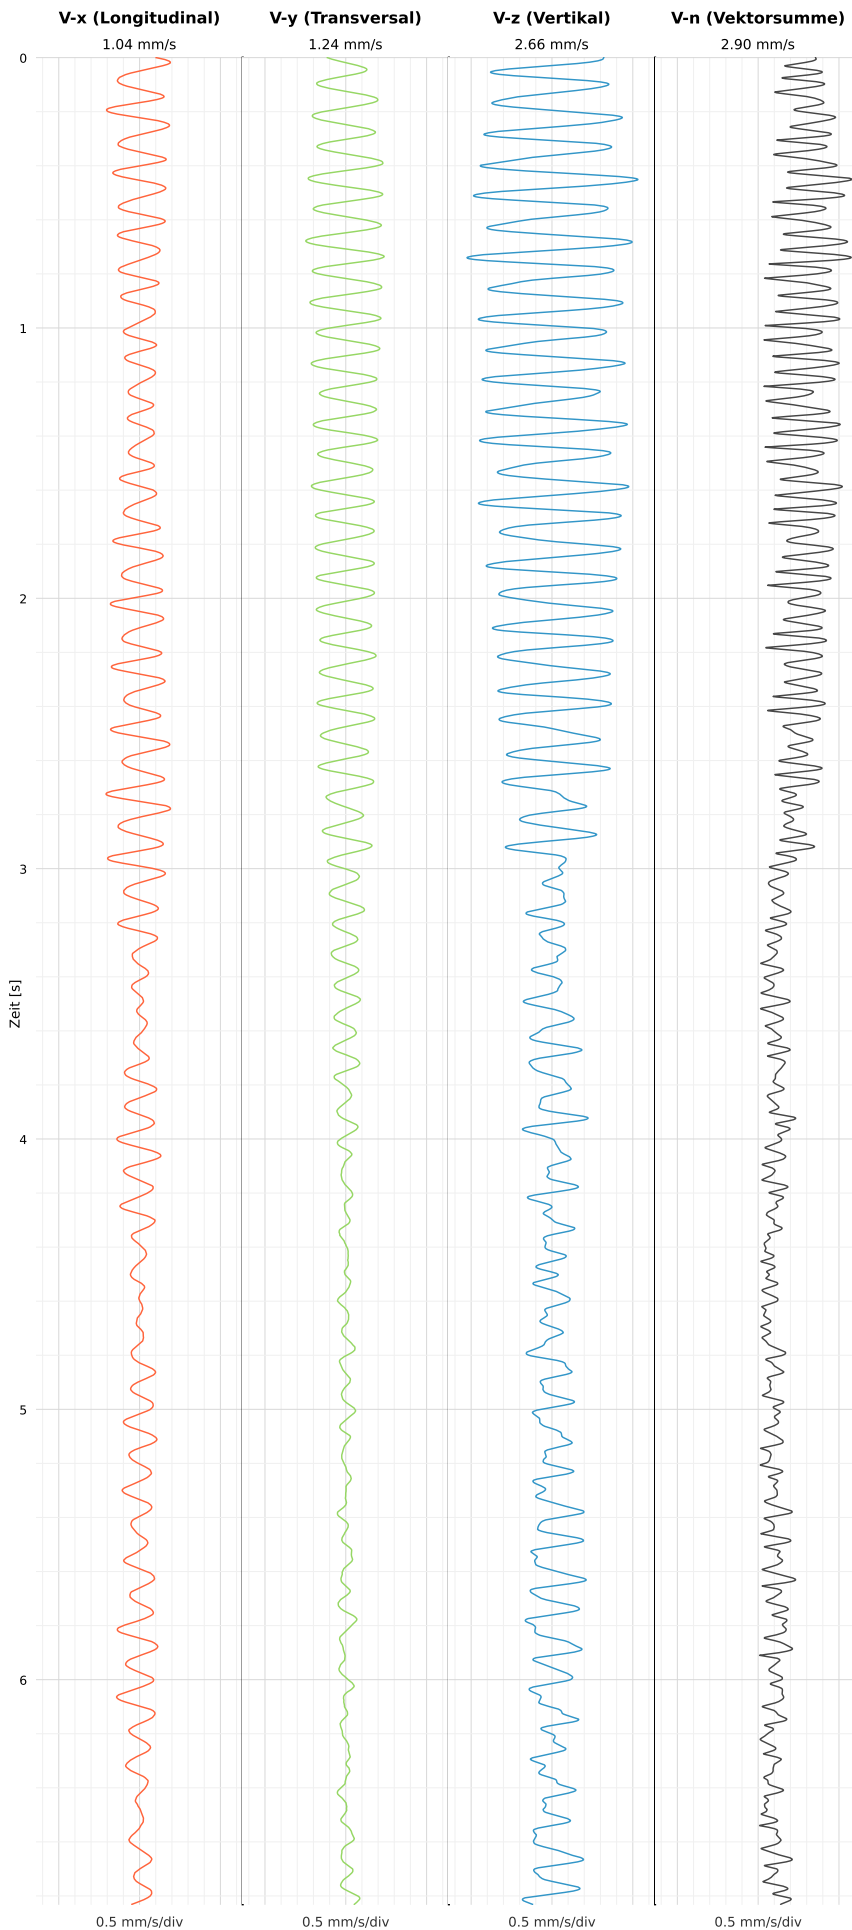


DATEI: 2492-PG-8-12052026-202419_raw.csv

Aufzeichnungsdauer: 6.83 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	22:24:19
Event-ID	2492-PG-8-12052026-202419
Status	Ereignis
X	1.04 mm/s @ 8.6 Hz
Y	1.24 mm/s @ 8.6 Hz
Z	2.66 mm/s @ 8.6 Hz
Vn	2.90 mm/s @ 8.6 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

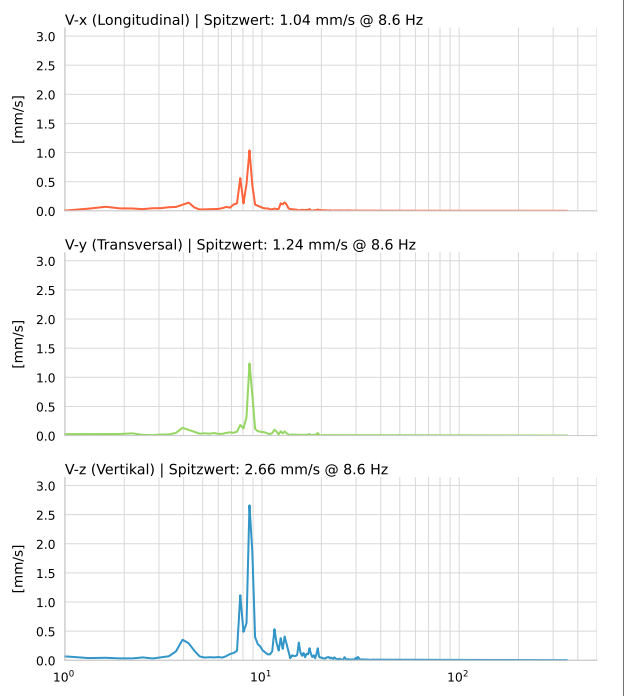

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.6 Hz	7.8 Hz	8.6 Hz	13.3 Hz
Y	8.6 Hz	8.3 Hz	8.9 Hz	15.4 Hz
Z	8.6 Hz	8.6 Hz	9.8 Hz	18.3 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

