


SCHWINGGESCHWINDIGKEIT

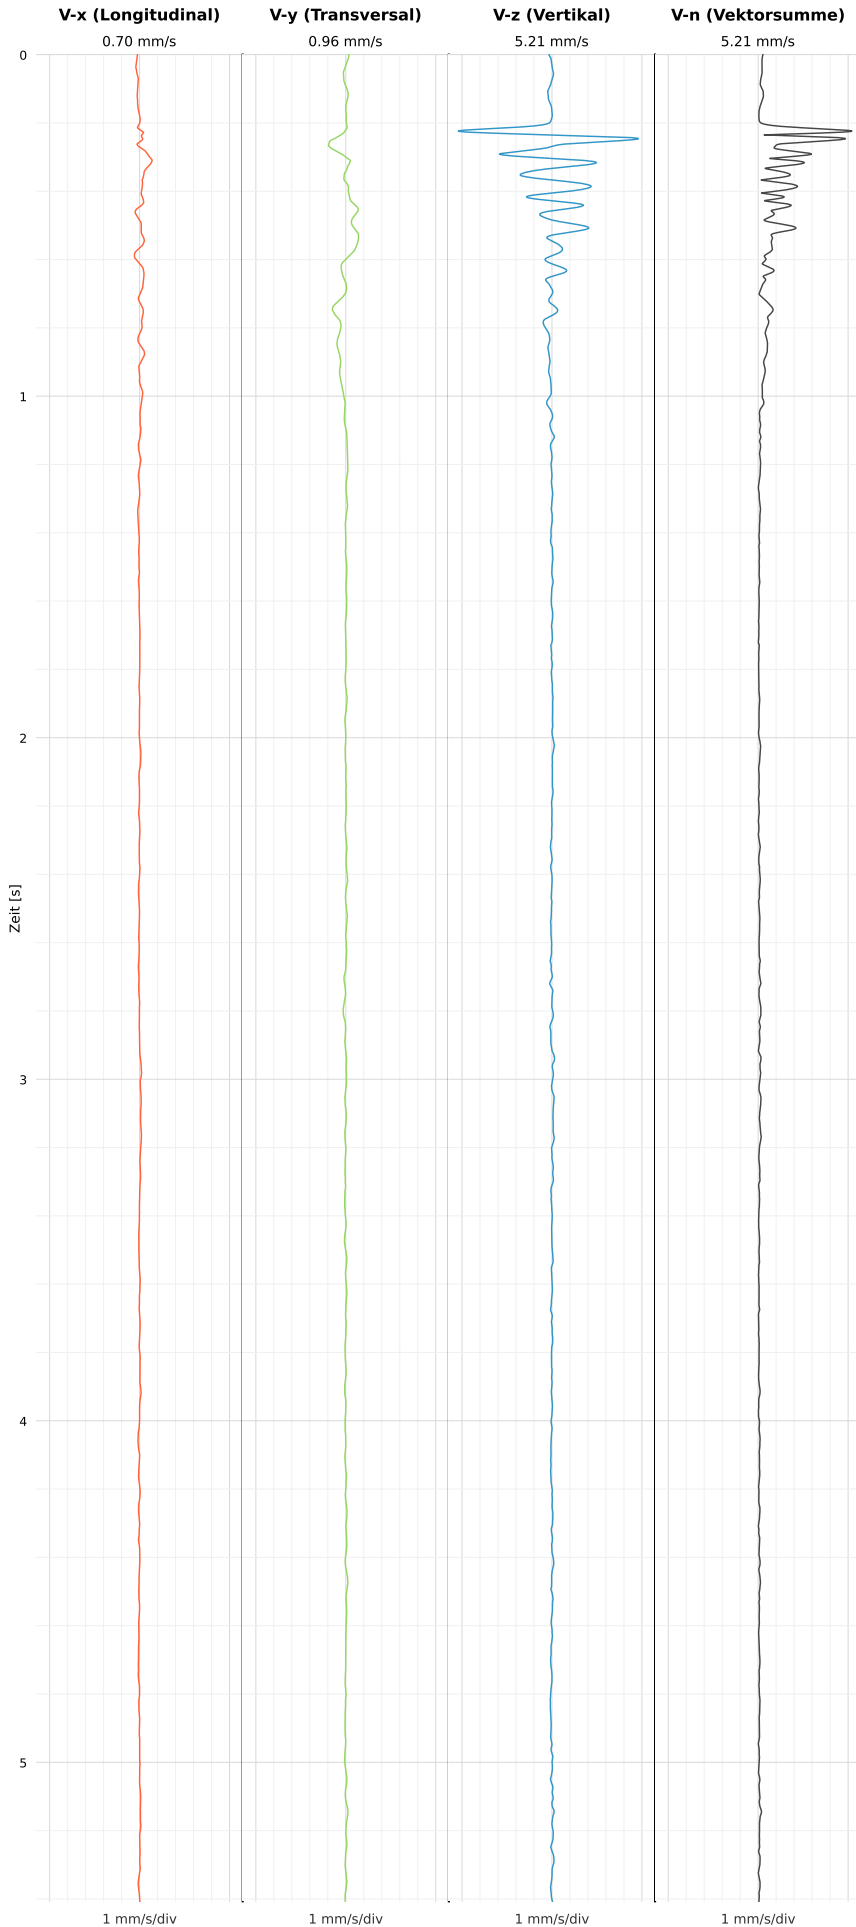


DATEI: 2492-PG-8-12052026-203531_raw.csv

Aufzeichnungsdauer: 5.41 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	22:35:31
Event-ID	2492-PG-8-12052026-203531
Status	Hinweis
X	0.70 mm/s @ 1.5 Hz
Y	0.96 mm/s @ 1.7 Hz
Z	5.21 mm/s @ 16.5 Hz
Vn	5.21 mm/s @ 16.5 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

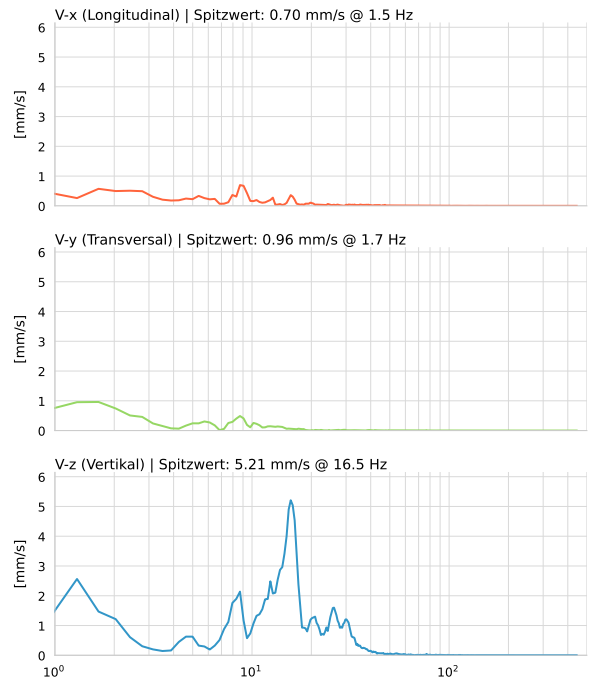

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	1.5 Hz	3.5 Hz	9.1 Hz	19.8 Hz
Y	1.7 Hz	2.0 Hz	6.5 Hz	12.4 Hz
Z	16.5 Hz	12.4 Hz	16.1 Hz	25.3 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

