


## SCHWINGGESCHWINDIGKEIT



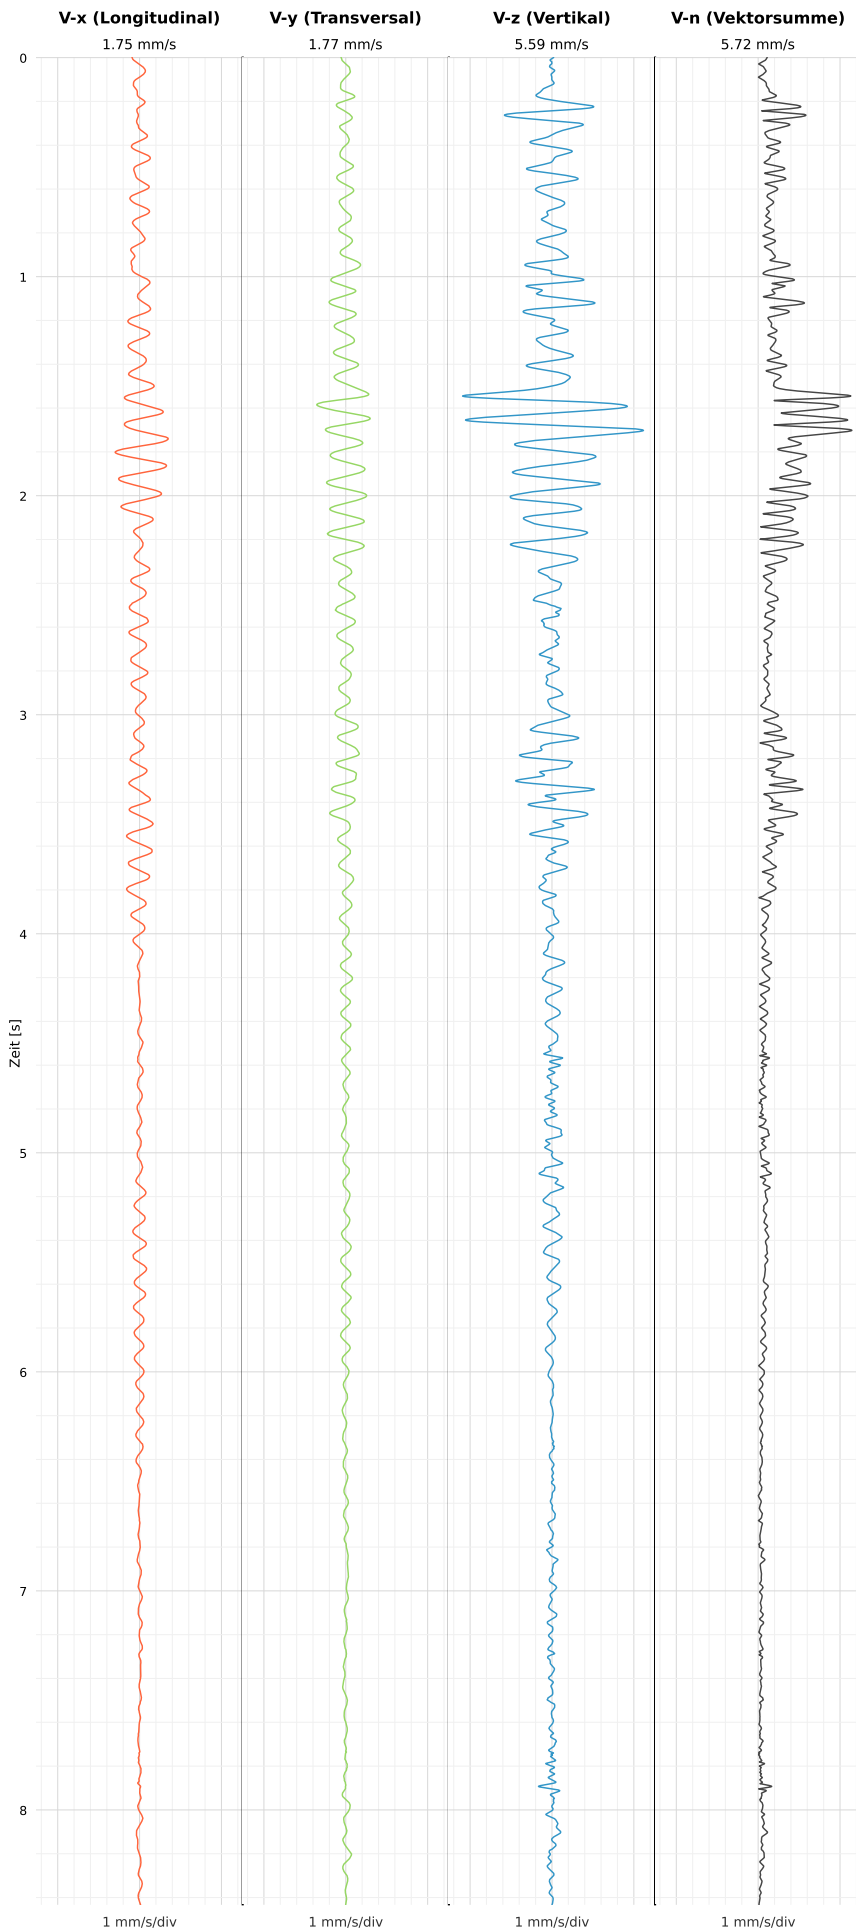


DATEI: 2492-PG-8-12052026-203932\_raw.csv

Aufzeichnungsdauer: 8.43 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	22:39:32
Event-ID	2492-PG-8-12052026-203932
Status	Kritisch
X	1.75 mm/s @ 8.4 Hz
Y	1.77 mm/s @ 8.7 Hz
Z	5.59 mm/s @ 8.4 Hz
Vn	5.72 mm/s @ 8.4 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

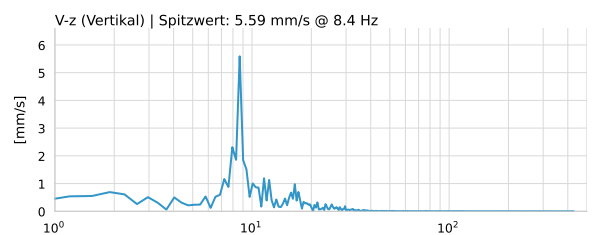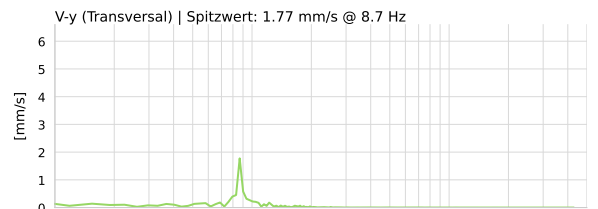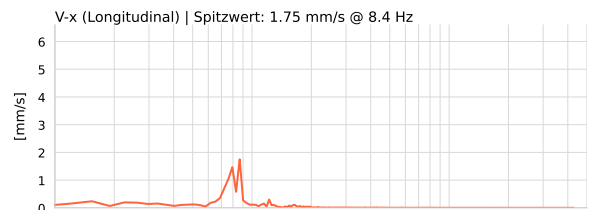

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.4 Hz	7.2 Hz	8.3 Hz	12.2 Hz
Y	8.7 Hz	7.6 Hz	8.7 Hz	11.1 Hz
Z	8.4 Hz	7.9 Hz	9.4 Hz	15.8 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

