


SCHWINGGESCHWINDIGKEIT

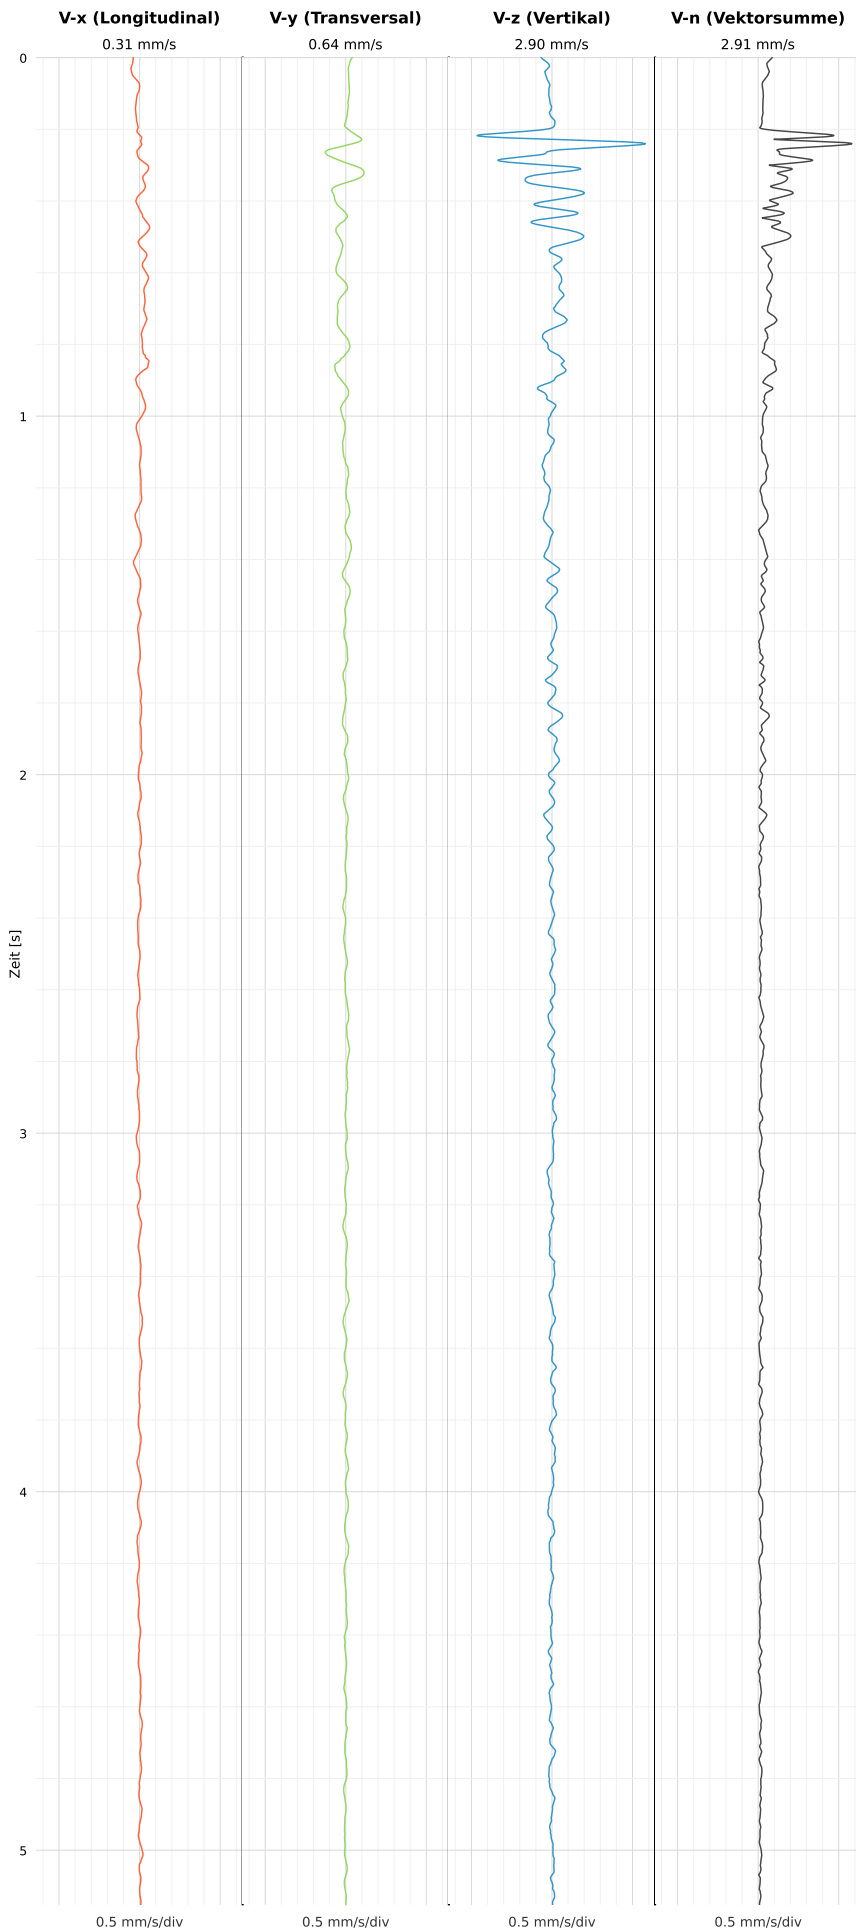


DATEI: 2492-PG-8-12052026-204013_raw.csv

Aufzeichnungsdauer: 5.15 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	22:40:13
Event-ID	2492-PG-8-12052026-204013
Status	Ereignis
X	0.31 mm/s @ 8.7 Hz
Y	0.64 mm/s @ 1.6 Hz
Z	2.90 mm/s @ 2.1 Hz
Vn	2.91 mm/s @ 2.1 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

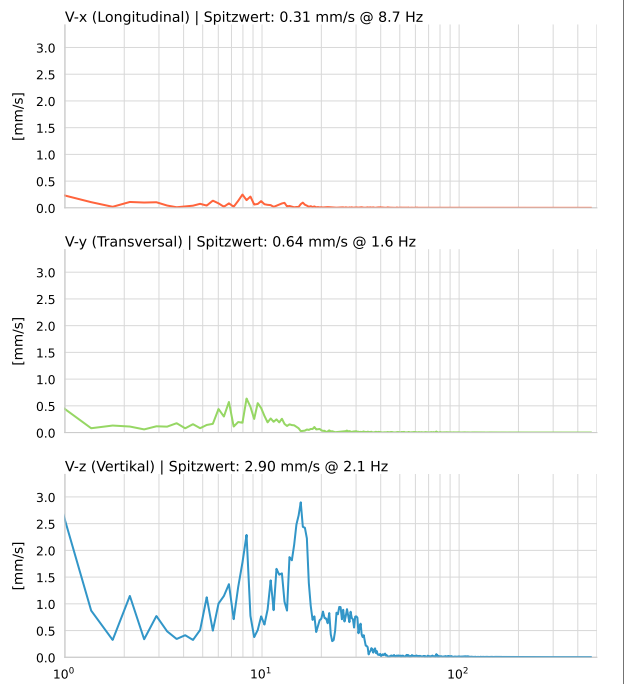

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.7 Hz	4.1 Hz	9.1 Hz	21.9 Hz
Y	1.6 Hz	6.0 Hz	9.5 Hz	14.9 Hz
Z	2.1 Hz	9.9 Hz	15.7 Hz	25.0 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

