


SCHWINGGESCHWINDIGKEIT

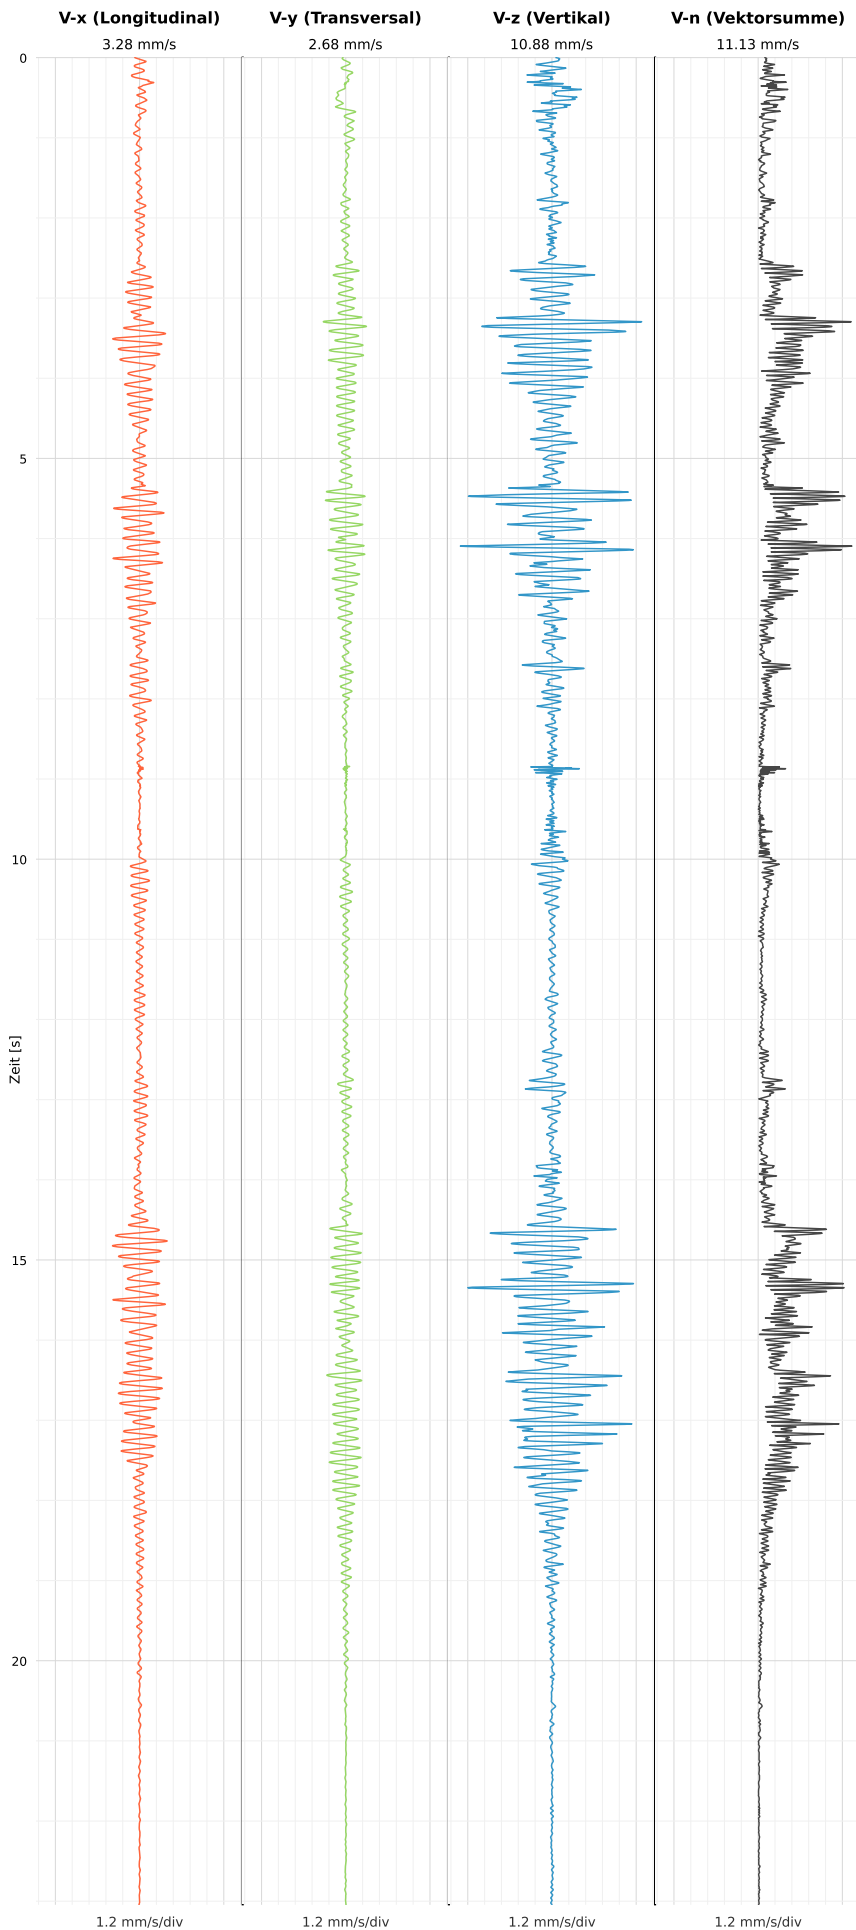


DATEI: 2492-PG-8-12052026-205455_raw.csv

Aufzeichnungsdauer: 23.04 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	22:54:55
Event-ID	2492-PG-8-12052026-205455
Status	Kritisch
X	3.28 mm/s @ 8.2 Hz
Y	2.68 mm/s @ 8.2 Hz
Z	10.88 mm/s @ 8.5 Hz
Vn	11.13 mm/s @ 8.5 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

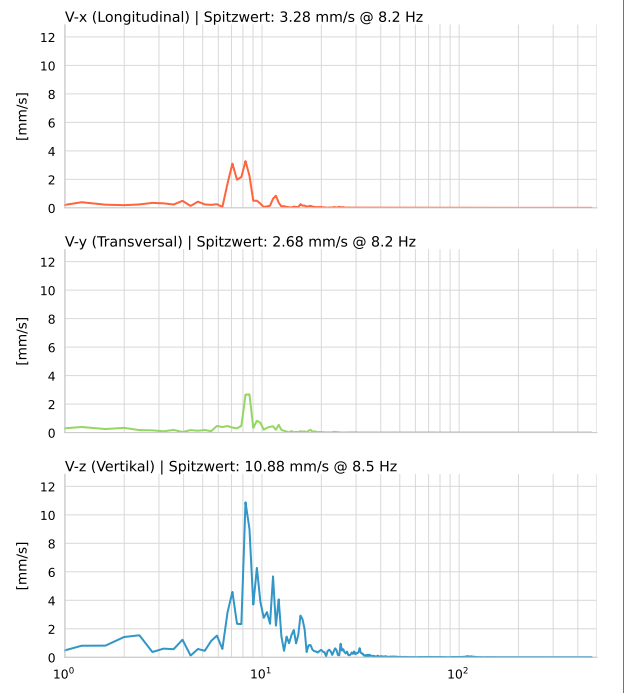

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.2 Hz	7.1 Hz	8.2 Hz	9.8 Hz
Y	8.2 Hz	7.5 Hz	8.6 Hz	11.4 Hz
Z	8.5 Hz	8.2 Hz	10.2 Hz	15.7 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

