


SCHWINGGESCHWINDIGKEIT

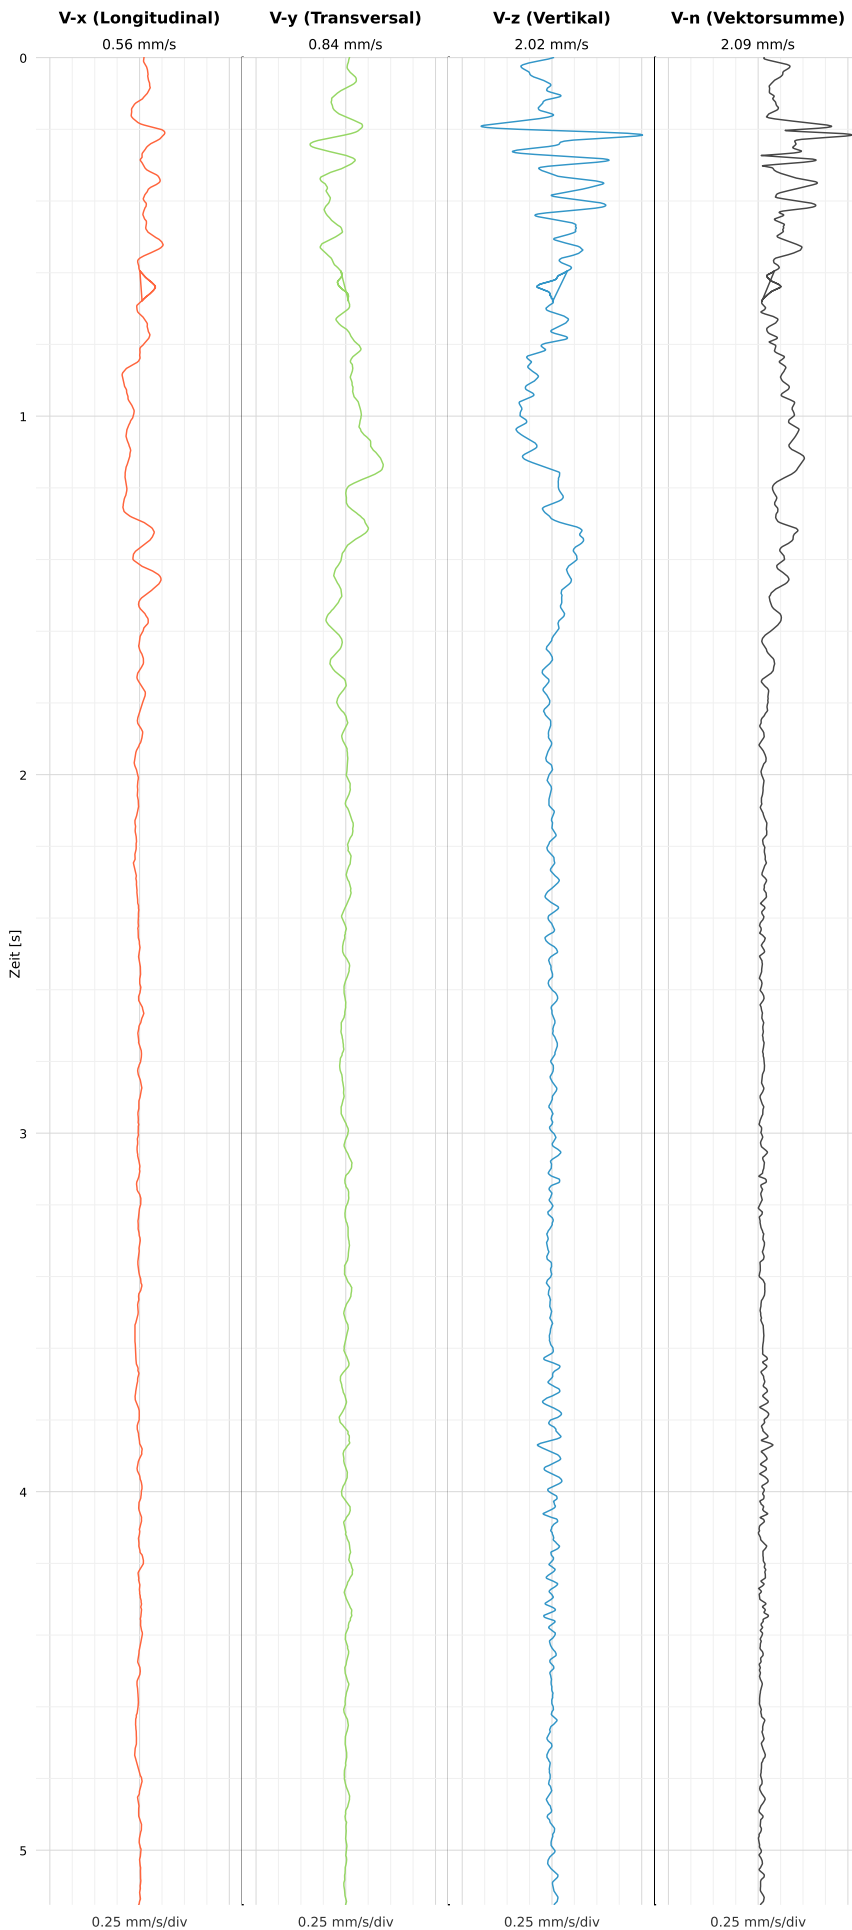


DATEI: 2492-PG-8-12052026-221506_raw.csv

Aufzeichnungsdauer: 5.15 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	00:15:06
Event-ID	2492-PG-8-12052026-221506
Status	Ereignis
X	0.56 mm/s @ 1.1 Hz
Y	0.84 mm/s @ 1.1 Hz
Z	2.02 mm/s @ 1.1 Hz
Vn	2.09 mm/s @ 1.2 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

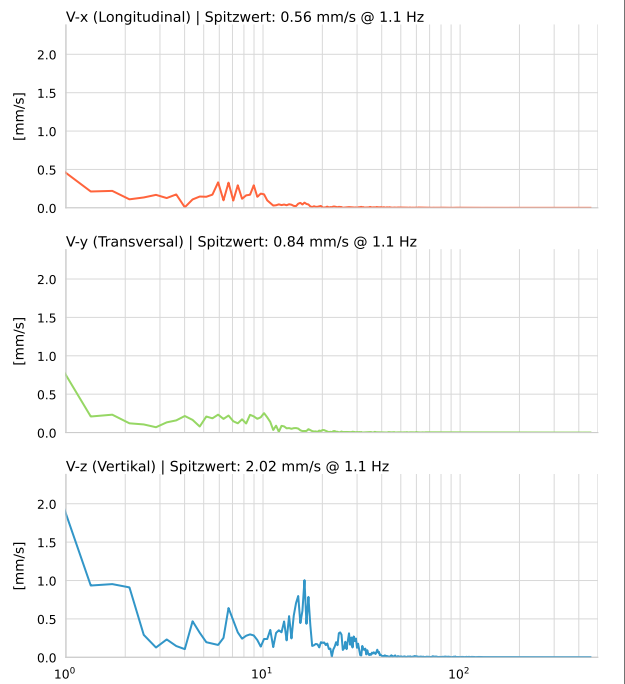

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	1.1 Hz	2.1 Hz	6.7 Hz	10.9 Hz
Y	1.1 Hz	1.7 Hz	6.7 Hz	10.9 Hz
Z	1.1 Hz	5.2 Hz	14.7 Hz	23.9 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

