


## SCHWINGGESCHWINDIGKEIT

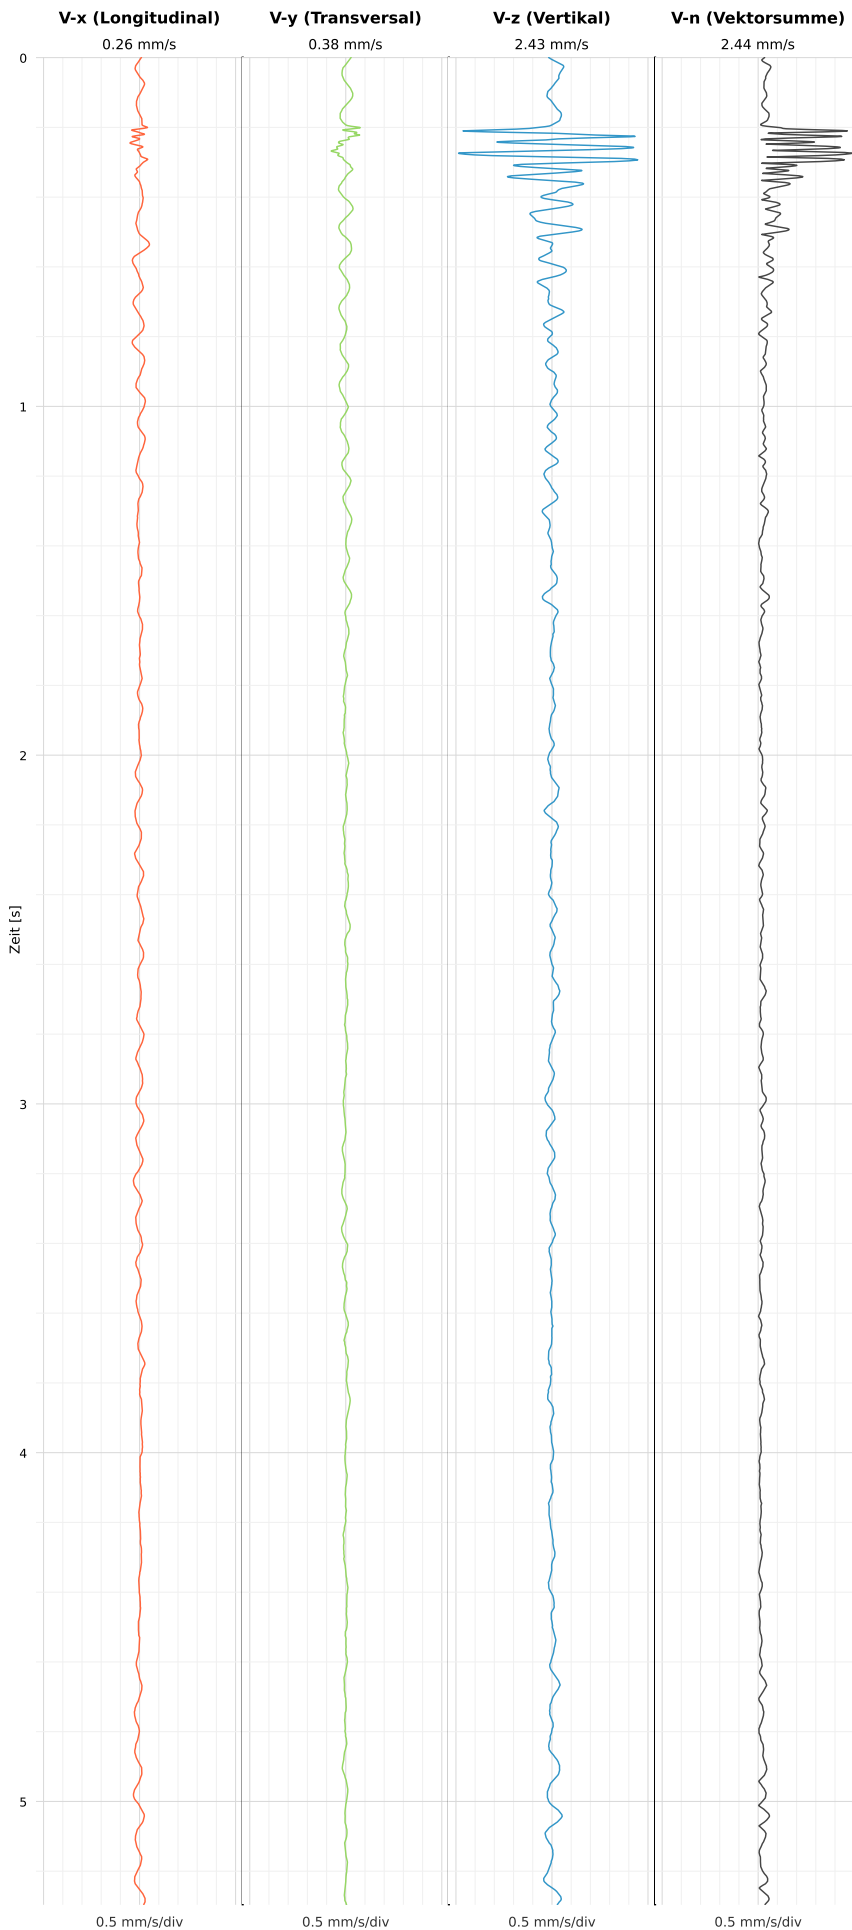


DATEI: 2492-PG-8-12052026-224219\_raw.csv

Aufzeichnungsdauer: 5.30 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	00:42:19
Event-ID	2492-PG-8-12052026-224219
Status	Ereignis
X	0.26 mm/s @ 8.7 Hz
Y	0.38 mm/s @ 8.7 Hz
Z	2.43 mm/s @ 8.5 Hz
Vn	2.44 mm/s @ 8.5 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

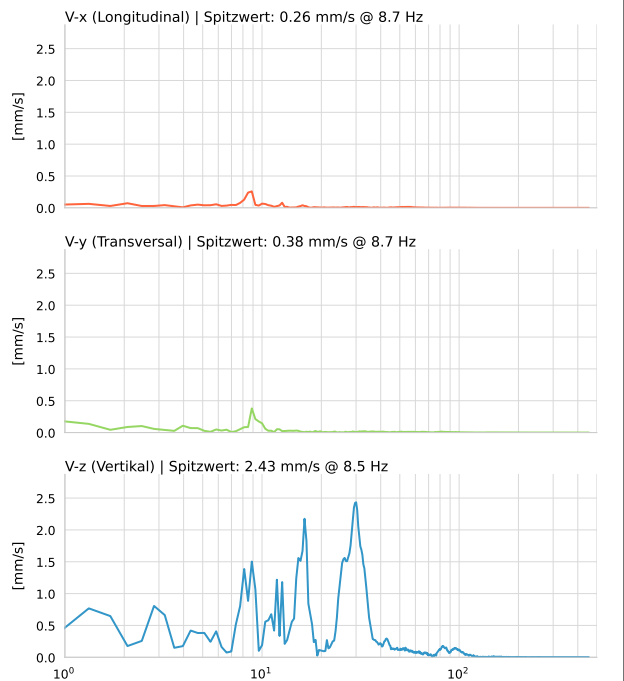

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.7 Hz	7.7 Hz	11.5 Hz	48.9 Hz
Y	8.7 Hz	8.1 Hz	14.2 Hz	59.9 Hz
Z	8.5 Hz	16.4 Hz	28.9 Hz	34.9 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

