


SCHWINGGESCHWINDIGKEIT

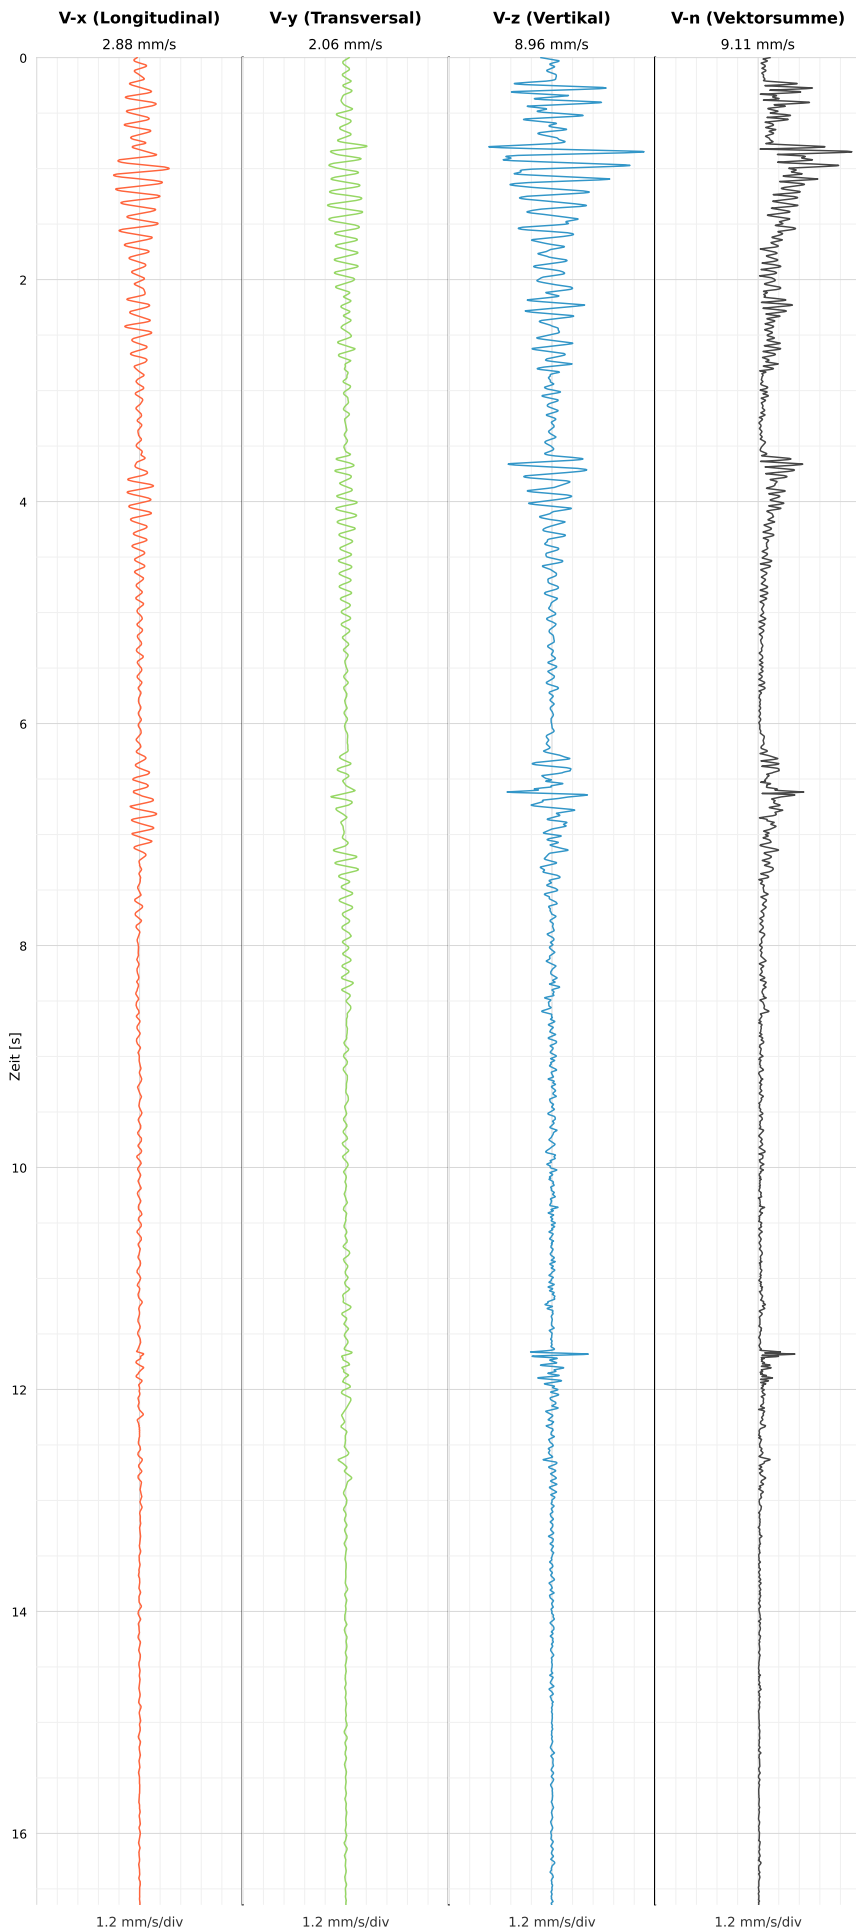


DATEI: 2492-PG-8-12052026-235135_raw.csv

Aufzeichnungsdauer: 16.64 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	01:51:35
Event-ID	2492-PG-8-12052026-235135
Status	Kritisch
X	2.88 mm/s @ 8.1 Hz
Y	2.06 mm/s @ 8.5 Hz
Z	8.96 mm/s @ 8.5 Hz
Vn	9.11 mm/s @ 8.5 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

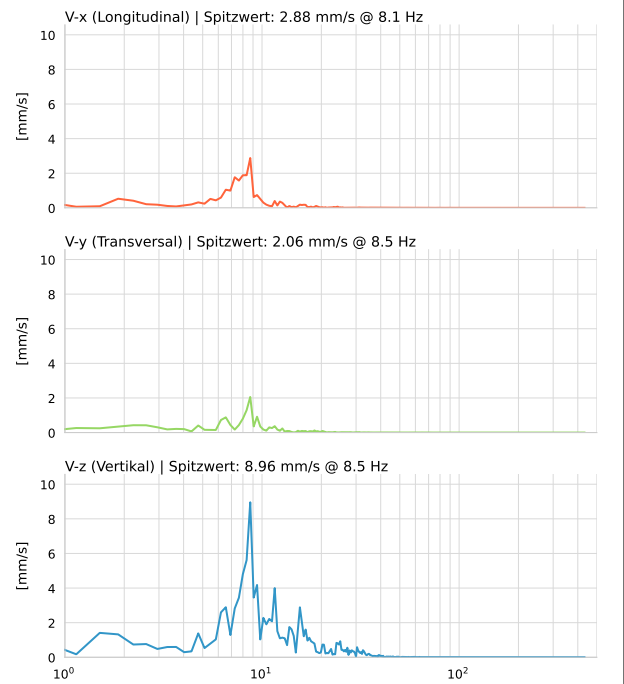

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.1 Hz	6.6 Hz	8.0 Hz	9.4 Hz
Y	8.5 Hz	6.2 Hz	8.4 Hz	10.9 Hz
Z	8.5 Hz	8.0 Hz	10.5 Hz	16.6 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

