


SCHWINGGESCHWINDIGKEIT

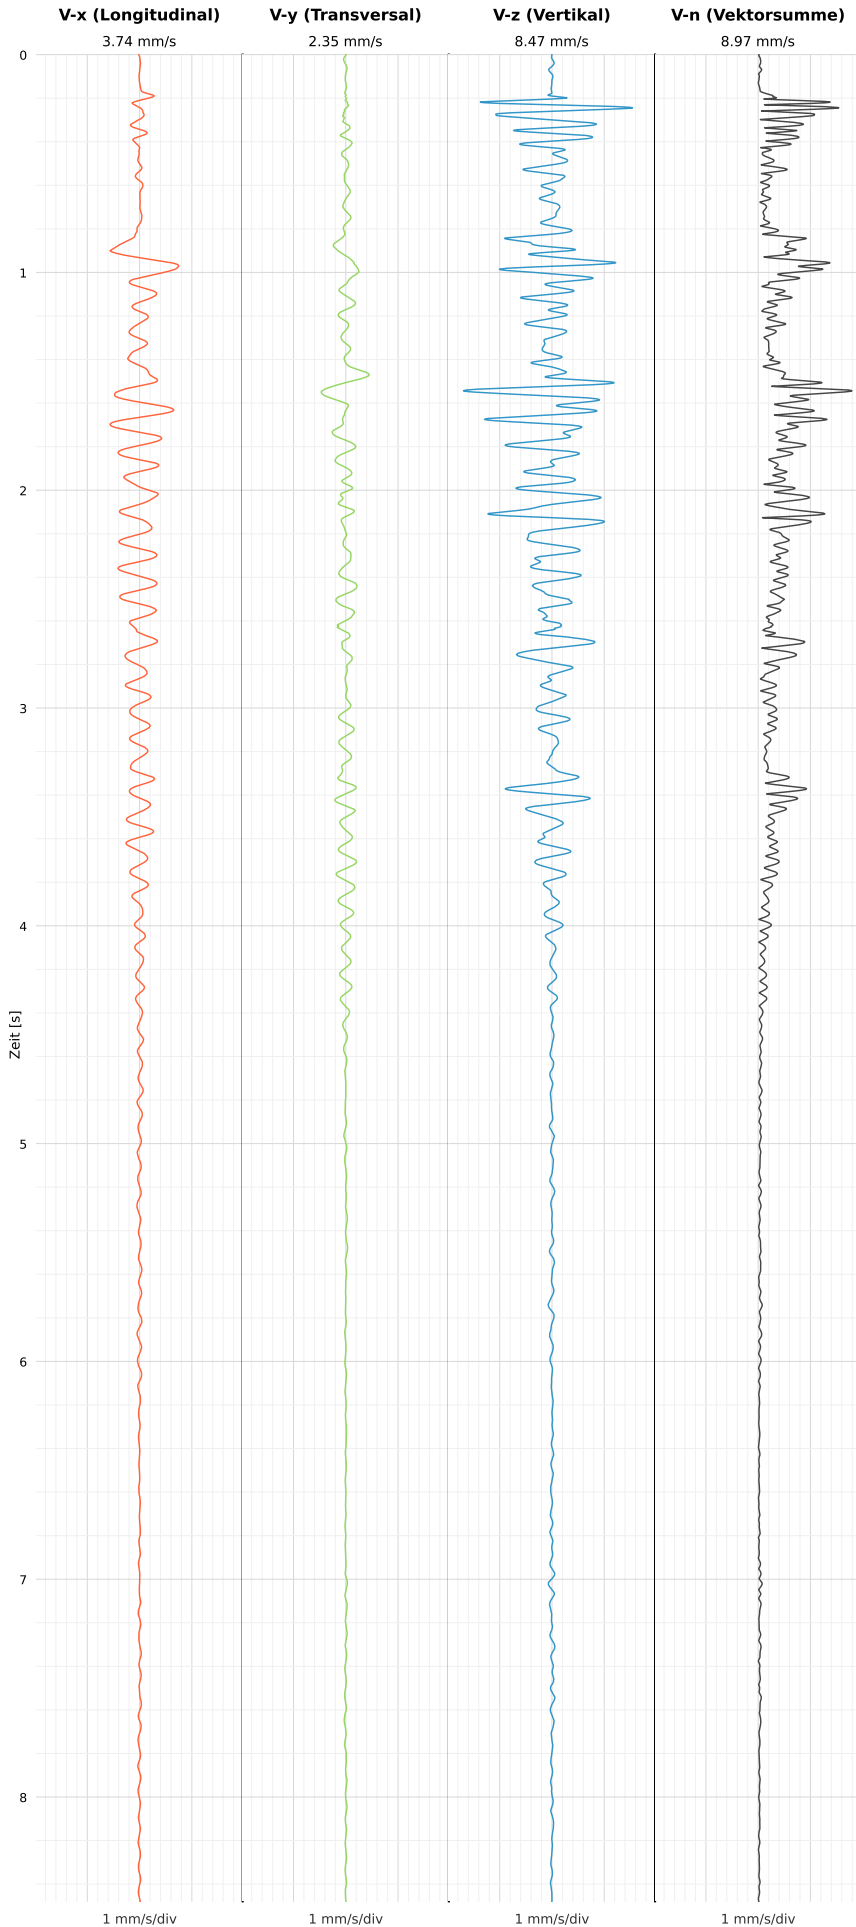


DATEI: 2492-PG-8-13052026-075350_raw.csv

Aufzeichnungsdauer: 8.48 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	09:53:50
Event-ID	2492-PG-8-13052026-075350
Status	Kritisch
X	3.74 mm/s @ 7.7 Hz
Y	2.35 mm/s @ 8.6 Hz
Z	8.47 mm/s @ 8.8 Hz
Vn	8.97 mm/s @ 8.8 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

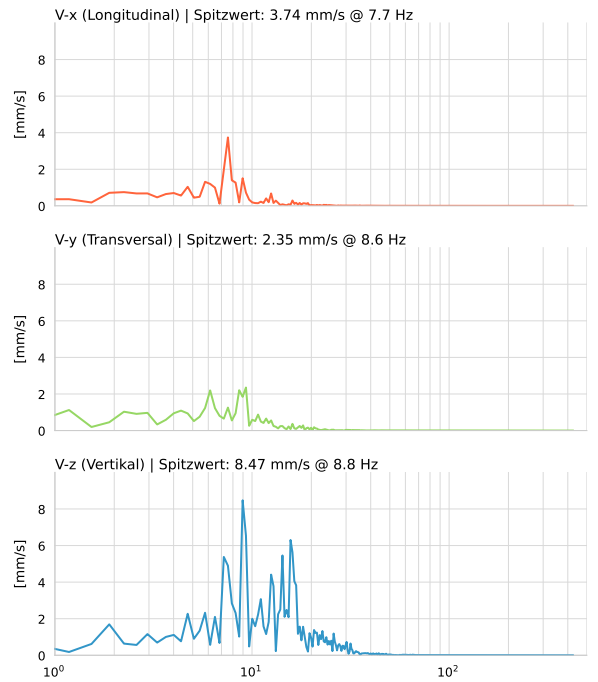

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	7.7 Hz	4.7 Hz	7.5 Hz	9.0 Hz
Y	8.6 Hz	4.7 Hz	7.9 Hz	10.7 Hz
Z	8.8 Hz	9.0 Hz	13.6 Hz	17.5 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

