


SCHWINGGESCHWINDIGKEIT

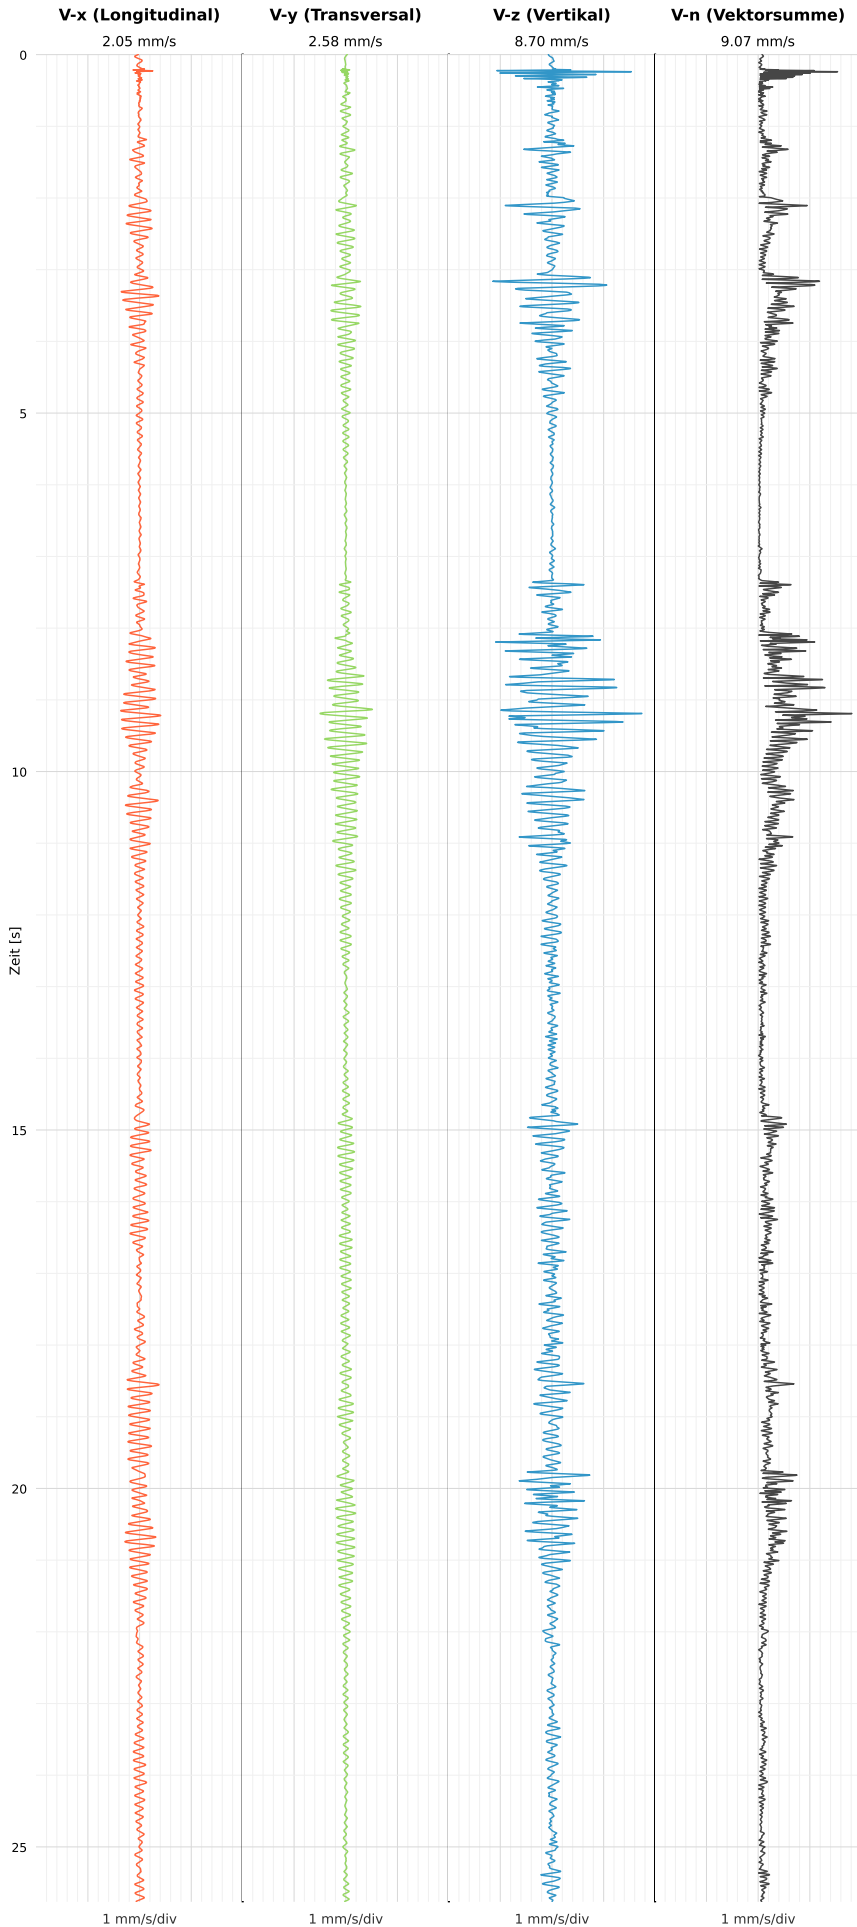


DATEI: 2492-PG-8-13052026-075403_raw.csv

Aufzeichnungsdauer: 25.76 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	09:54:03
Event-ID	2492-PG-8-13052026-075403
Status	Kritisch
X	2.05 mm/s @ 8.2 Hz
Y	2.58 mm/s @ 8.6 Hz
Z	8.70 mm/s @ 8.5 Hz
Vn	9.07 mm/s @ 8.5 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

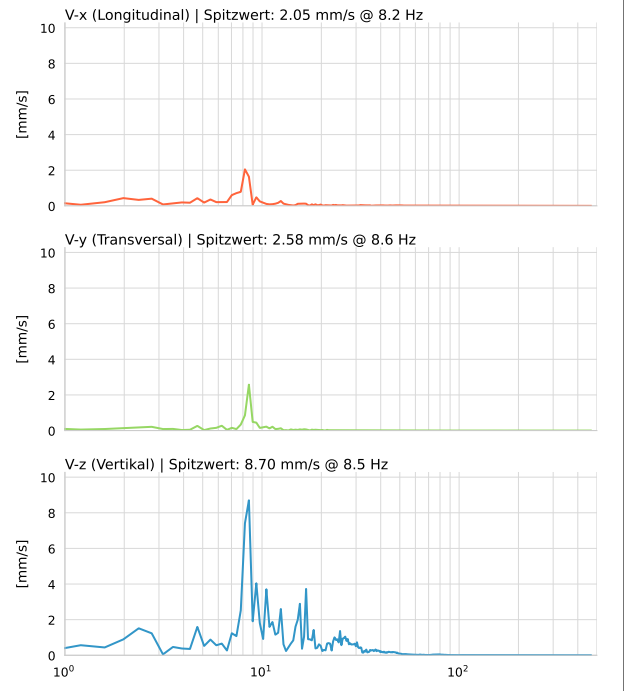

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.2 Hz	7.0 Hz	8.2 Hz	15.6 Hz
Y	8.6 Hz	8.2 Hz	8.6 Hz	12.5 Hz
Z	8.5 Hz	8.6 Hz	14.4 Hz	25.3 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

