


## SCHWINGGESCHWINDIGKEIT



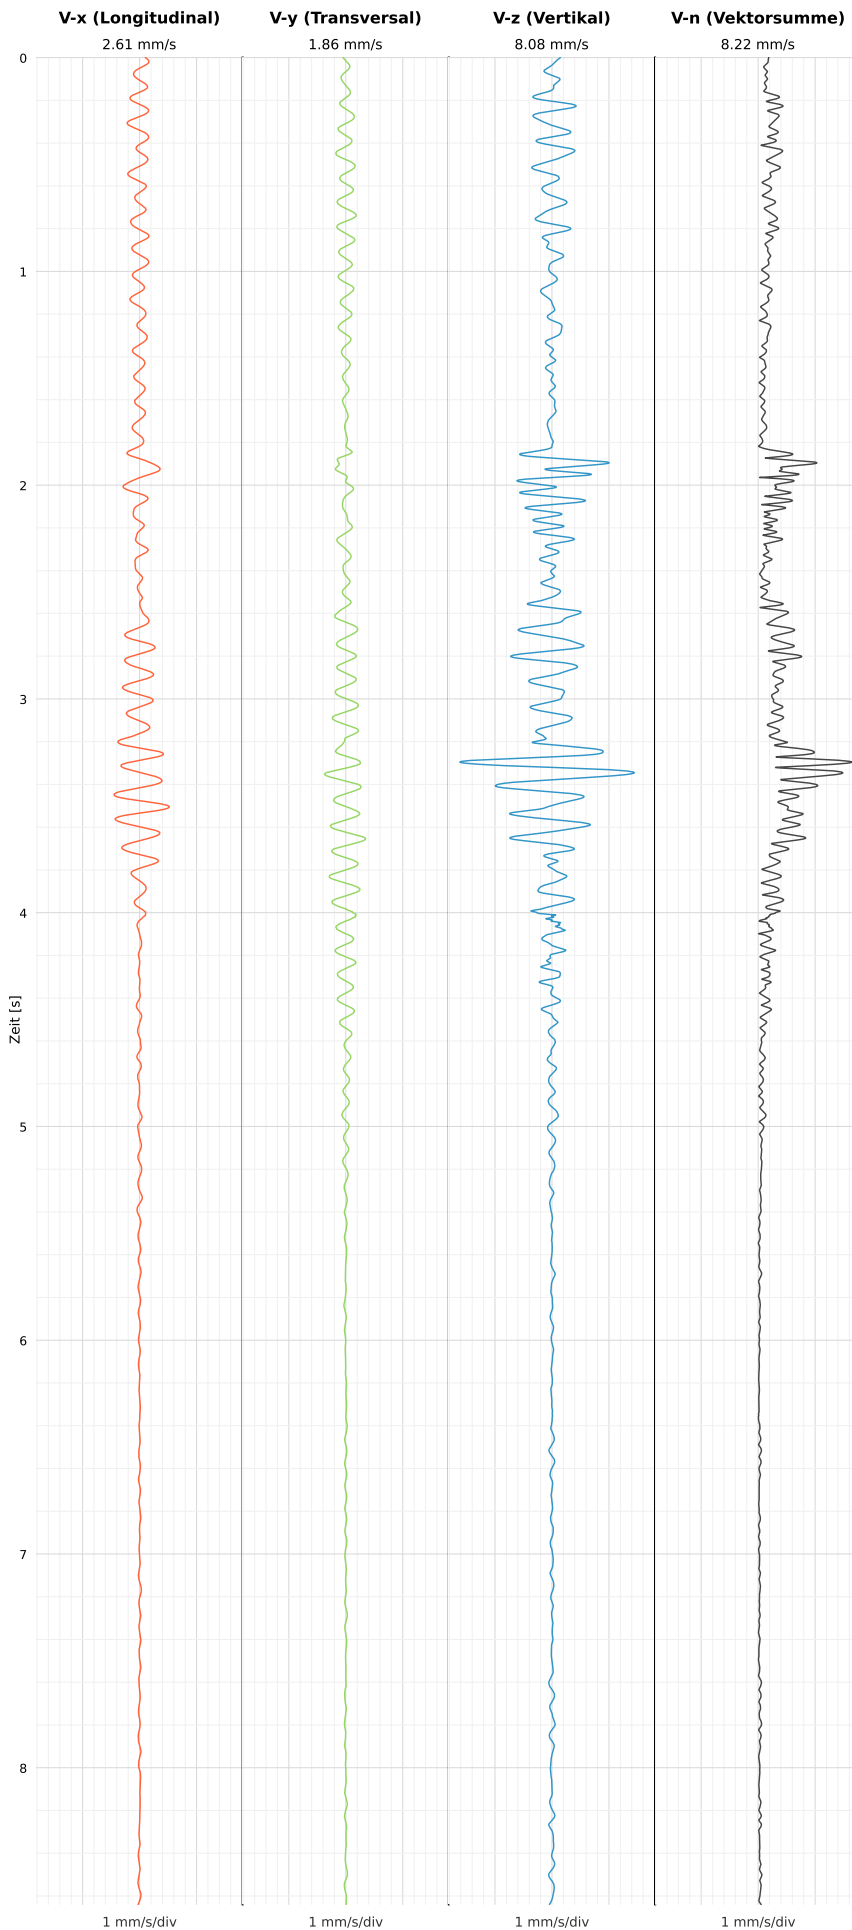


DATEI: 2492-PG-8-13052026-075429\_raw.csv

Aufzeichnungsdauer: 8.64 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	09:54:29
Event-ID	2492-PG-8-13052026-075429
Status	Kritisch
X	2.61 mm/s @ 8.2 Hz
Y	1.86 mm/s @ 8.2 Hz
Z	8.08 mm/s @ 8.3 Hz
Vn	8.22 mm/s @ 8.3 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

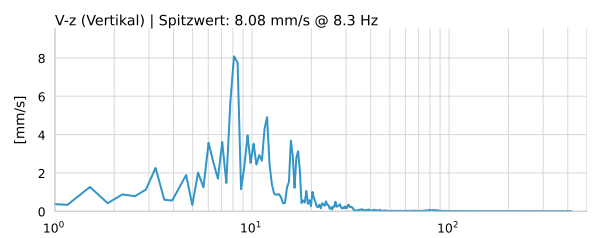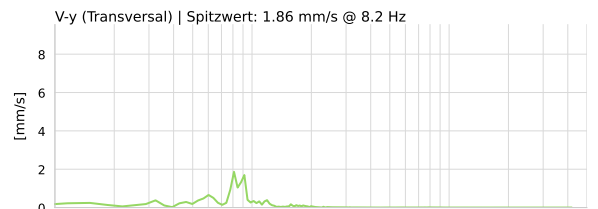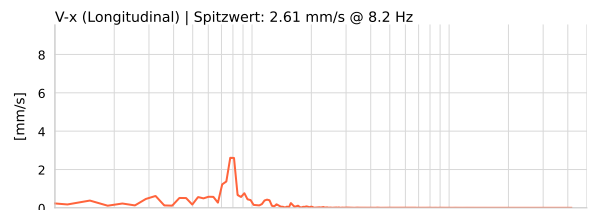

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.2 Hz	6.4 Hz	8.1 Hz	11.6 Hz
Y	8.2 Hz	6.4 Hz	8.8 Hz	11.2 Hz
Z	8.3 Hz	7.8 Hz	10.9 Hz	16.4 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

