


SCHWINGGESCHWINDIGKEIT

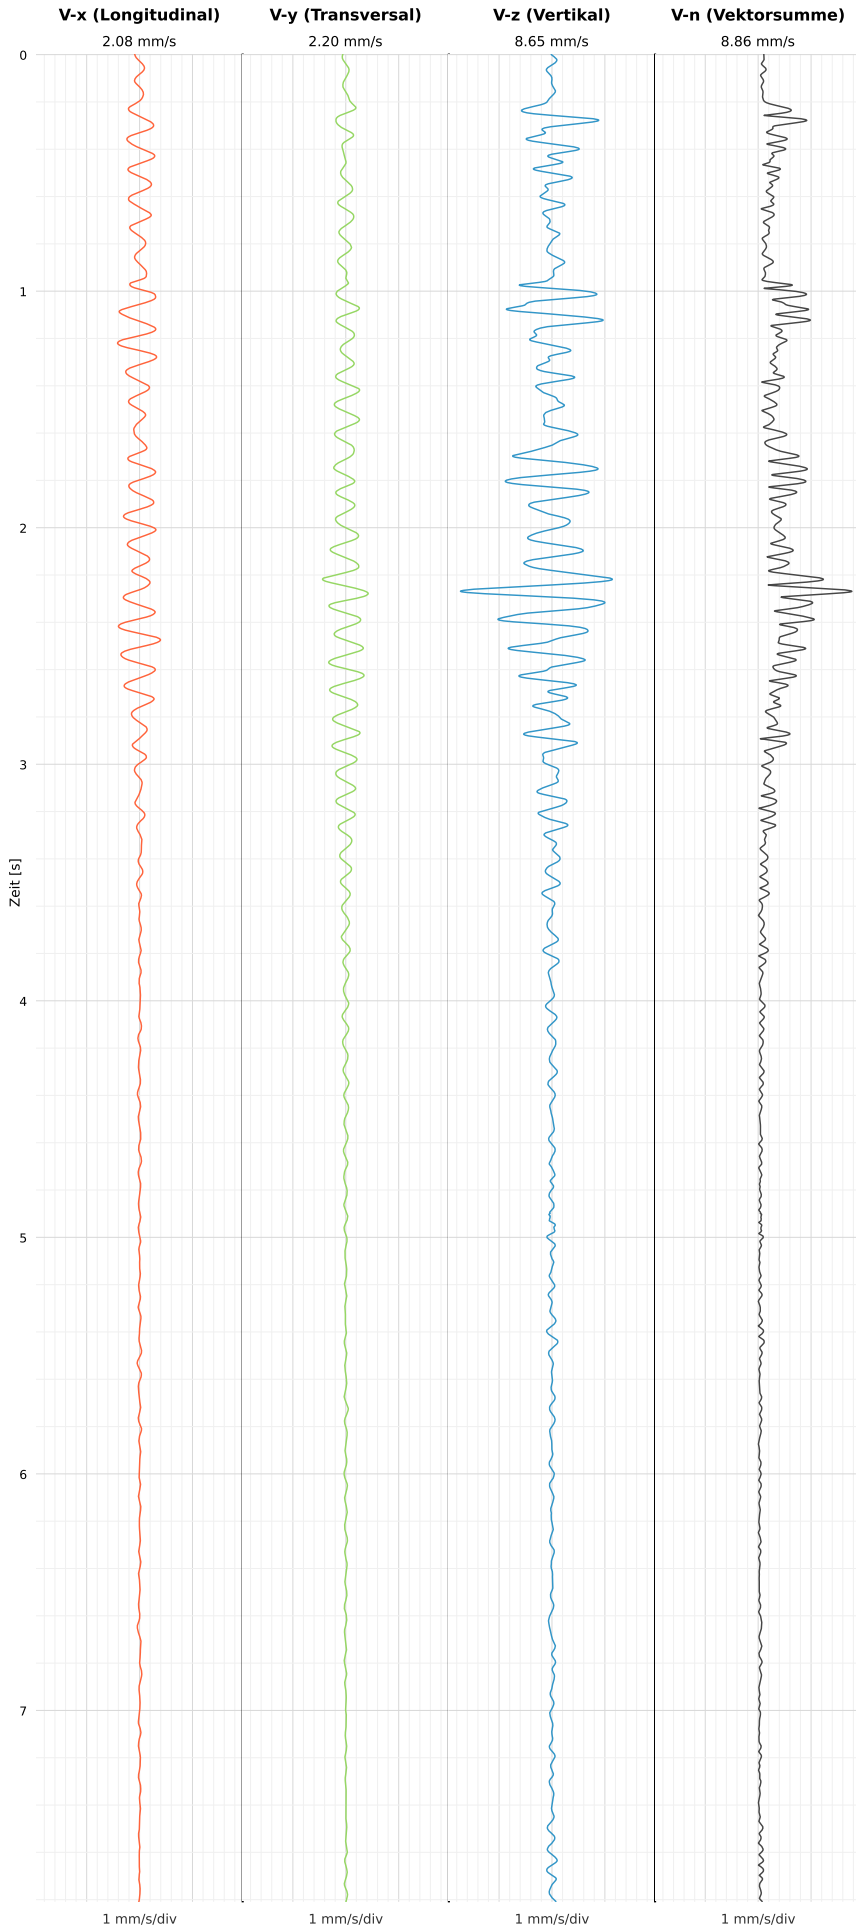


DATEI: 2492-PG-8-13052026-075505_raw.csv

Aufzeichnungsdauer: 7.81 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	09:55:05
Event-ID	2492-PG-8-13052026-075505
Status	Kritisch
X	2.08 mm/s @ 8.3 Hz
Y	2.20 mm/s @ 8.4 Hz
Z	8.65 mm/s @ 8.4 Hz
Vn	8.86 mm/s @ 8.4 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

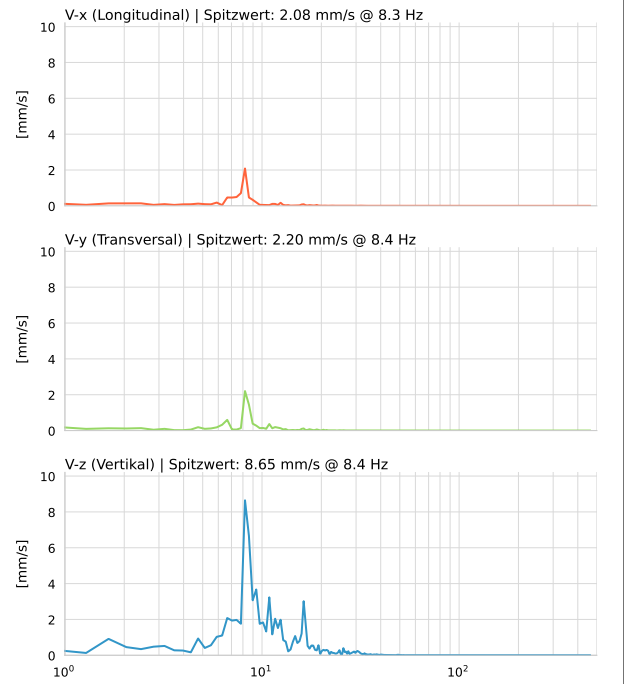

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.3 Hz	7.0 Hz	8.2 Hz	9.3 Hz
Y	8.4 Hz	7.4 Hz	8.6 Hz	10.9 Hz
Z	8.4 Hz	8.2 Hz	9.7 Hz	15.1 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

