


SCHWINGGESCHWINDIGKEIT

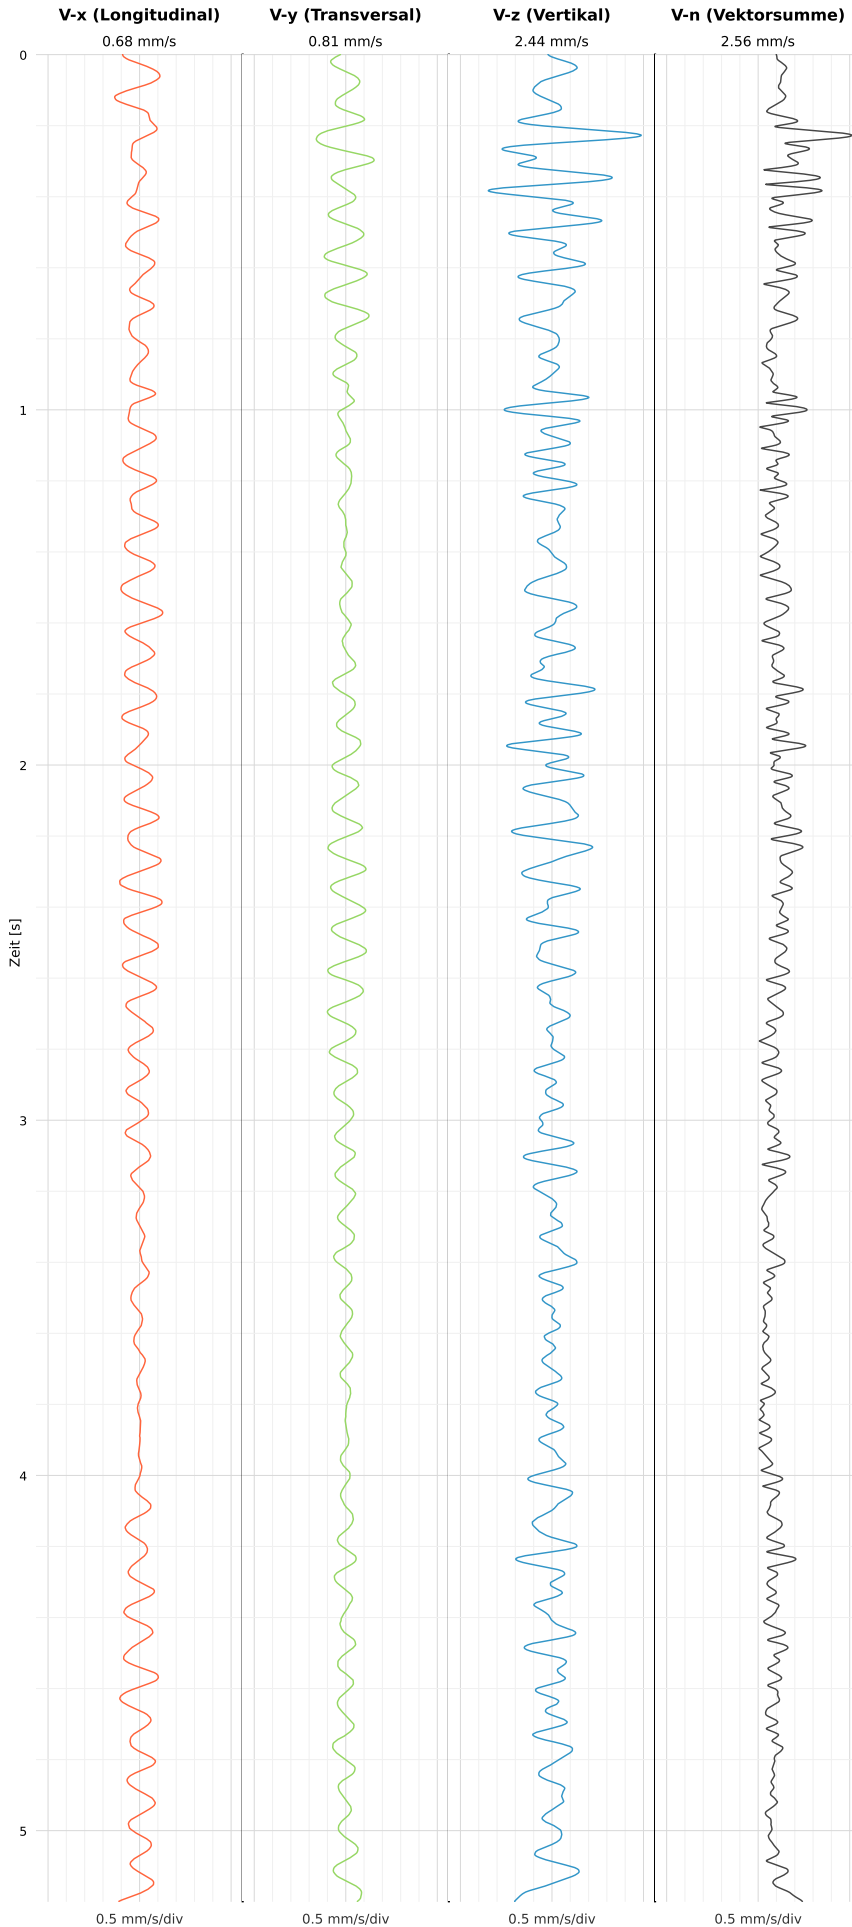


DATEI: 2492-PG-8-13052026-075554_raw.csv

Aufzeichnungsdauer: 5.20 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	09:55:54
Event-ID	2492-PG-8-13052026-075554
Status	Ereignis
X	0.68 mm/s @ 8.5 Hz
Y	0.81 mm/s @ 8.7 Hz
Z	2.44 mm/s @ 8.7 Hz
Vn	2.56 mm/s @ 8.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

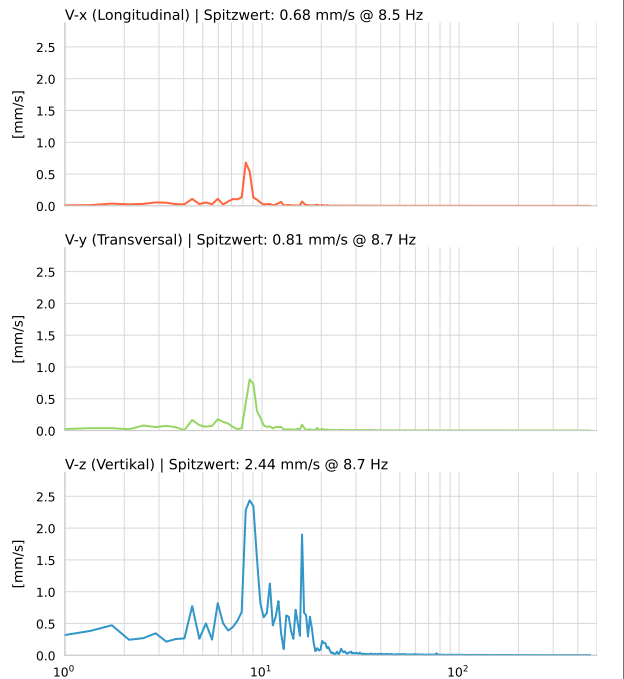

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.5 Hz	7.5 Hz	8.3 Hz	9.4 Hz
Y	8.7 Hz	8.3 Hz	9.0 Hz	16.3 Hz
Z	8.7 Hz	8.3 Hz	11.0 Hz	16.7 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

