


SCHWINGGESCHWINDIGKEIT

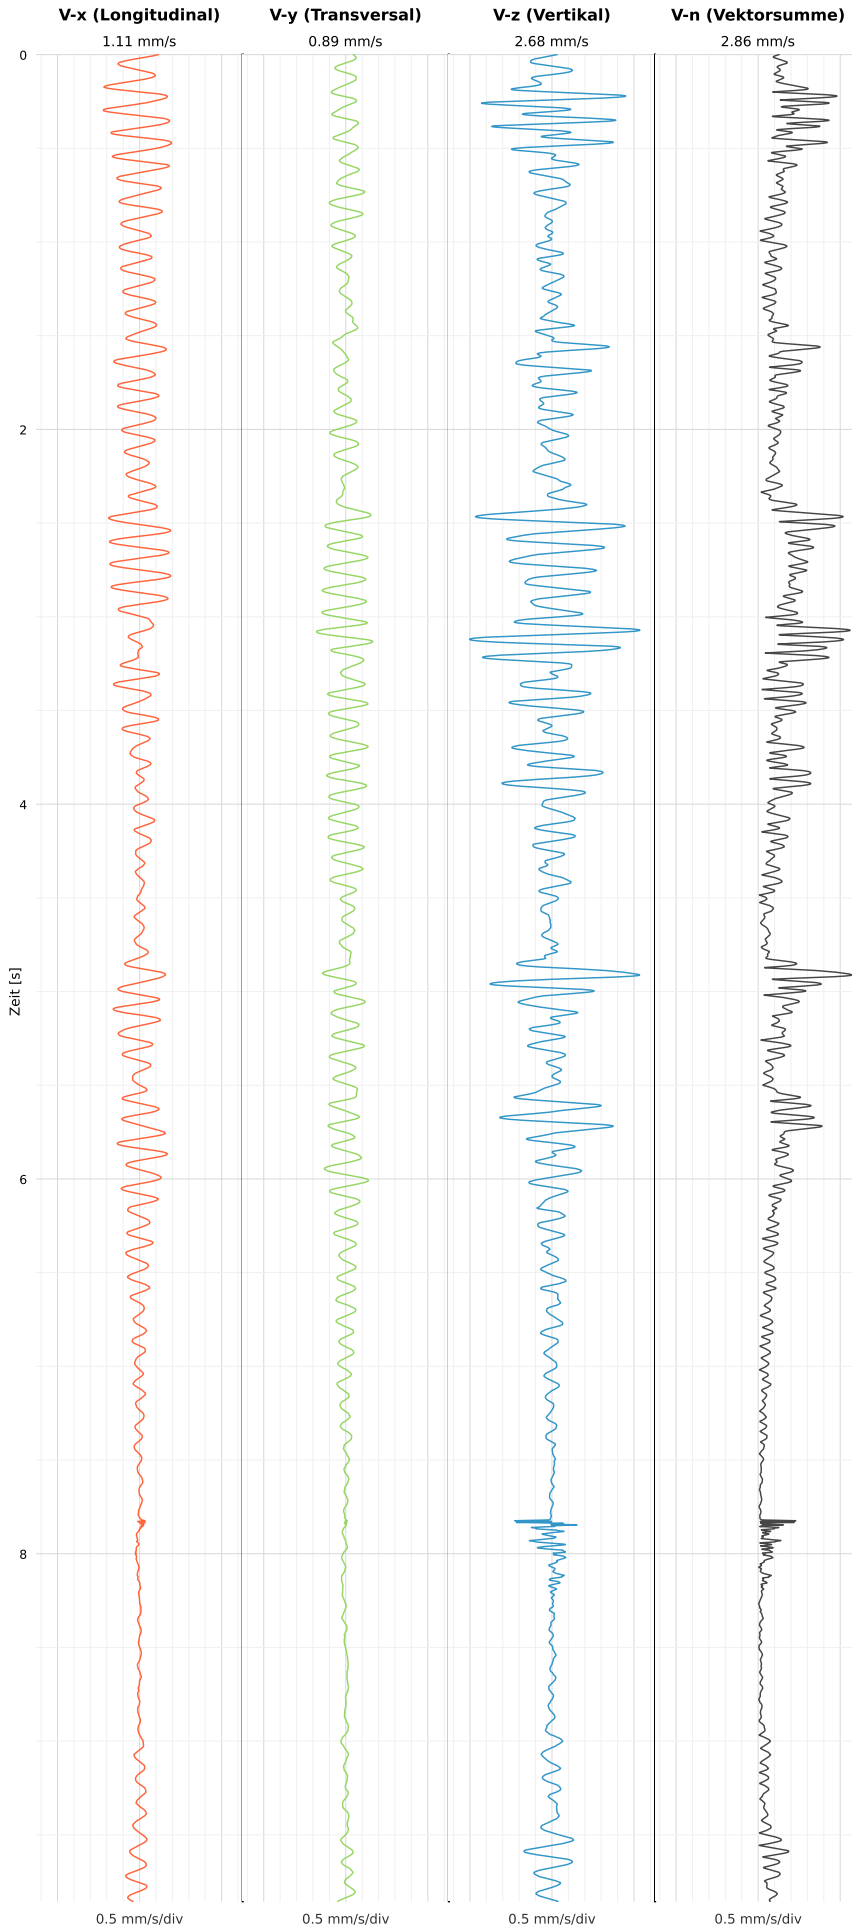


DATEI: 2492-PG-8-13052026-075620_raw.csv

Aufzeichnungsdauer: 9.86 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	09:56:20
Event-ID	2492-PG-8-13052026-075620
Status	Ereignis
X	1.11 mm/s @ 8.4 Hz
Y	0.89 mm/s @ 8.7 Hz
Z	2.68 mm/s @ 8.4 Hz
Vn	2.86 mm/s @ 8.4 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

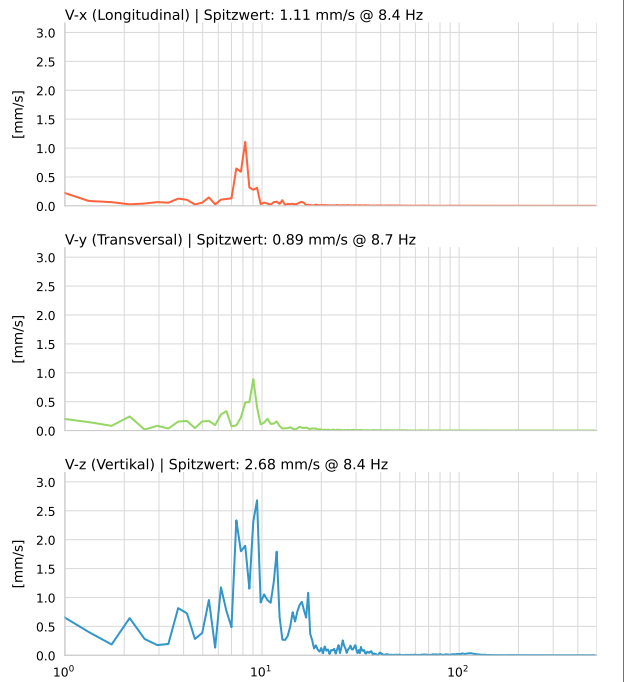

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.4 Hz	7.4 Hz	8.2 Hz	15.9 Hz
Y	8.7 Hz	6.6 Hz	9.0 Hz	13.9 Hz
Z	8.4 Hz	7.8 Hz	10.2 Hz	16.3 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

