


SCHWINGGESCHWINDIGKEIT

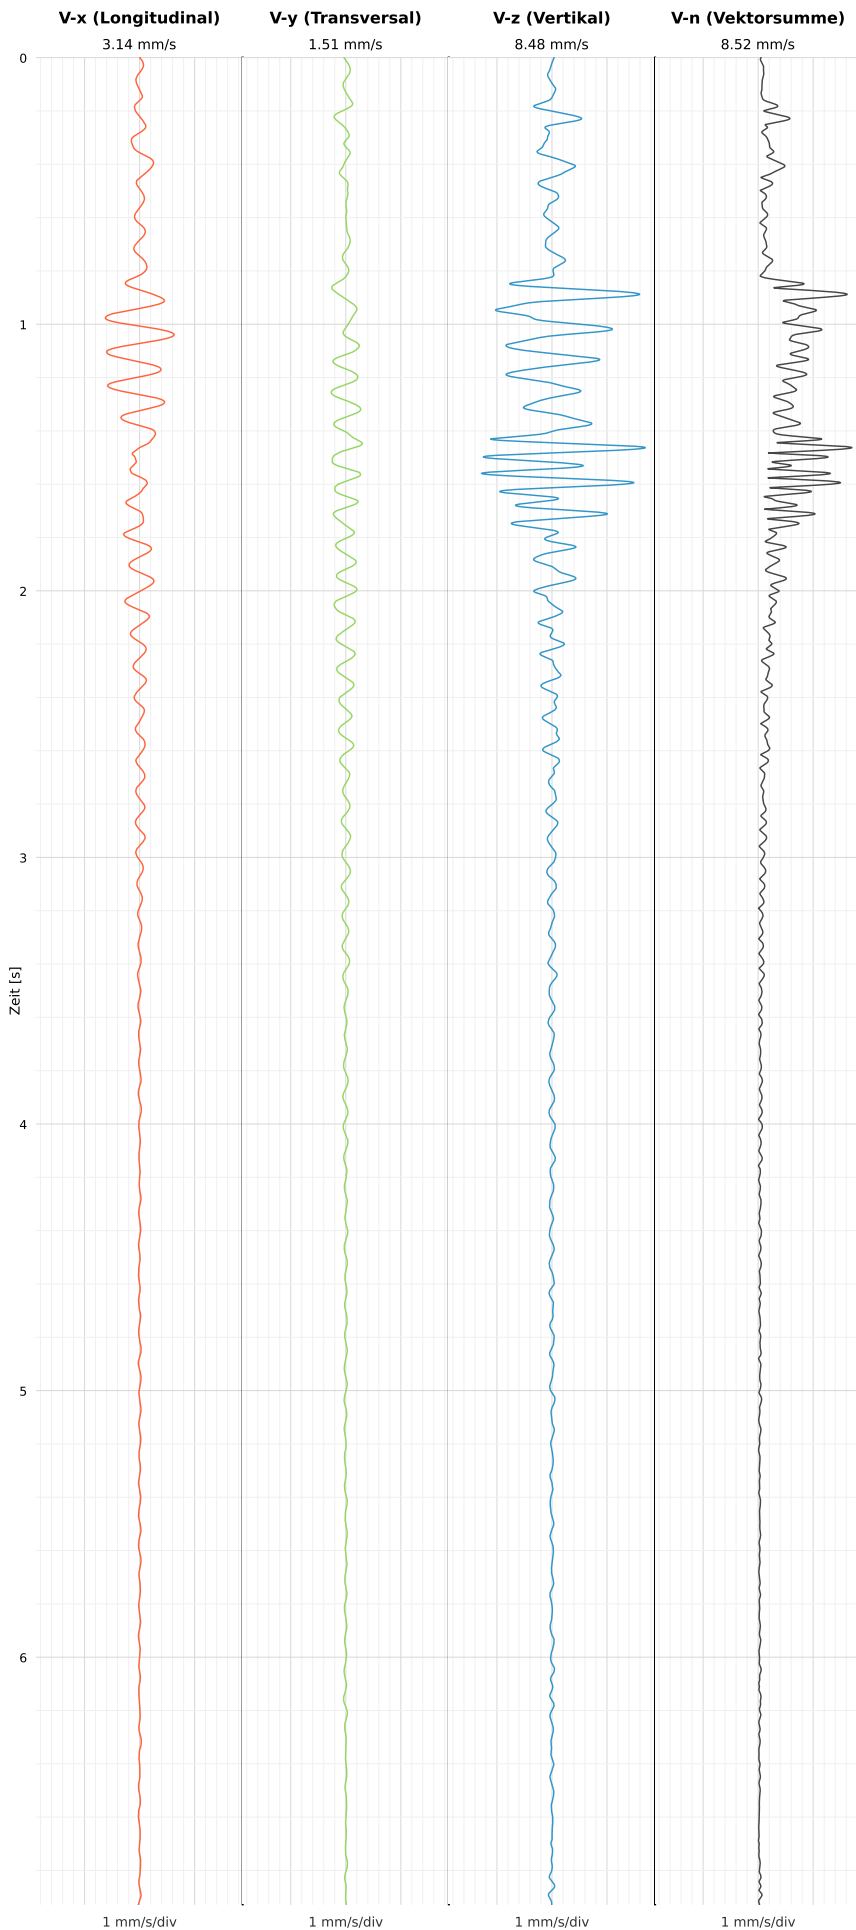


DATEI: 2492-PG-8-13052026-075656_raw.csv

Aufzeichnungsdauer: 6.93 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	09:56:56
Event-ID	2492-PG-8-13052026-075656
Status	Kritisch
X	3.14 mm/s @ 8.5 Hz
Y	1.51 mm/s @ 8.8 Hz
Z	8.48 mm/s @ 8.7 Hz
Vn	8.52 mm/s @ 8.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

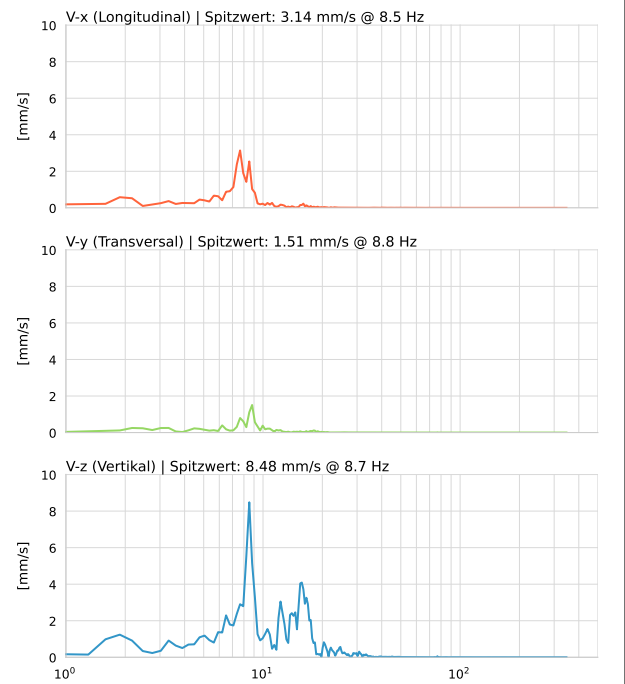

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.5 Hz	6.2 Hz	7.7 Hz	8.8 Hz
Y	8.8 Hz	6.5 Hz	8.5 Hz	10.5 Hz
Z	8.7 Hz	8.2 Hz	12.3 Hz	16.0 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

