


SCHWINGGESCHWINDIGKEIT

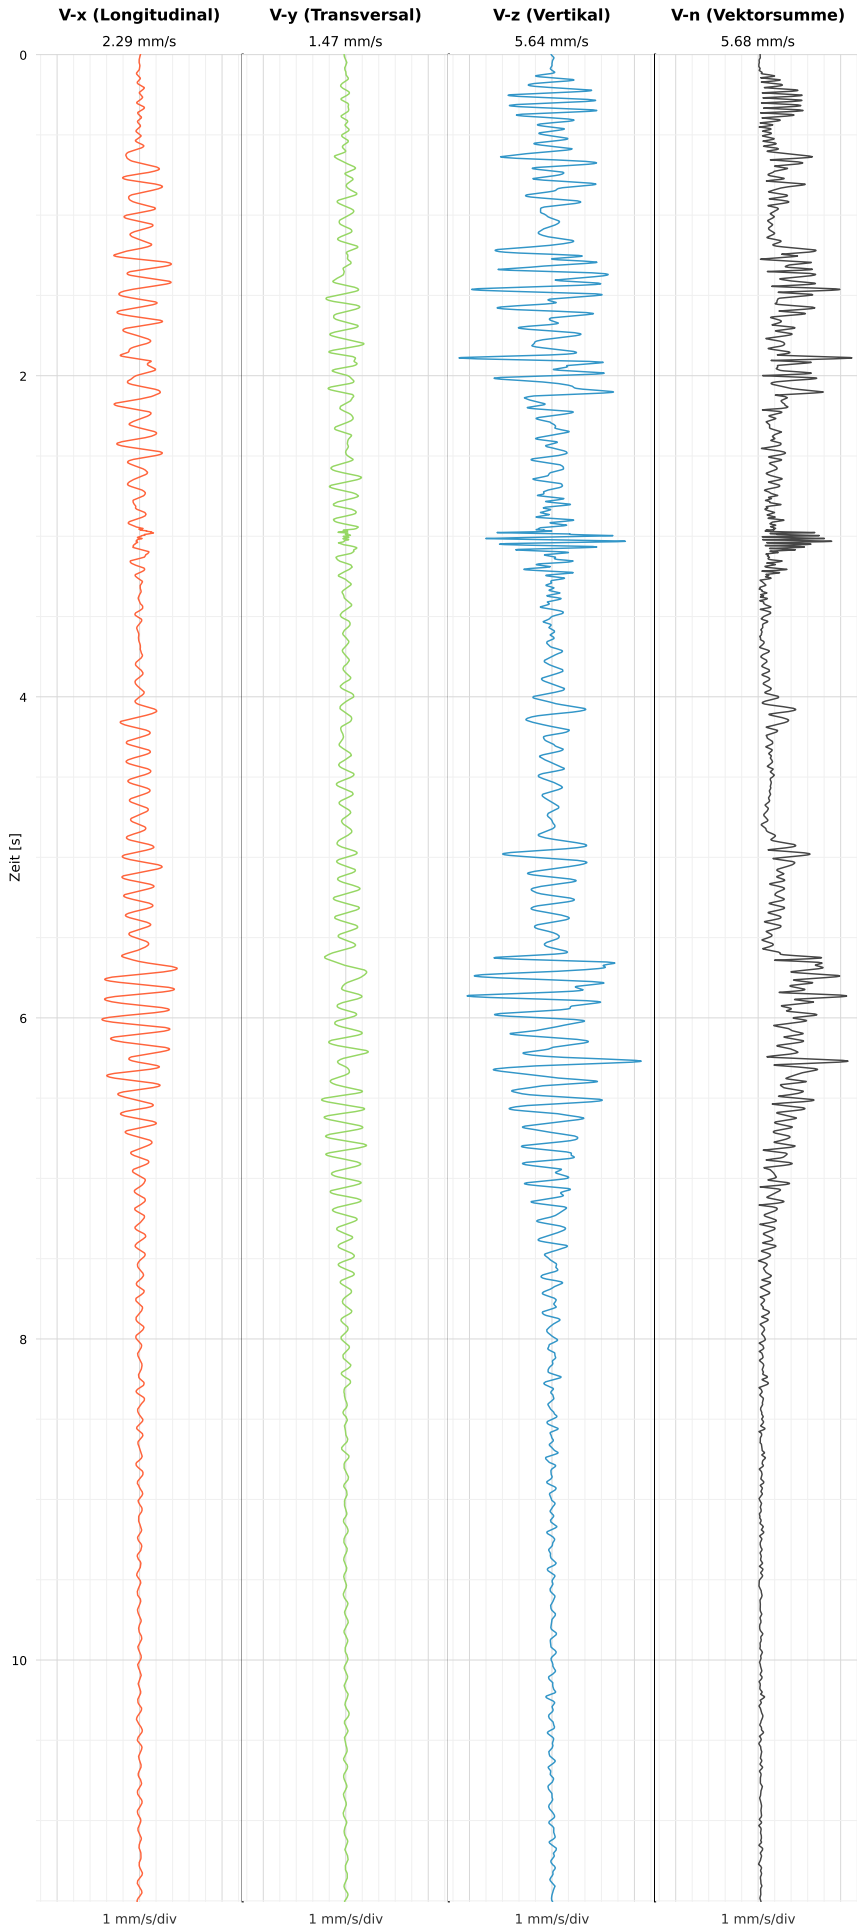


DATEI: 2492-PG-8-13052026-080517_raw.csv

Aufzeichnungsdauer: 11.50 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	10:05:17
Event-ID	2492-PG-8-13052026-080517
Status	Kritisch
X	2.29 mm/s @ 8.2 Hz
Y	1.47 mm/s @ 8.6 Hz
Z	5.64 mm/s @ 8.6 Hz
Vn	5.68 mm/s @ 8.6 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

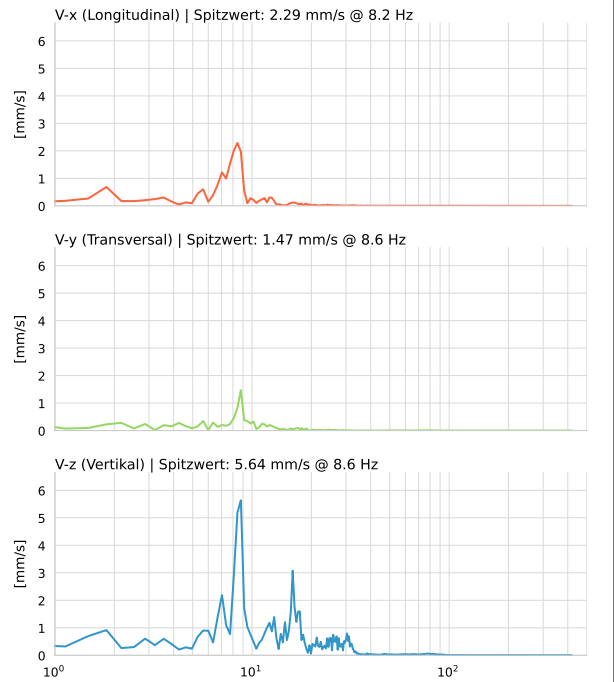

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.2 Hz	6.7 Hz	8.1 Hz	9.8 Hz
Y	8.6 Hz	6.3 Hz	8.8 Hz	12.3 Hz
Z	8.6 Hz	8.4 Hz	14.3 Hz	23.4 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

