


SCHWINGGESCHWINDIGKEIT

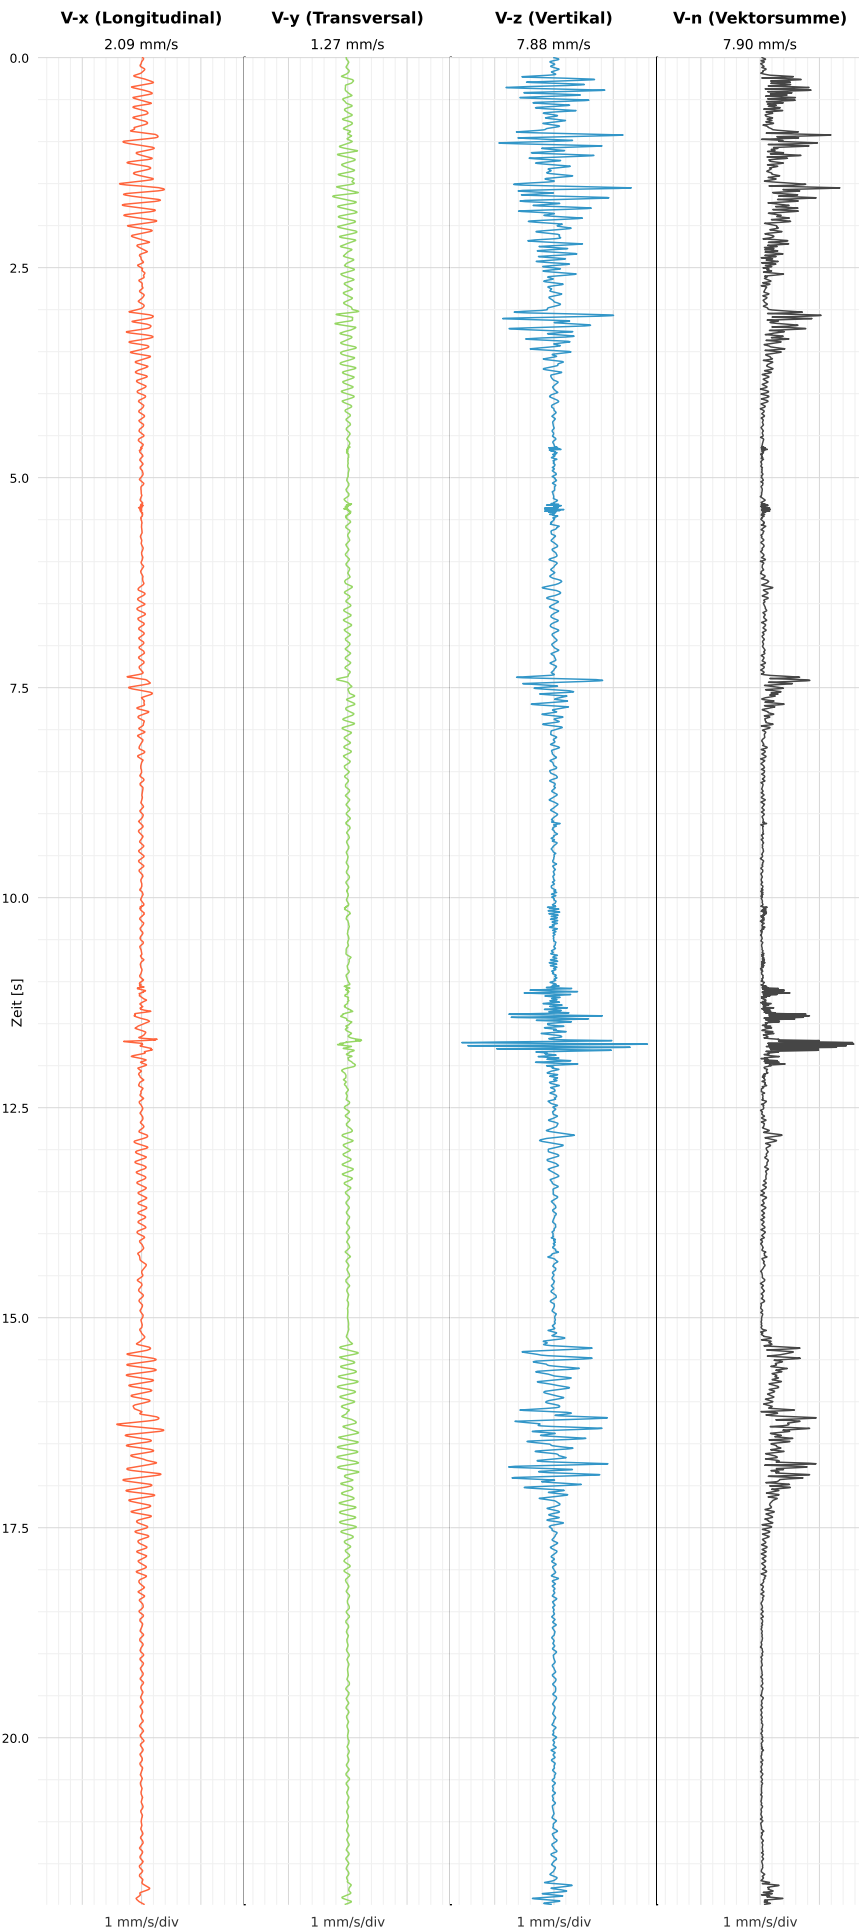


DATEI: 2492-PG-8-13052026-084130_raw.csv

Aufzeichnungsdauer: 21.98 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	10:41:30
Event-ID	2492-PG-8-13052026-084130
Status	Kritisch
X	2.09 mm/s @ 8.6 Hz
Y	1.27 mm/s @ 8.7 Hz
Z	7.88 mm/s @ 8.7 Hz
Vn	7.90 mm/s @ 8.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

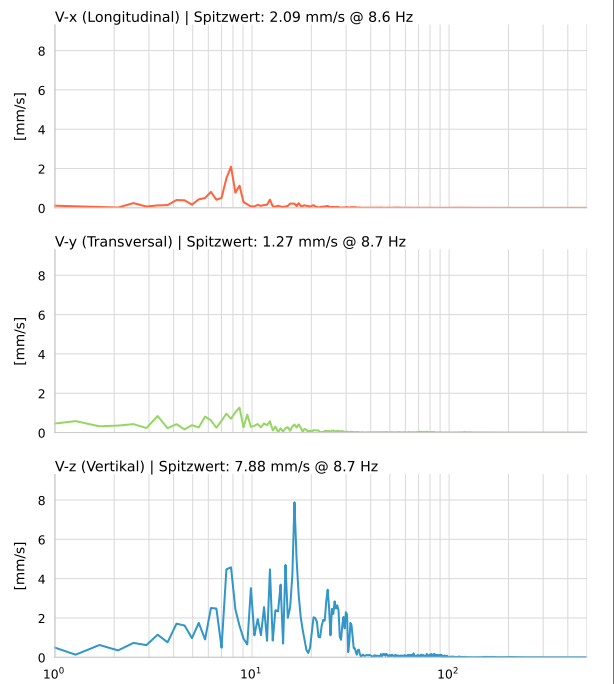

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.6 Hz	7.0 Hz	8.2 Hz	16.0 Hz
Y	8.7 Hz	6.2 Hz	9.5 Hz	18.9 Hz
Z	8.7 Hz	11.5 Hz	16.8 Hz	26.7 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

