


## SCHWINGGESCHWINDIGKEIT

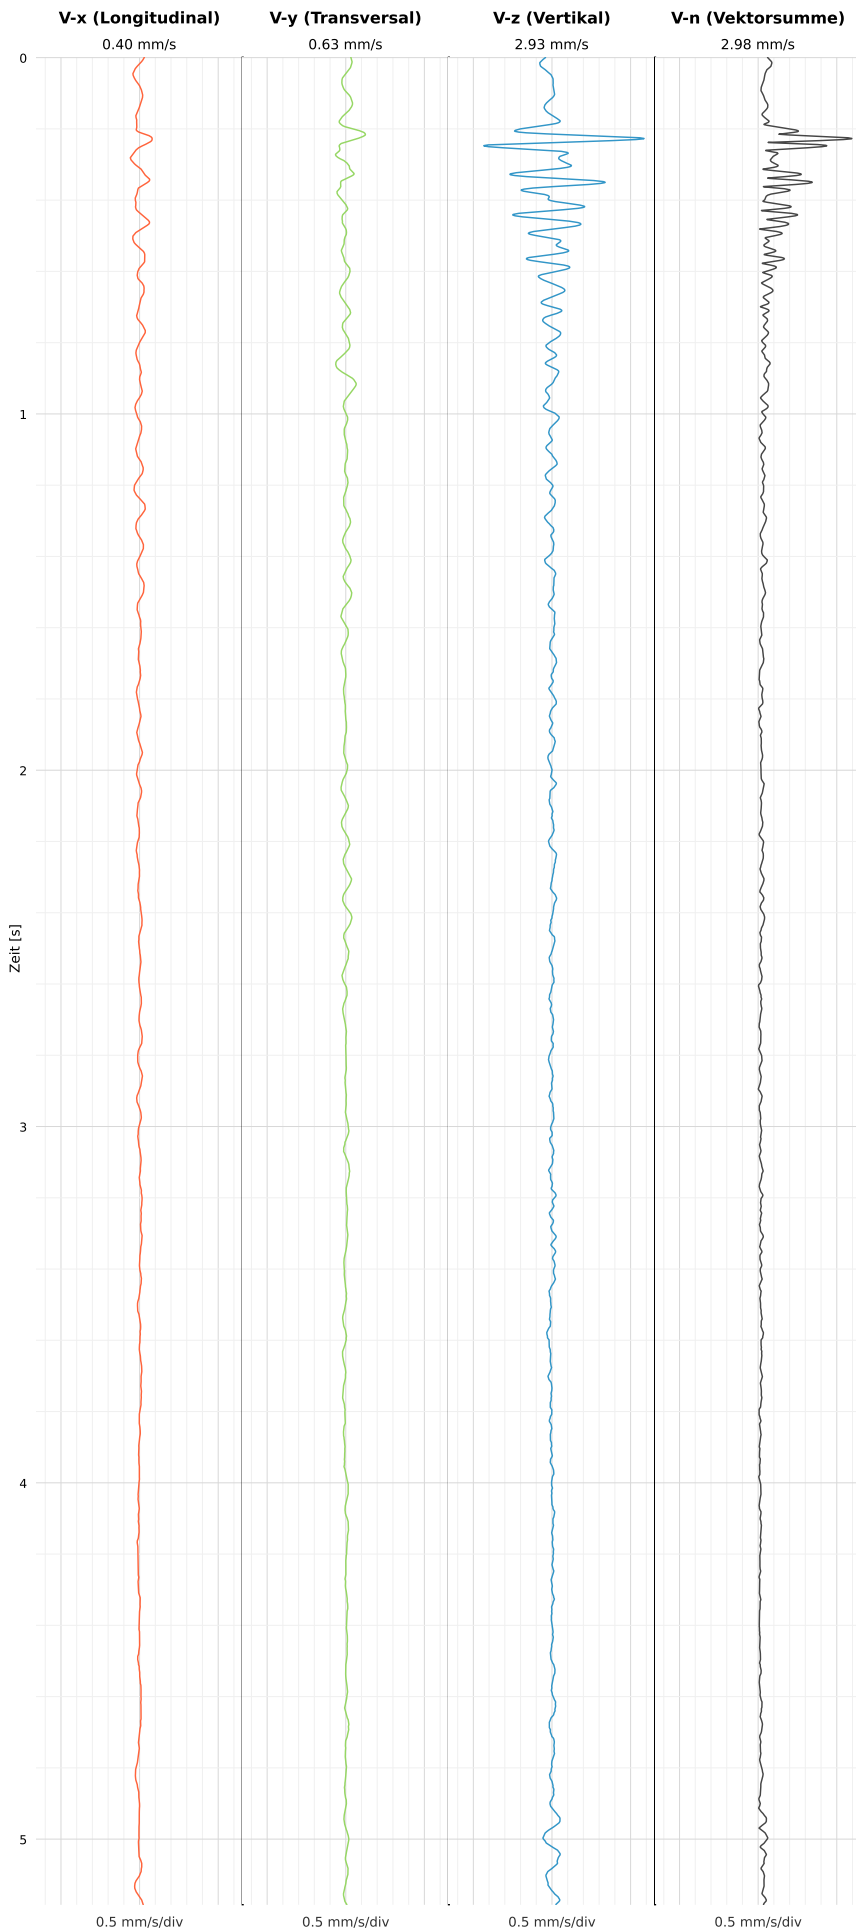


DATEI: 2492-PG-8-13052026-085925\_raw.csv

Aufzeichnungsdauer: 5.18 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	10:59:25
Event-ID	2492-PG-8-13052026-085925
Status	Ereignis
X	0.40 mm/s @ 8.7 Hz
Y	0.63 mm/s @ 10.0 Hz
Z	2.93 mm/s @ 8.7 Hz
Vn	2.98 mm/s @ 8.7 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

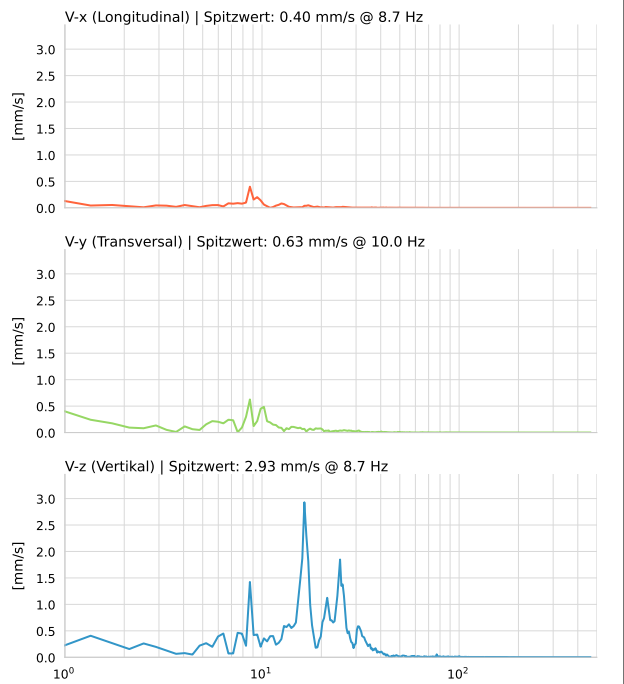

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.7 Hz	7.5 Hz	9.5 Hz	17.6 Hz
Y	10.0 Hz	6.4 Hz	10.2 Hz	19.1 Hz
Z	8.7 Hz	15.6 Hz	21.4 Hz	26.8 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

