


SCHWINGGESCHWINDIGKEIT

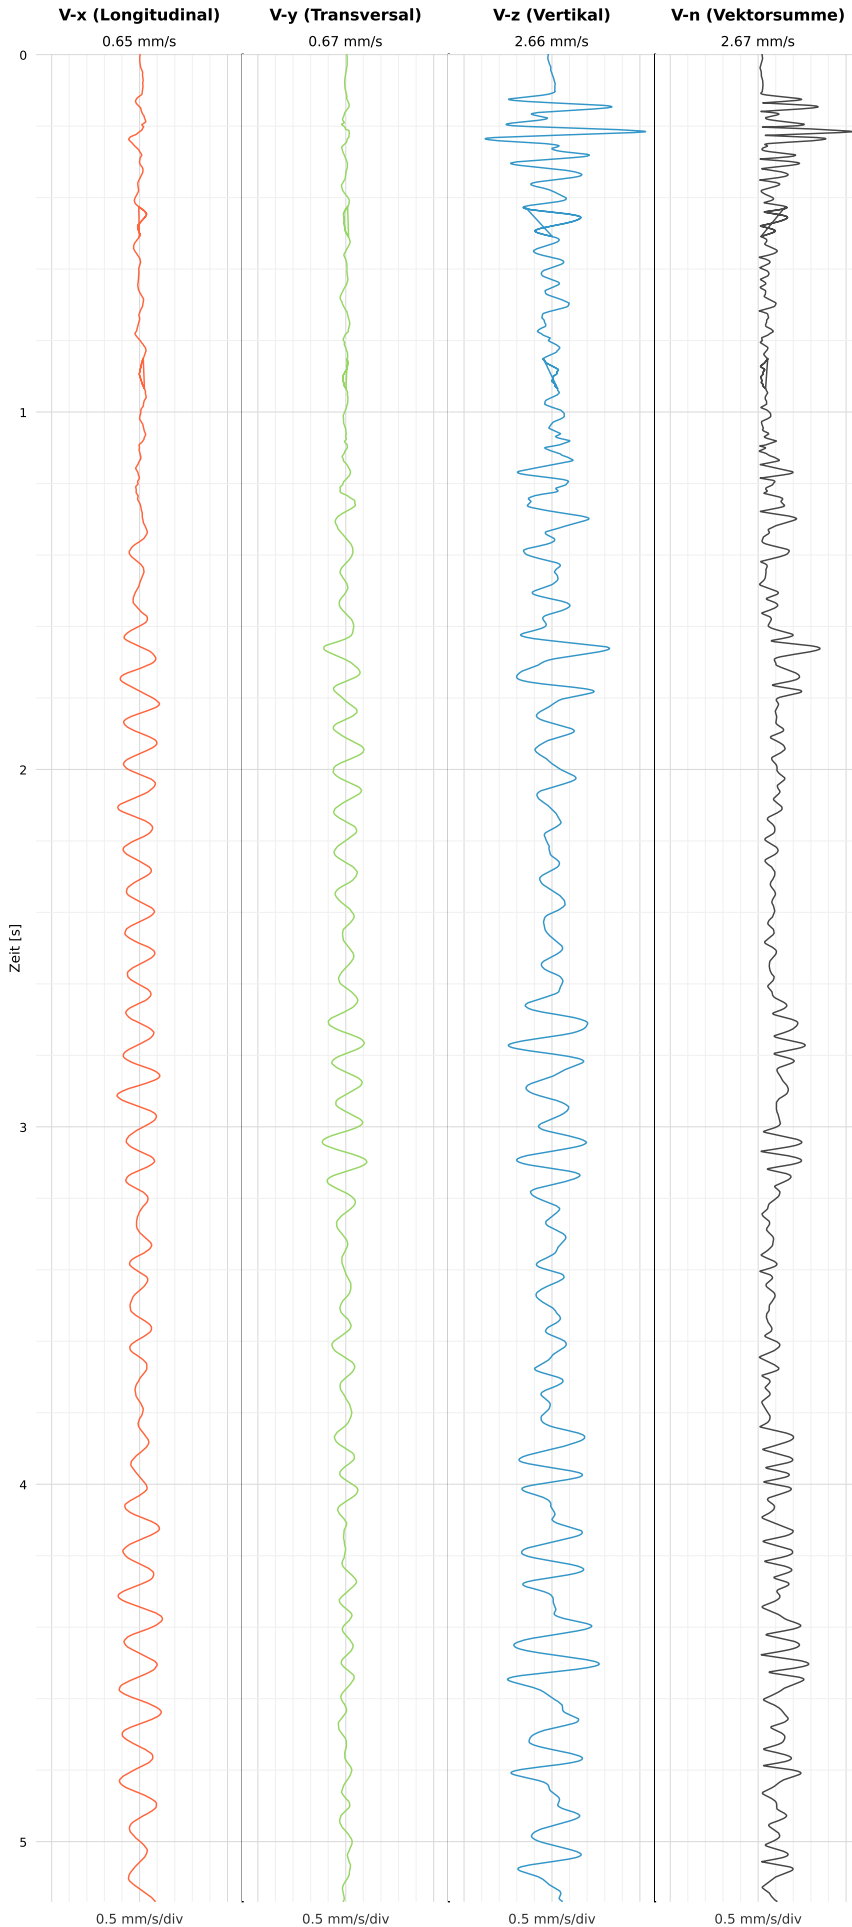


DATEI: 2492-PG-8-13052026-090043_raw.csv

Aufzeichnungsdauer: 5.17 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	11:00:43
Event-ID	2492-PG-8-13052026-090043
Status	Ereignis
X	0.65 mm/s @ 8.6 Hz
Y	0.67 mm/s @ 8.6 Hz
Z	2.66 mm/s @ 8.6 Hz
Vn	2.67 mm/s @ 8.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

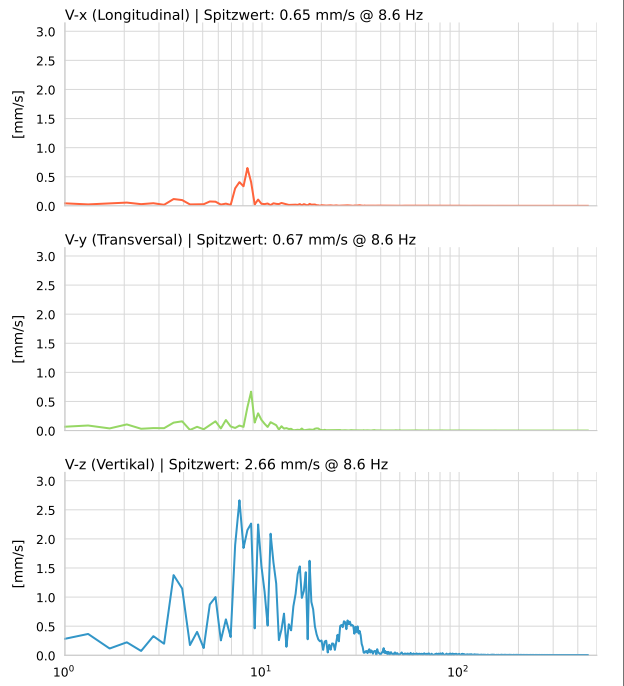

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.6 Hz	7.7 Hz	8.4 Hz	15.5 Hz
Y	8.6 Hz	6.6 Hz	8.8 Hz	11.8 Hz
Z	8.6 Hz	8.4 Hz	14.4 Hz	25.7 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

