


SCHWINGGESCHWINDIGKEIT

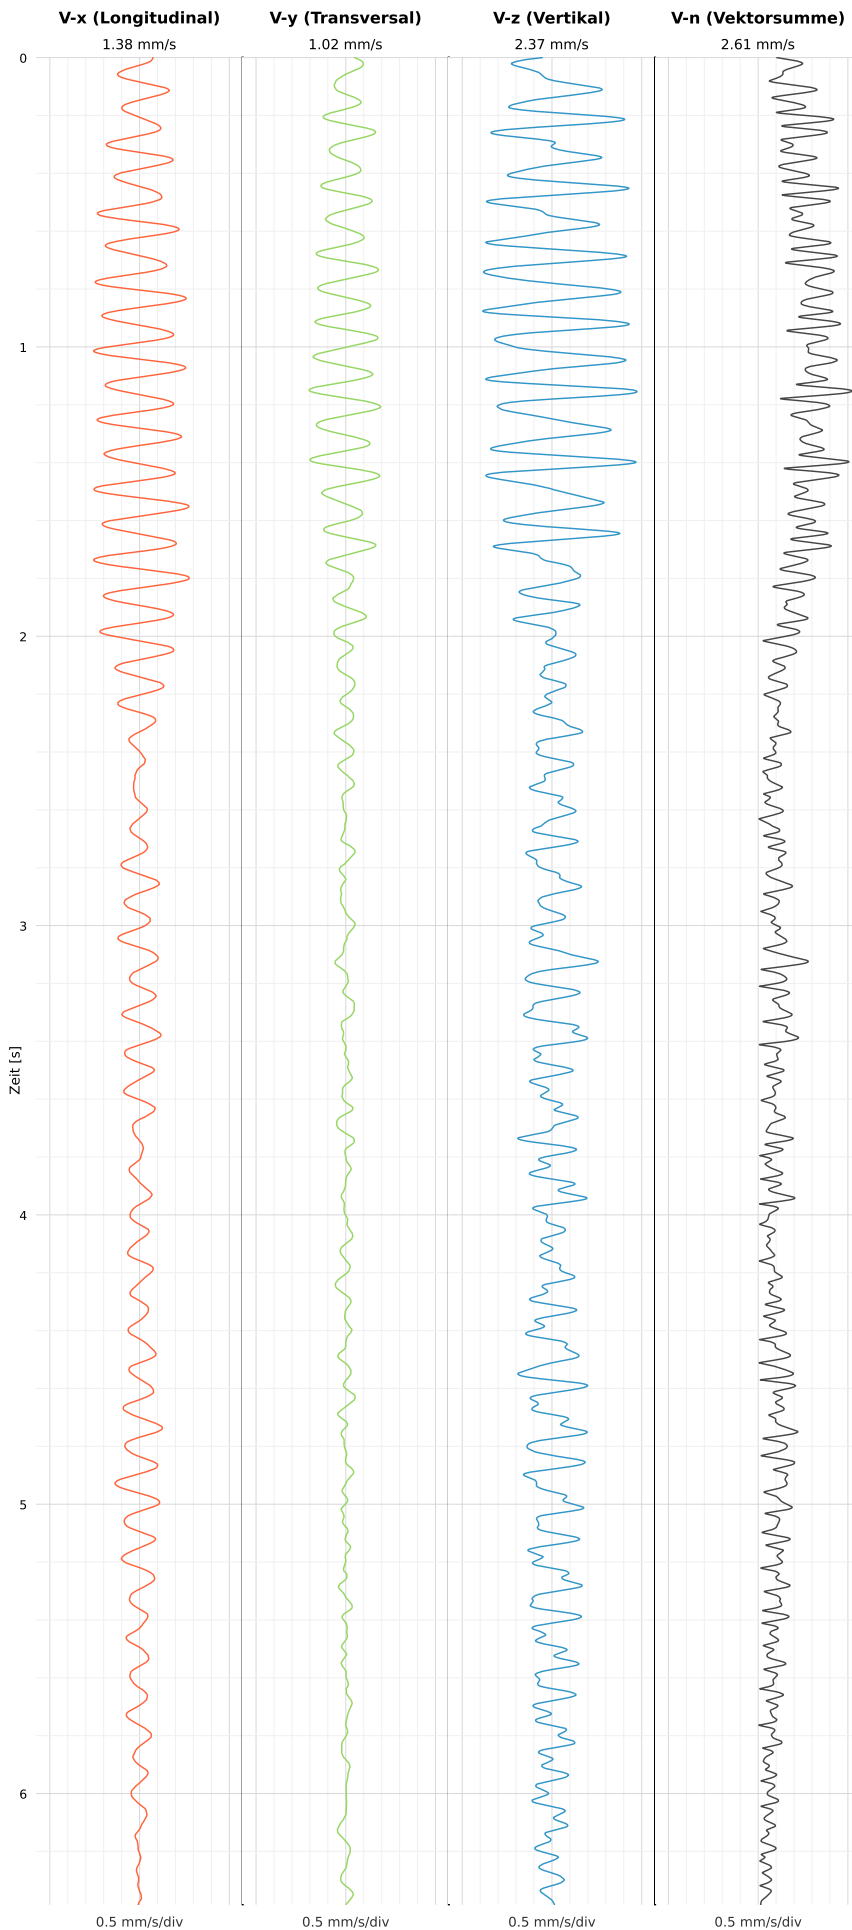


DATEI: 2492-PG-8-13052026-090849_raw.csv

Aufzeichnungsdauer: 6.38 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	11:08:49
Event-ID	2492-PG-8-13052026-090849
Status	Ereignis
X	1.38 mm/s @ 7.5 Hz
Y	1.02 mm/s @ 8.5 Hz
Z	2.37 mm/s @ 7.5 Hz
Vn	2.61 mm/s @ 7.5 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

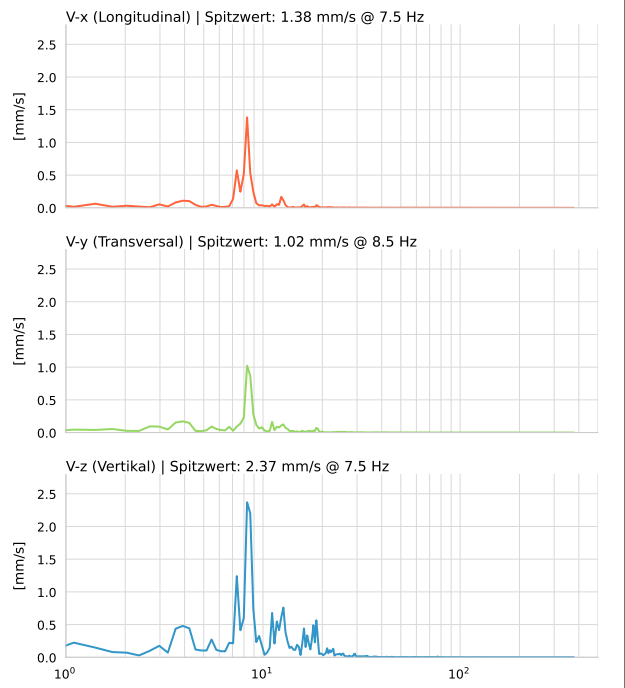

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	7.5 Hz	7.7 Hz	8.3 Hz	11.7 Hz
Y	8.5 Hz	7.7 Hz	8.6 Hz	12.4 Hz
Z	7.5 Hz	8.0 Hz	9.6 Hz	16.1 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

