


SCHWINGGESCHWINDIGKEIT

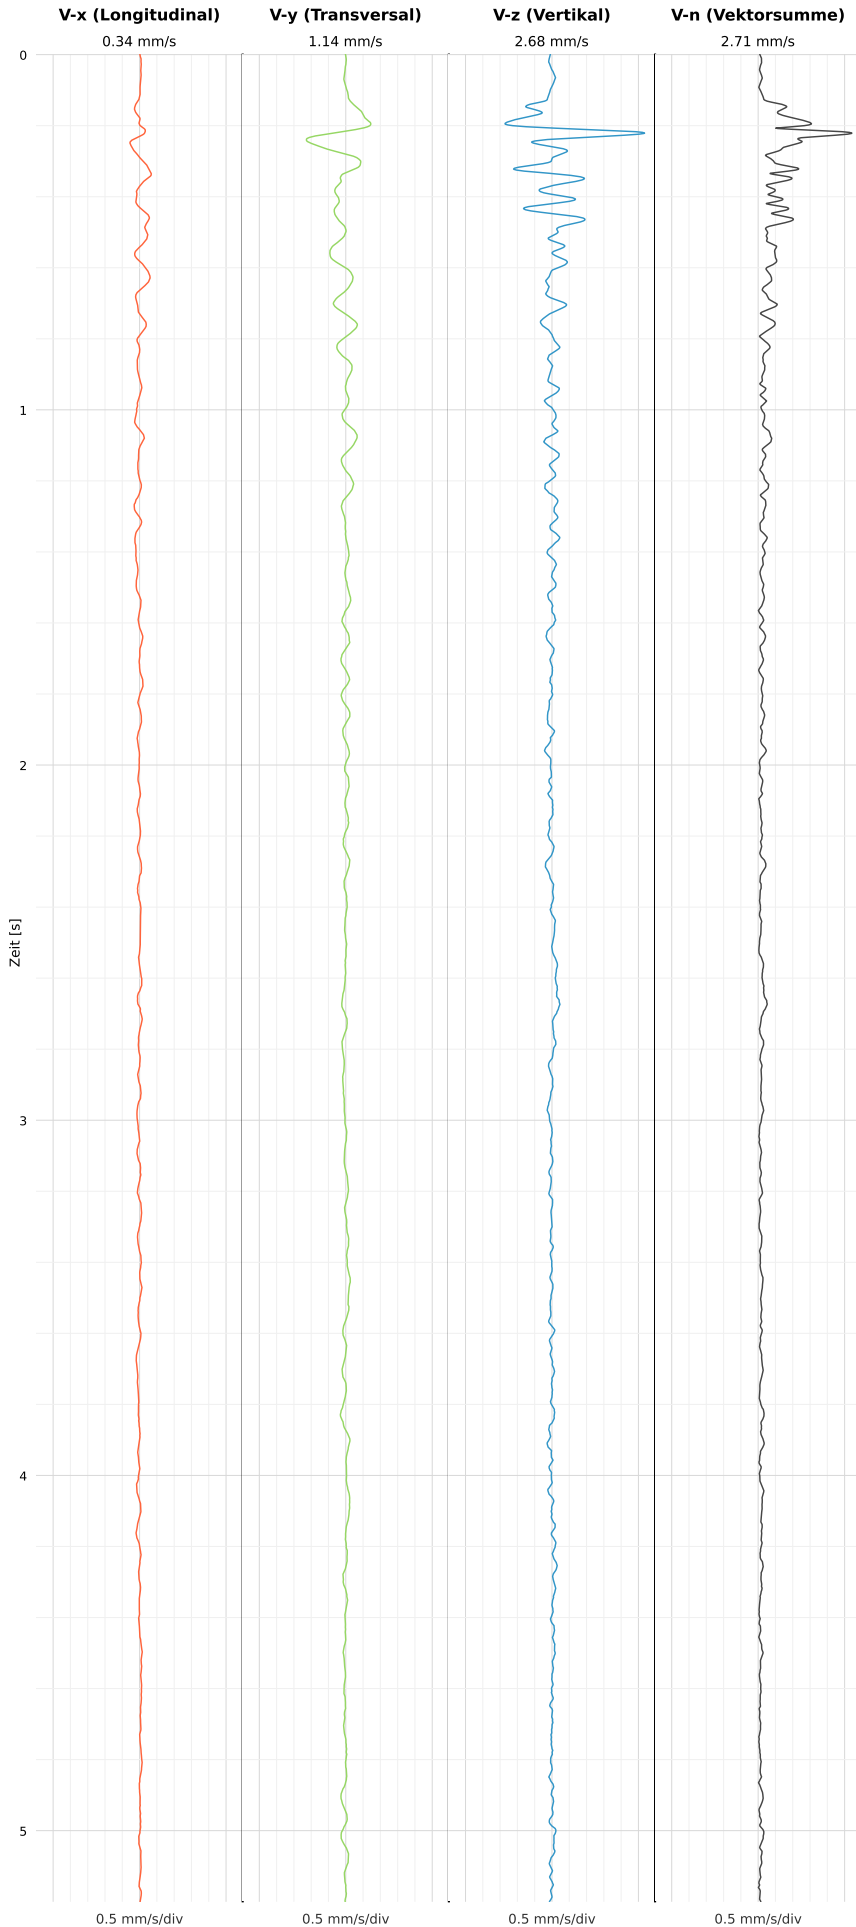


DATEI: 2492-PG-8-13052026-091316_raw.csv

Aufzeichnungsdauer: 5.20 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	11:13:16
Event-ID	2492-PG-8-13052026-091316
Status	Ereignis
X	0.34 mm/s @ 9.2 Hz
Y	1.14 mm/s @ 9.2 Hz
Z	2.68 mm/s @ 9.0 Hz
Vn	2.71 mm/s @ 9.0 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

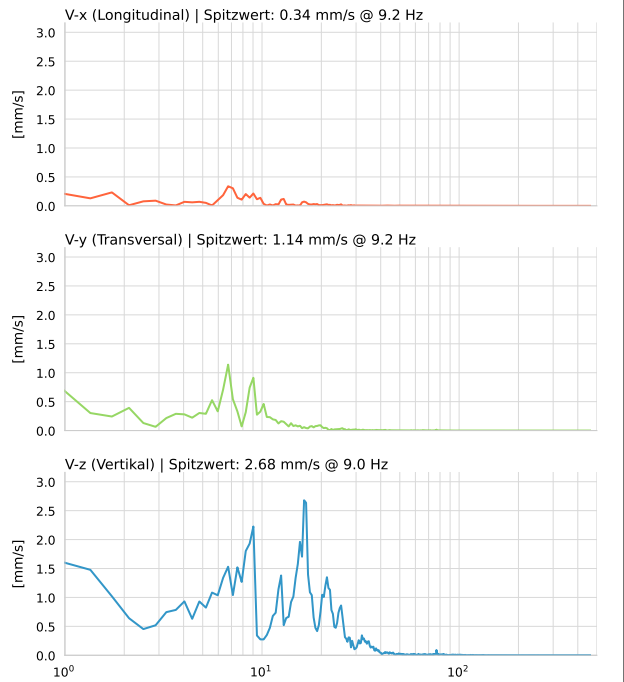

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	9.2 Hz	4.8 Hz	8.3 Hz	16.0 Hz
Y	9.2 Hz	4.8 Hz	7.5 Hz	11.0 Hz
Z	9.0 Hz	7.5 Hz	15.2 Hz	21.3 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

