


SCHWINGGESCHWINDIGKEIT

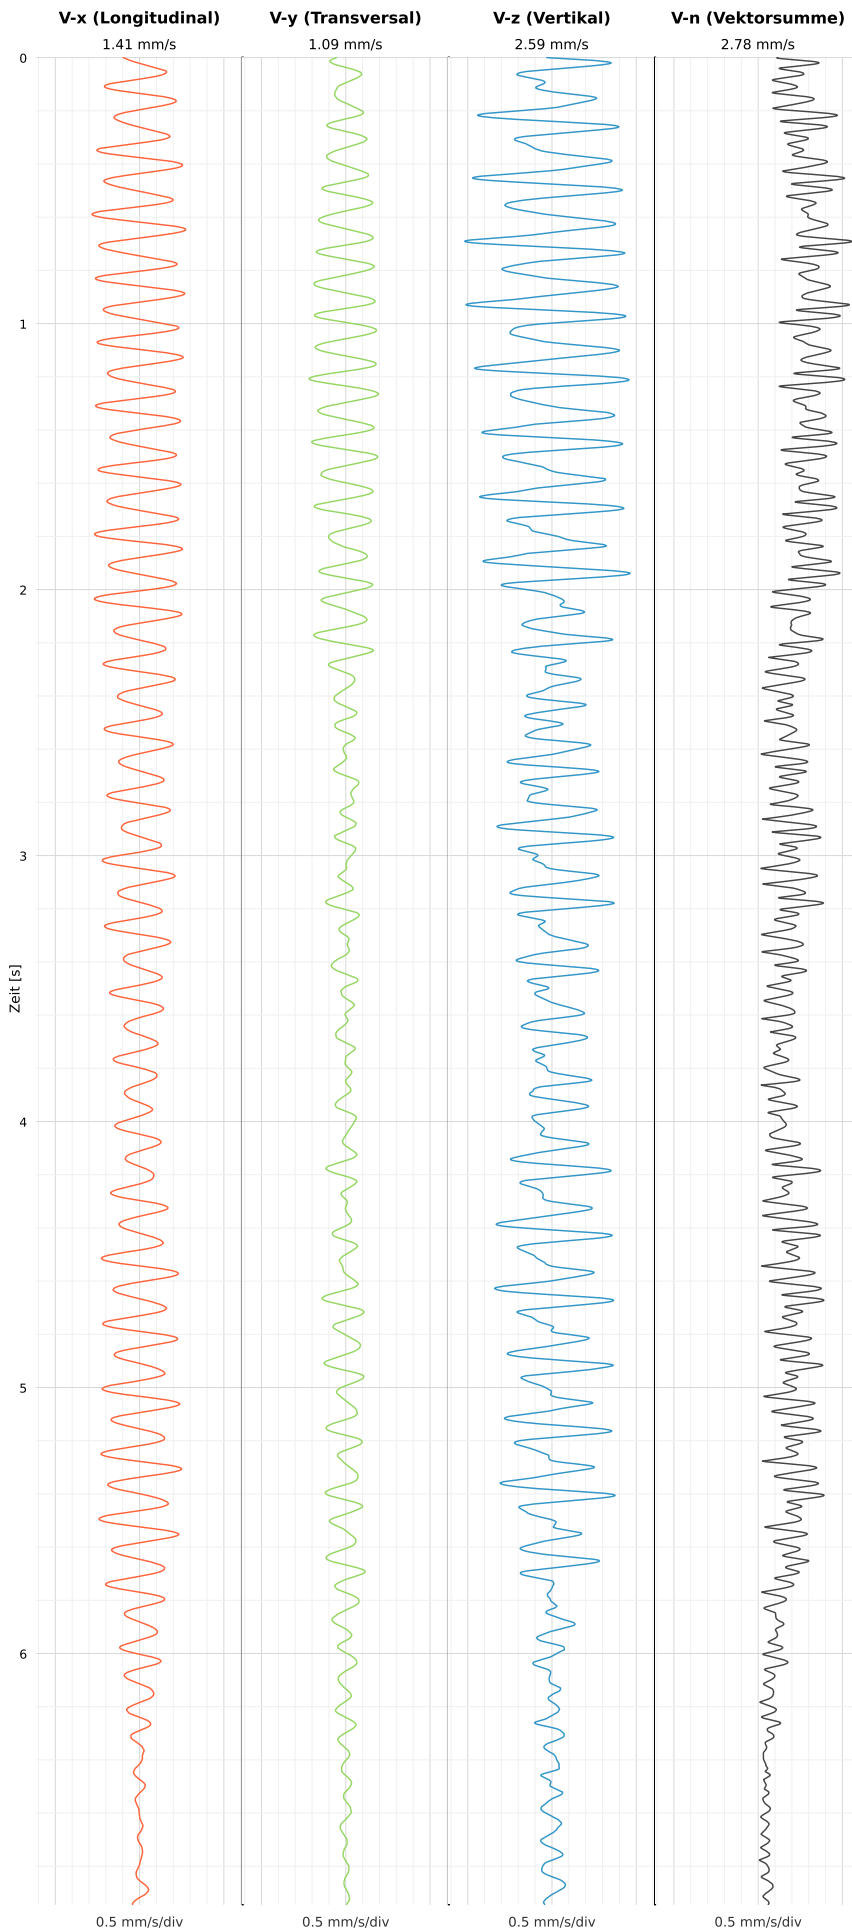


DATEI: 2492-PG-8-13052026-091600_raw.csv

Aufzeichnungsdauer: 6.94 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	11:16:00
Event-ID	2492-PG-8-13052026-091600
Status	Ereignis
X	1.41 mm/s @ 8.1 Hz
Y	1.09 mm/s @ 8.1 Hz
Z	2.59 mm/s @ 8.1 Hz
Vn	2.78 mm/s @ 8.1 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

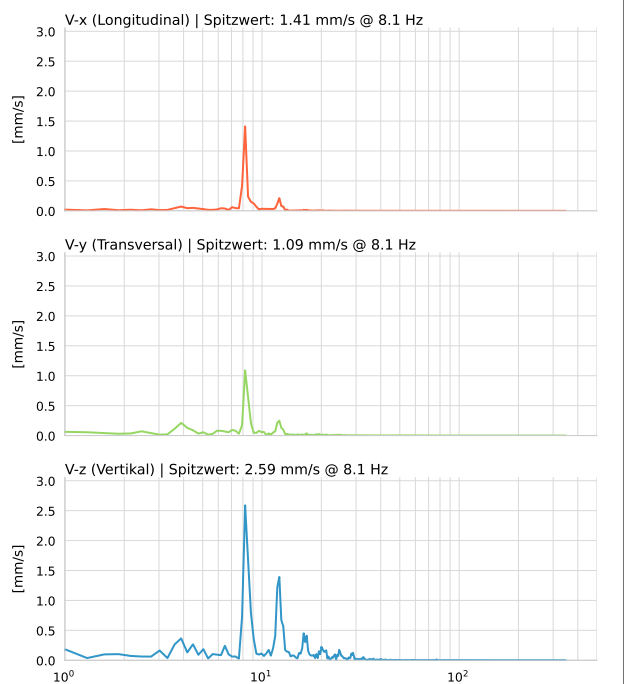

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.1 Hz	7.9 Hz	8.2 Hz	11.7 Hz
Y	8.1 Hz	7.3 Hz	8.5 Hz	12.2 Hz
Z	8.1 Hz	8.2 Hz	12.0 Hz	16.6 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

