


SCHWINGGESCHWINDIGKEIT

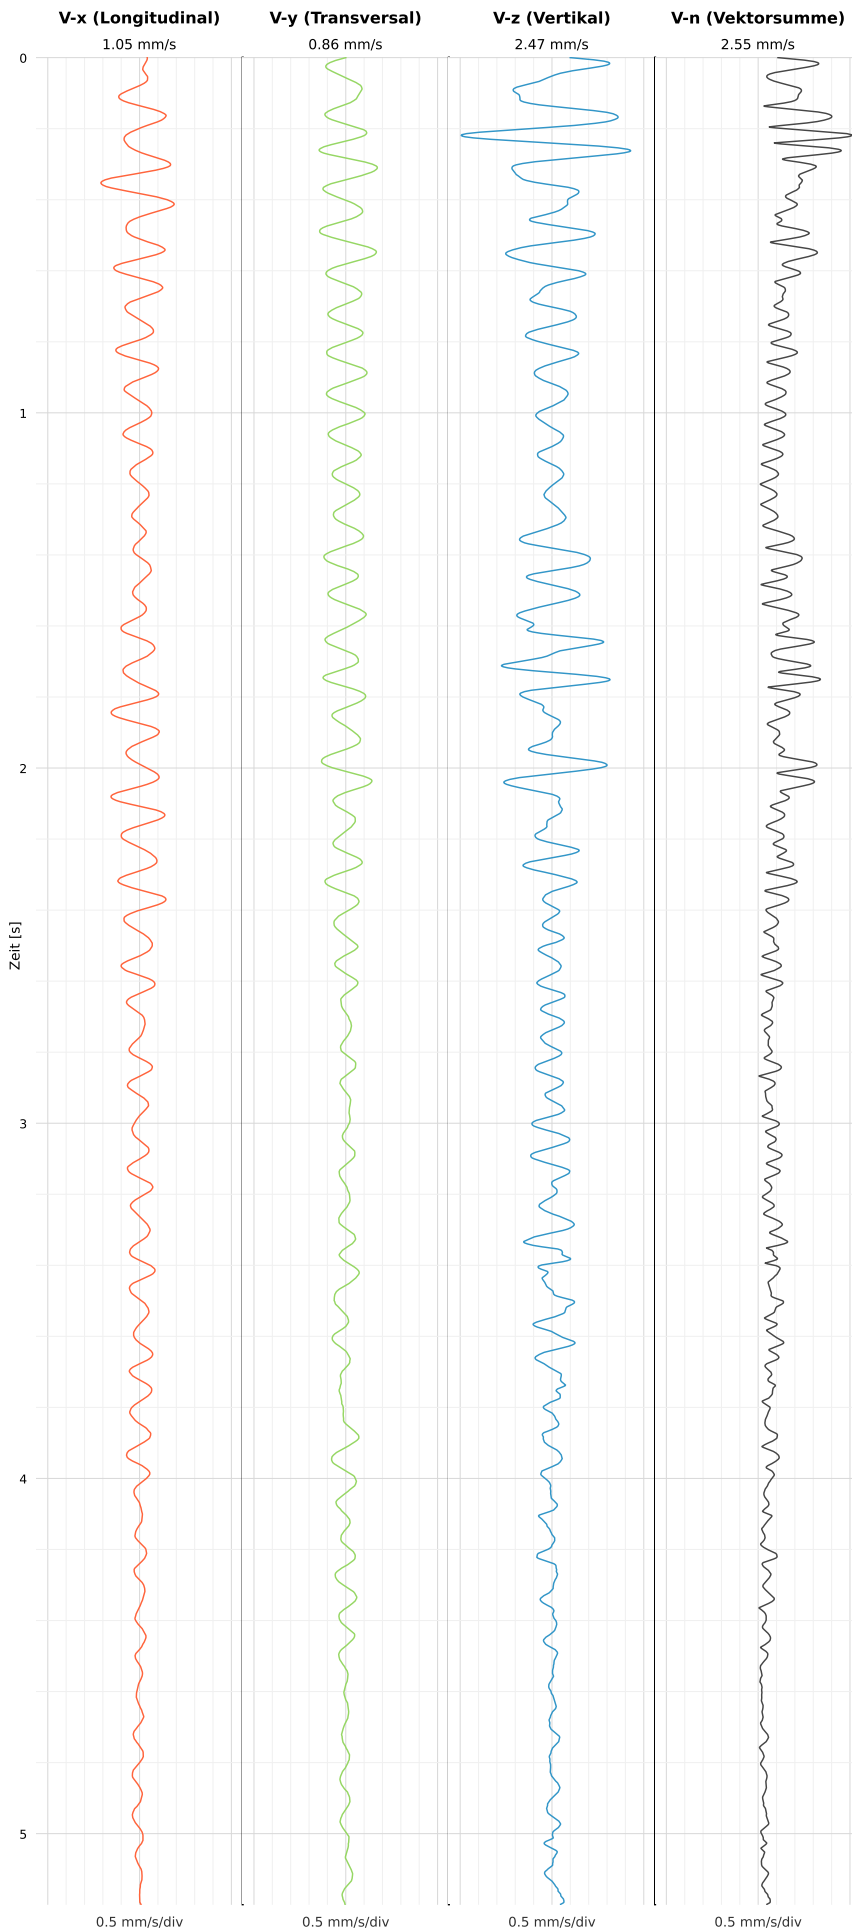


DATEI: 2492-PG-8-13052026-091628_raw.csv

Aufzeichnungsdauer: 5.20 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	11:16:28
Event-ID	2492-PG-8-13052026-091628
Status	Ereignis
X	1.05 mm/s @ 8.7 Hz
Y	0.86 mm/s @ 8.7 Hz
Z	2.47 mm/s @ 8.7 Hz
Vn	2.55 mm/s @ 8.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

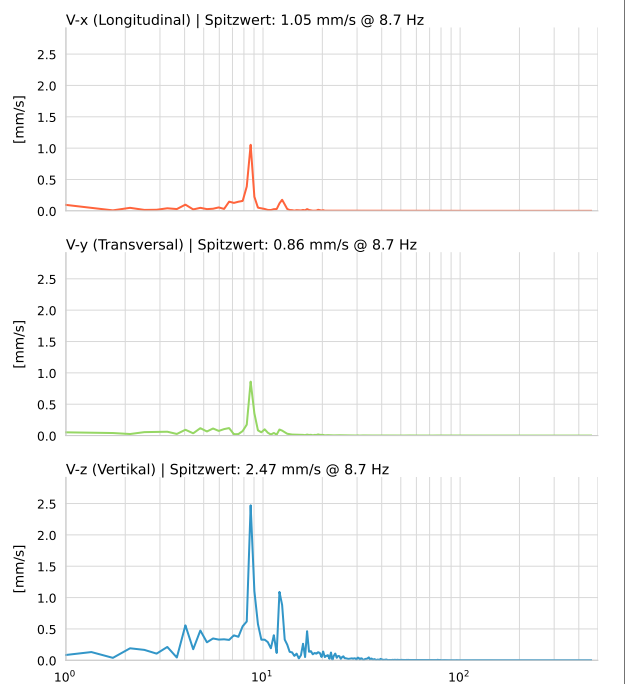

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.7 Hz	7.5 Hz	8.7 Hz	11.7 Hz
Y	8.7 Hz	6.3 Hz	8.7 Hz	10.2 Hz
Z	8.7 Hz	7.5 Hz	9.4 Hz	13.7 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

