


## SCHWINGGESCHWINDIGKEIT

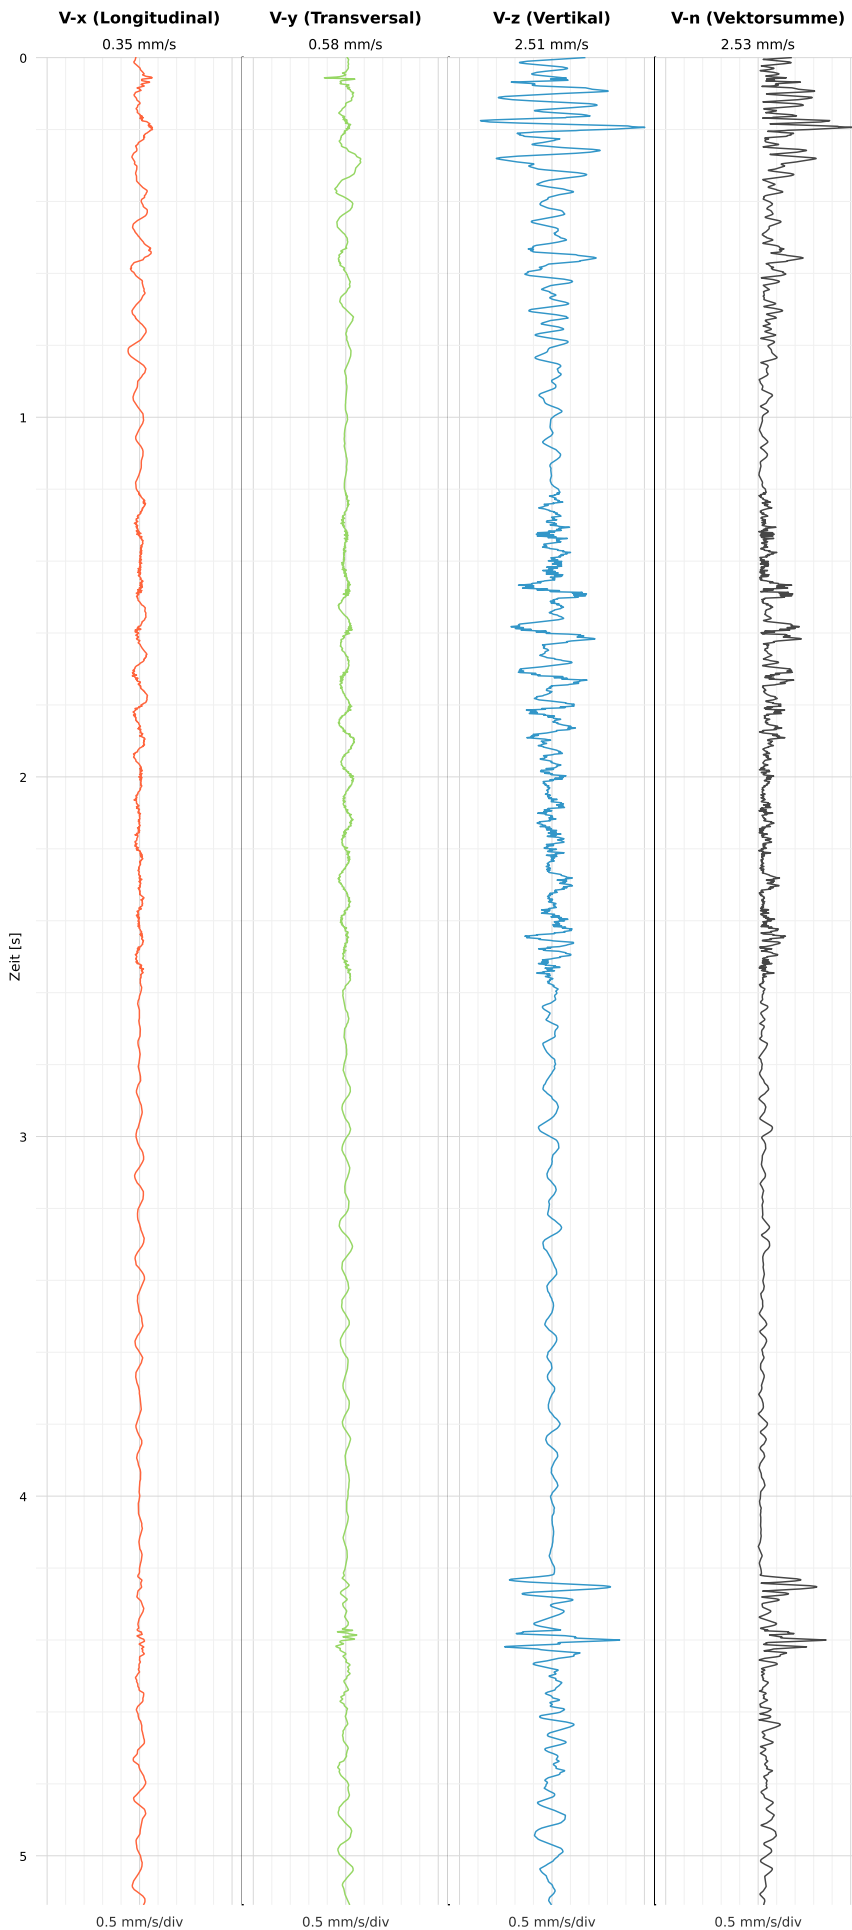


DATEI: 2492-PG-8-13052026-091652\_raw.csv

Aufzeichnungsdauer: 5.14 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	11:16:52
Event-ID	2492-PG-8-13052026-091652
Status	Ereignis
X	0.35 mm/s @ 8.8 Hz
Y	0.58 mm/s @ 9.3 Hz
Z	2.51 mm/s @ 9.3 Hz
Vn	2.53 mm/s @ 9.3 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

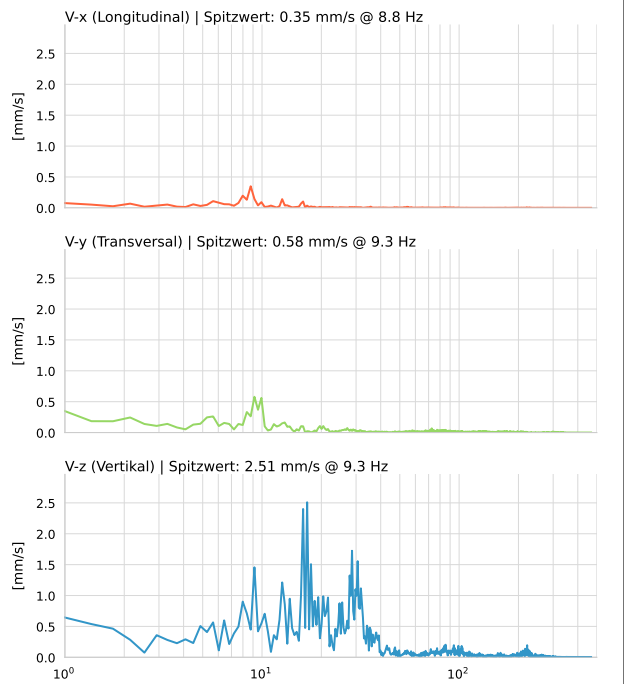

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.8 Hz	8.4 Hz	16.2 Hz	87.4 Hz
Y	9.3 Hz	9.2 Hz	31.7 Hz	124.0 Hz
Z	9.3 Hz	16.5 Hz	28.6 Hz	82.7 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

