


## SCHWINGGESCHWINDIGKEIT

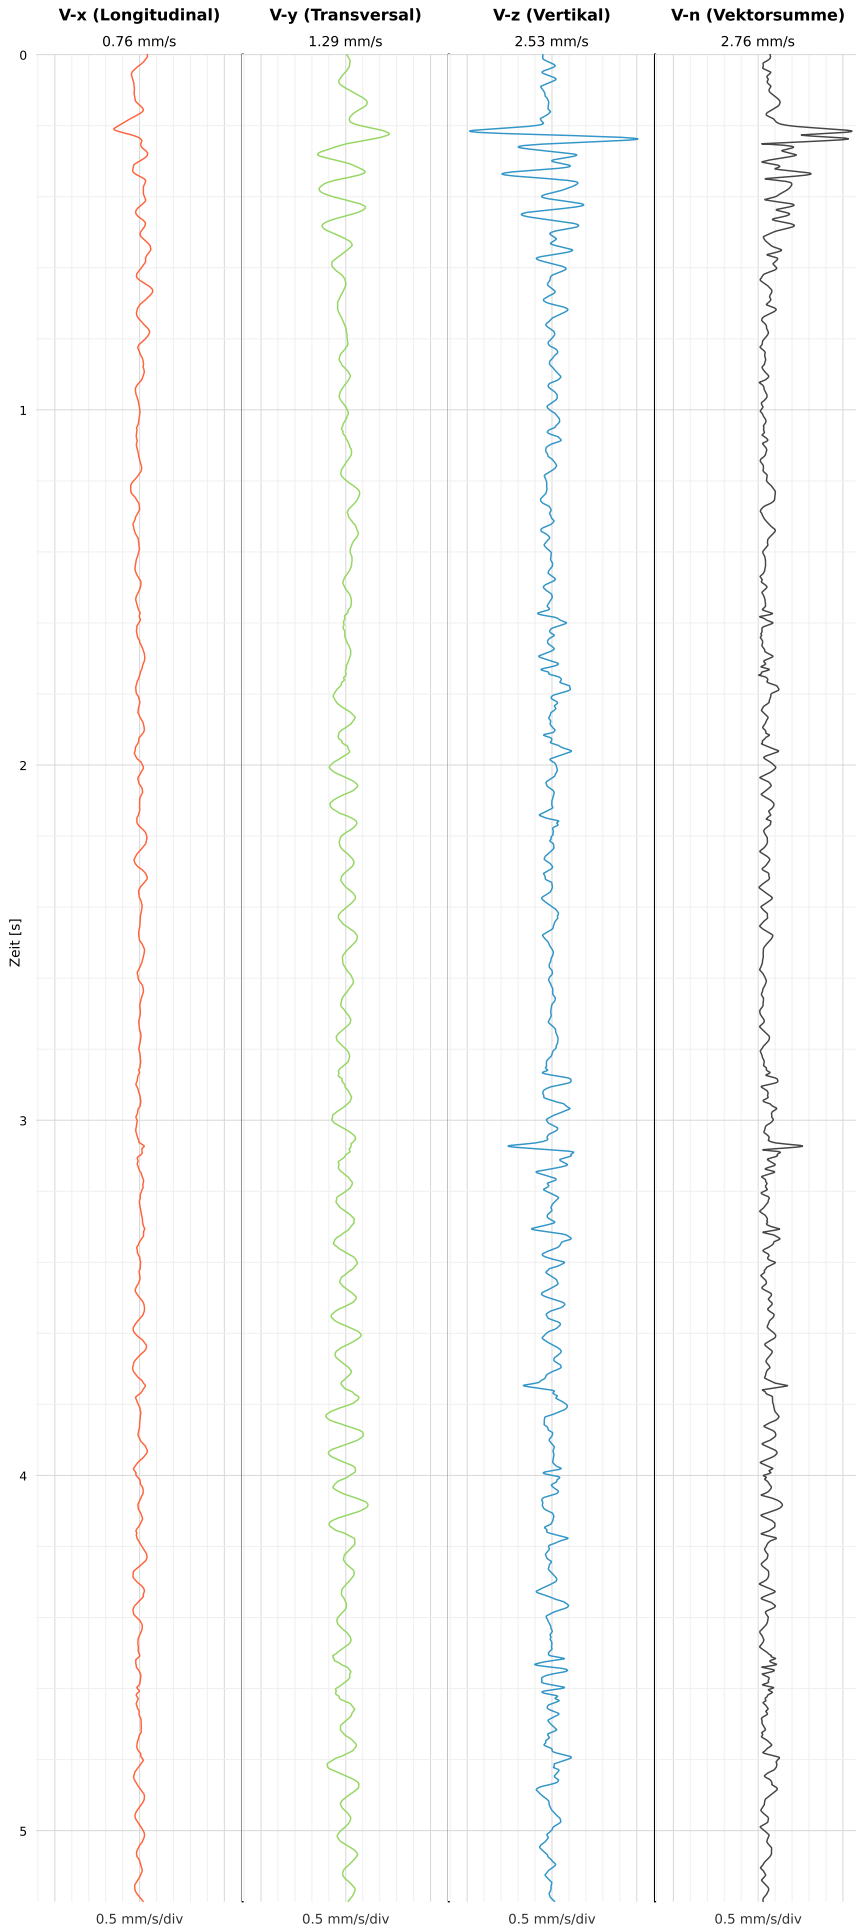


DATEI: 2492-PG-8-13052026-093136\_raw.csv

Aufzeichnungsdauer: 5.20 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	11:31:36
Event-ID	2492-PG-8-13052026-093136
Status	Ereignis
X	0.76 mm/s @ 9.8 Hz
Y	1.29 mm/s @ 8.8 Hz
Z	2.53 mm/s @ 8.8 Hz
Vn	2.76 mm/s @ 8.8 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

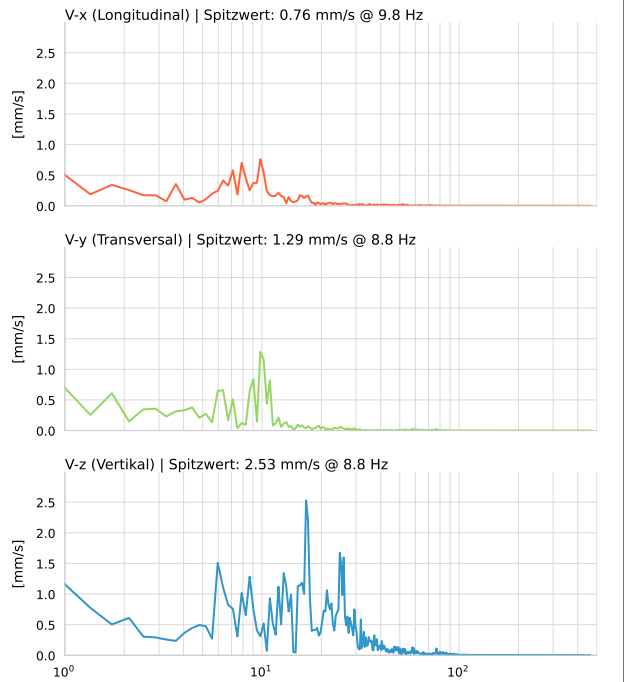

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	9.8 Hz	6.0 Hz	9.4 Hz	16.3 Hz
Y	8.8 Hz	4.4 Hz	9.0 Hz	11.0 Hz
Z	8.8 Hz	11.3 Hz	18.7 Hz	27.5 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

