


## SCHWINGGESCHWINDIGKEIT

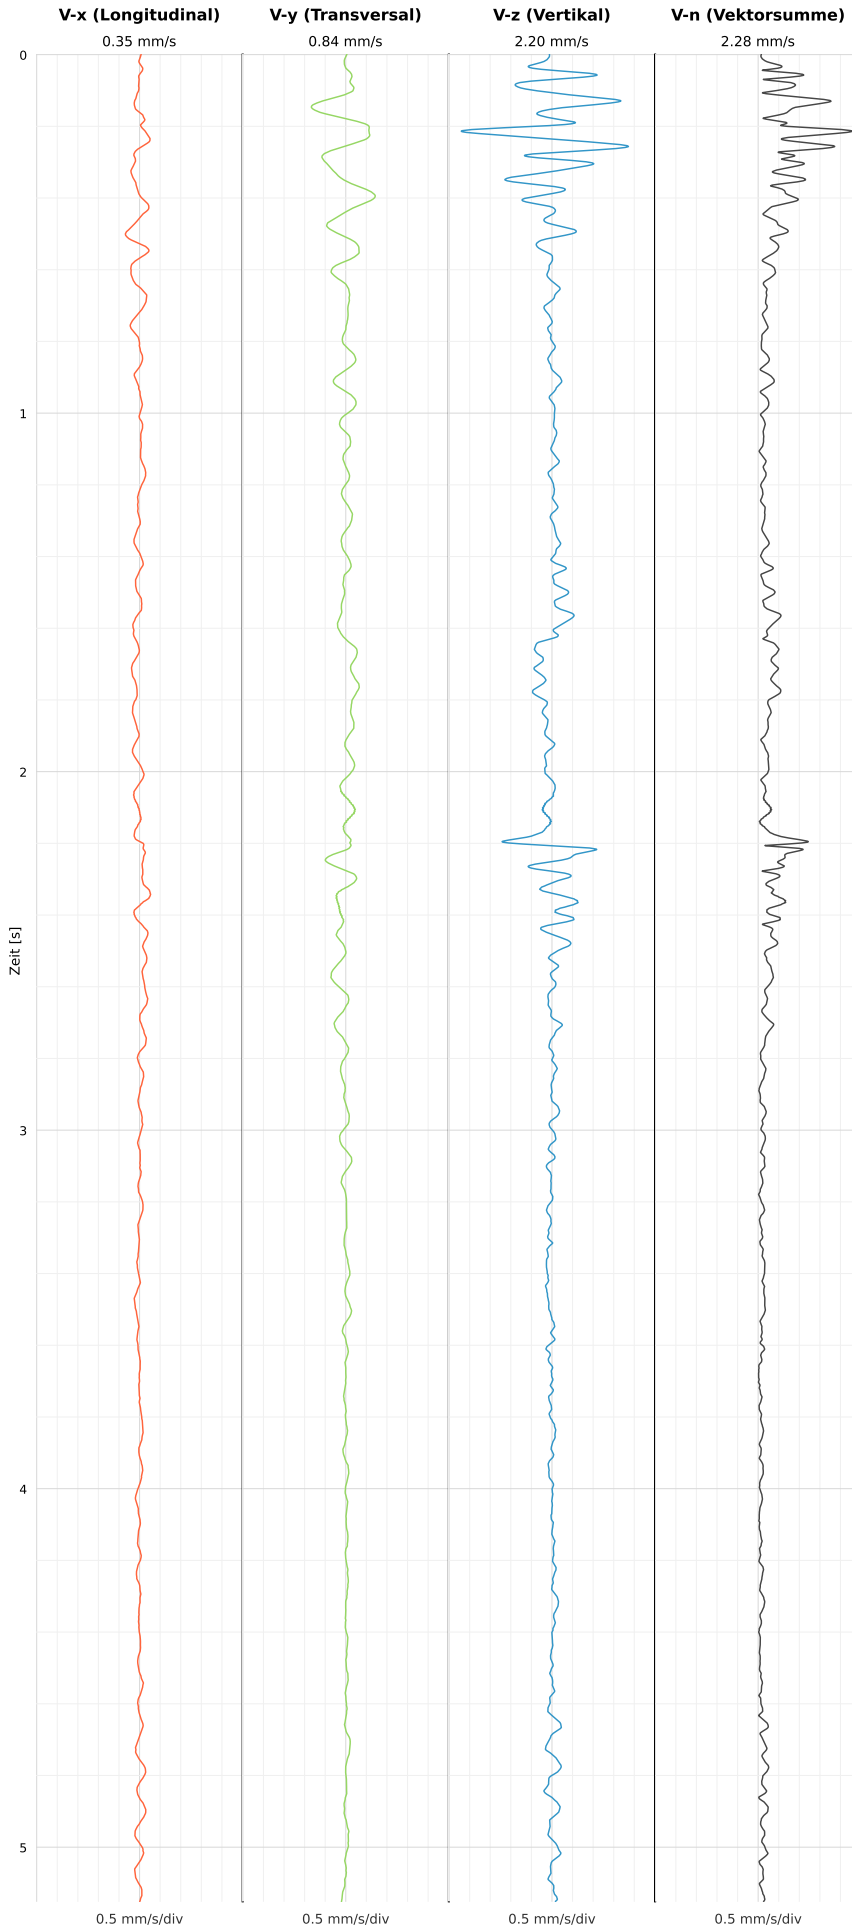


DATEI: 2492-PG-8-13052026-094548\_raw.csv

Aufzeichnungsdauer: 5.15 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	11:45:48
Event-ID	2492-PG-8-13052026-094548
Status	Ereignis
X	0.35 mm/s @ 8.3 Hz
Y	0.84 mm/s @ 9.1 Hz
Z	2.20 mm/s @ 16.5 Hz
Vn	2.28 mm/s @ 16.5 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

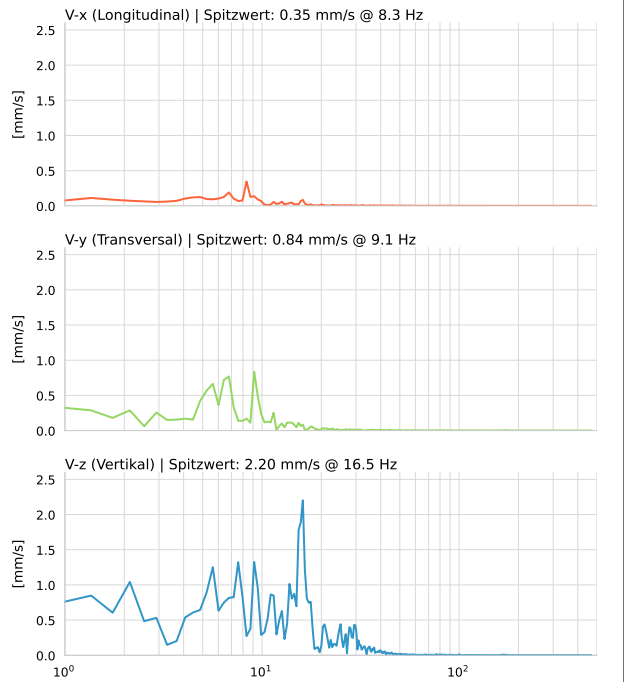

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.3 Hz	4.1 Hz	8.0 Hz	14.2 Hz
Y	9.1 Hz	4.9 Hz	6.8 Hz	11.5 Hz
Z	16.5 Hz	6.8 Hz	14.2 Hz	18.8 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

