


SCHWINGGESCHWINDIGKEIT

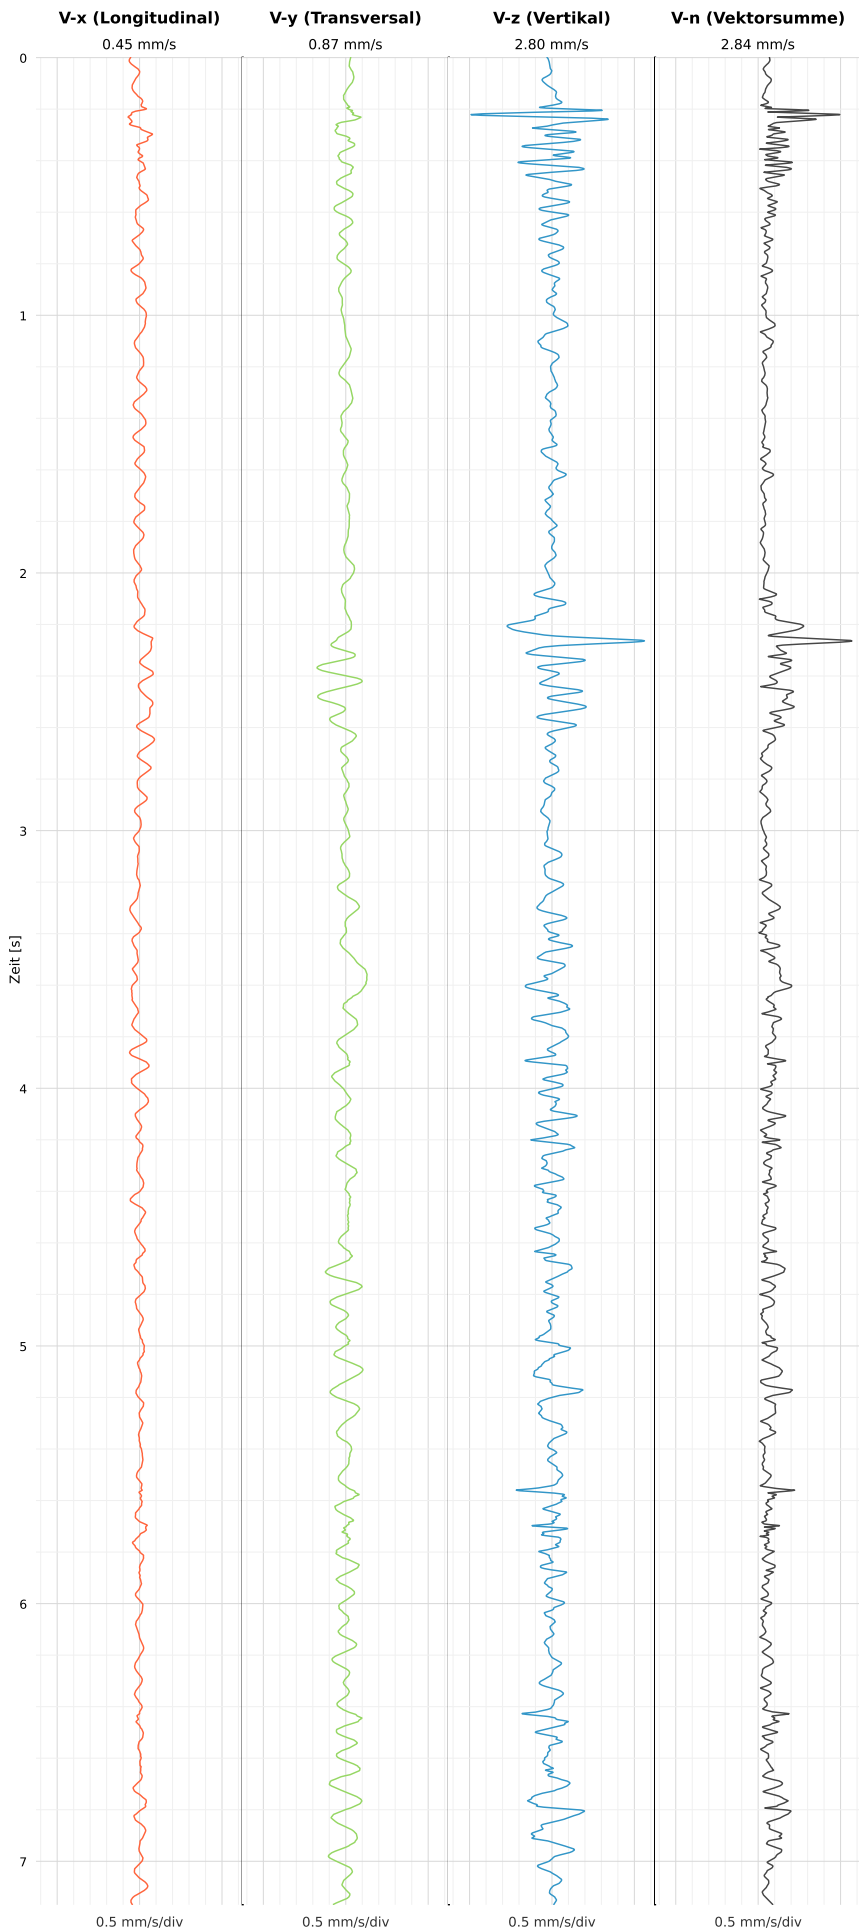


DATEI: 2492-PG-8-13052026-095008_raw.csv

Aufzeichnungsdauer: 7.17 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	11:50:08
Event-ID	2492-PG-8-13052026-095008
Status	Ereignis
X	0.45 mm/s @ 8.5 Hz
Y	0.87 mm/s @ 1.3 Hz
Z	2.80 mm/s @ 8.7 Hz
Vn	2.84 mm/s @ 8.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

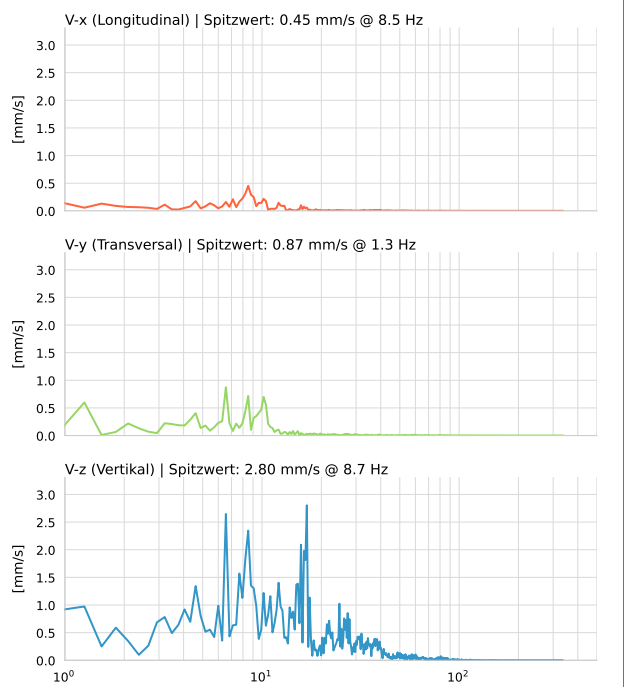

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.5 Hz	5.2 Hz	8.5 Hz	14.1 Hz
Y	1.3 Hz	5.2 Hz	8.8 Hz	13.5 Hz
Z	8.7 Hz	8.5 Hz	15.8 Hz	27.2 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

