


## SCHWINGGESCHWINDIGKEIT

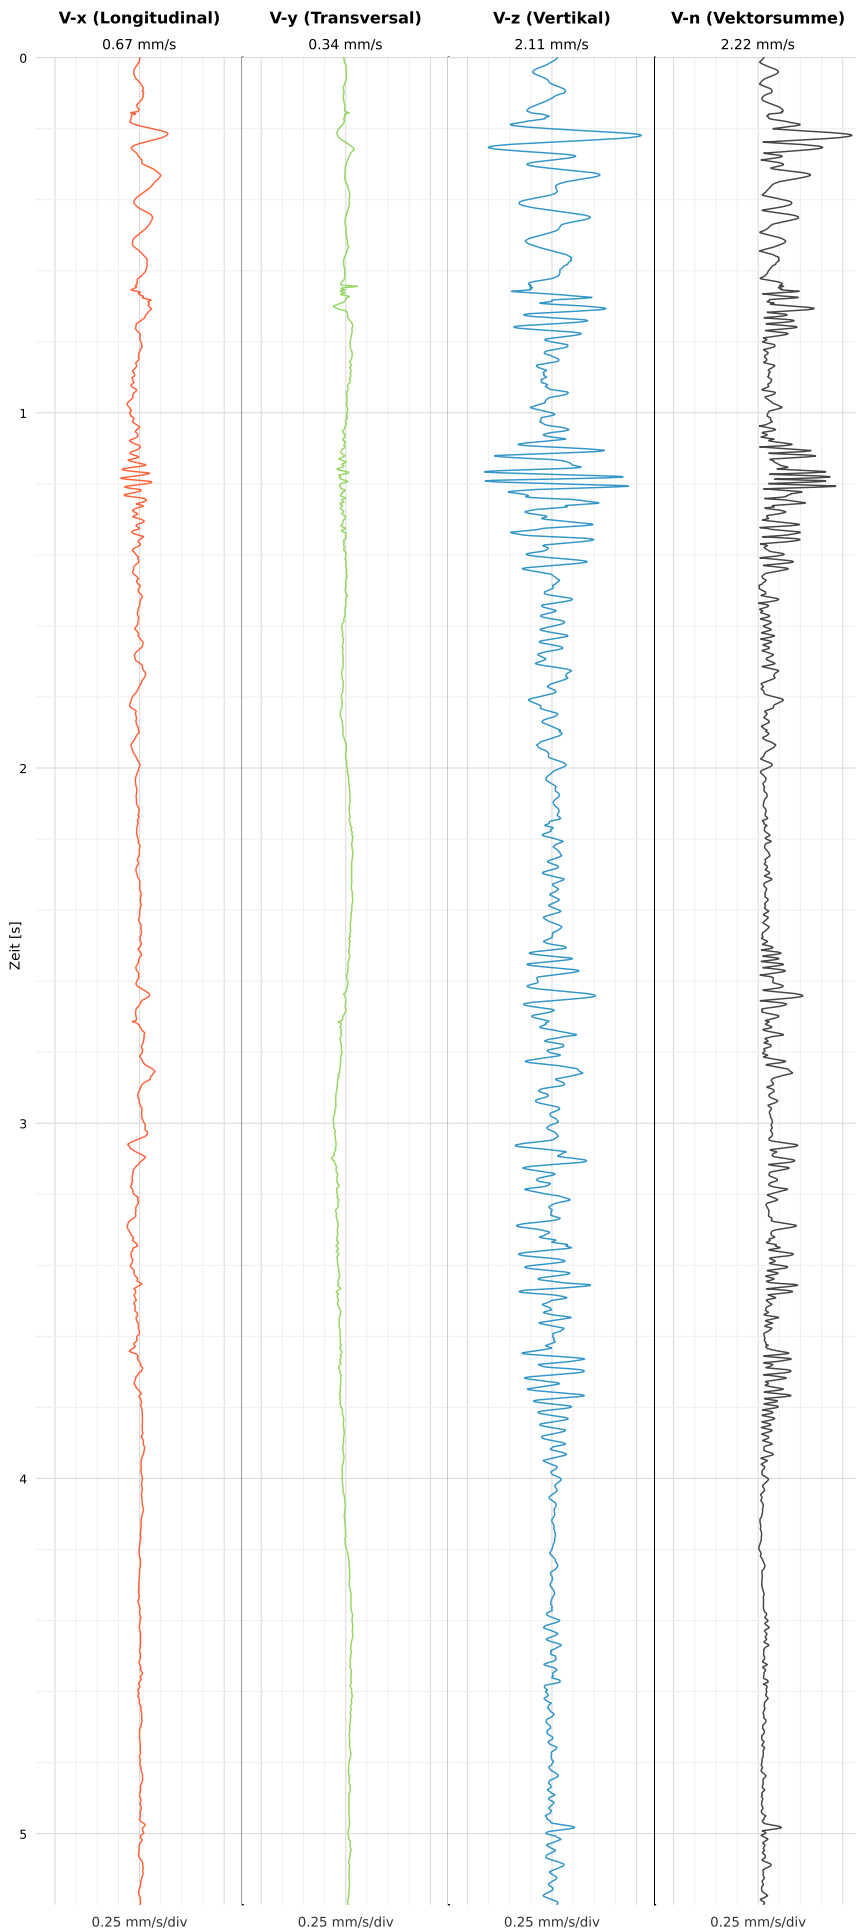


DATEI: 2492-PG-8-13052026-124622\_raw.csv

Aufzeichnungsdauer: 5.20 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	14:46:22
Event-ID	2492-PG-8-13052026-124622
Status	Ereignis
X	0.67 mm/s @ 8.3 Hz
Y	0.34 mm/s @ 1.1 Hz
Z	2.11 mm/s @ 29.4 Hz
Vn	2.22 mm/s @ 29.4 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

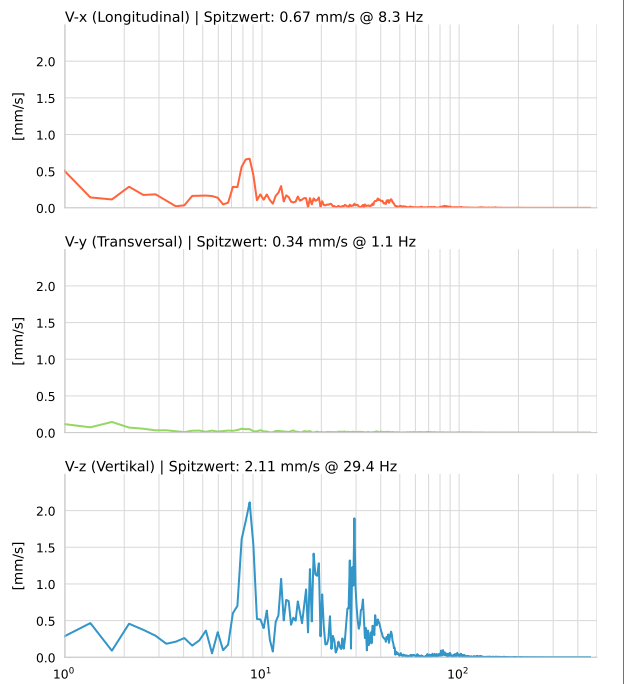

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.3 Hz	7.5 Hz	12.5 Hz	39.0 Hz
Y	1.1 Hz	1.3 Hz	12.1 Hz	54.4 Hz
Z	29.4 Hz	12.1 Hz	20.6 Hz	33.7 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

