


SCHWINGGESCHWINDIGKEIT

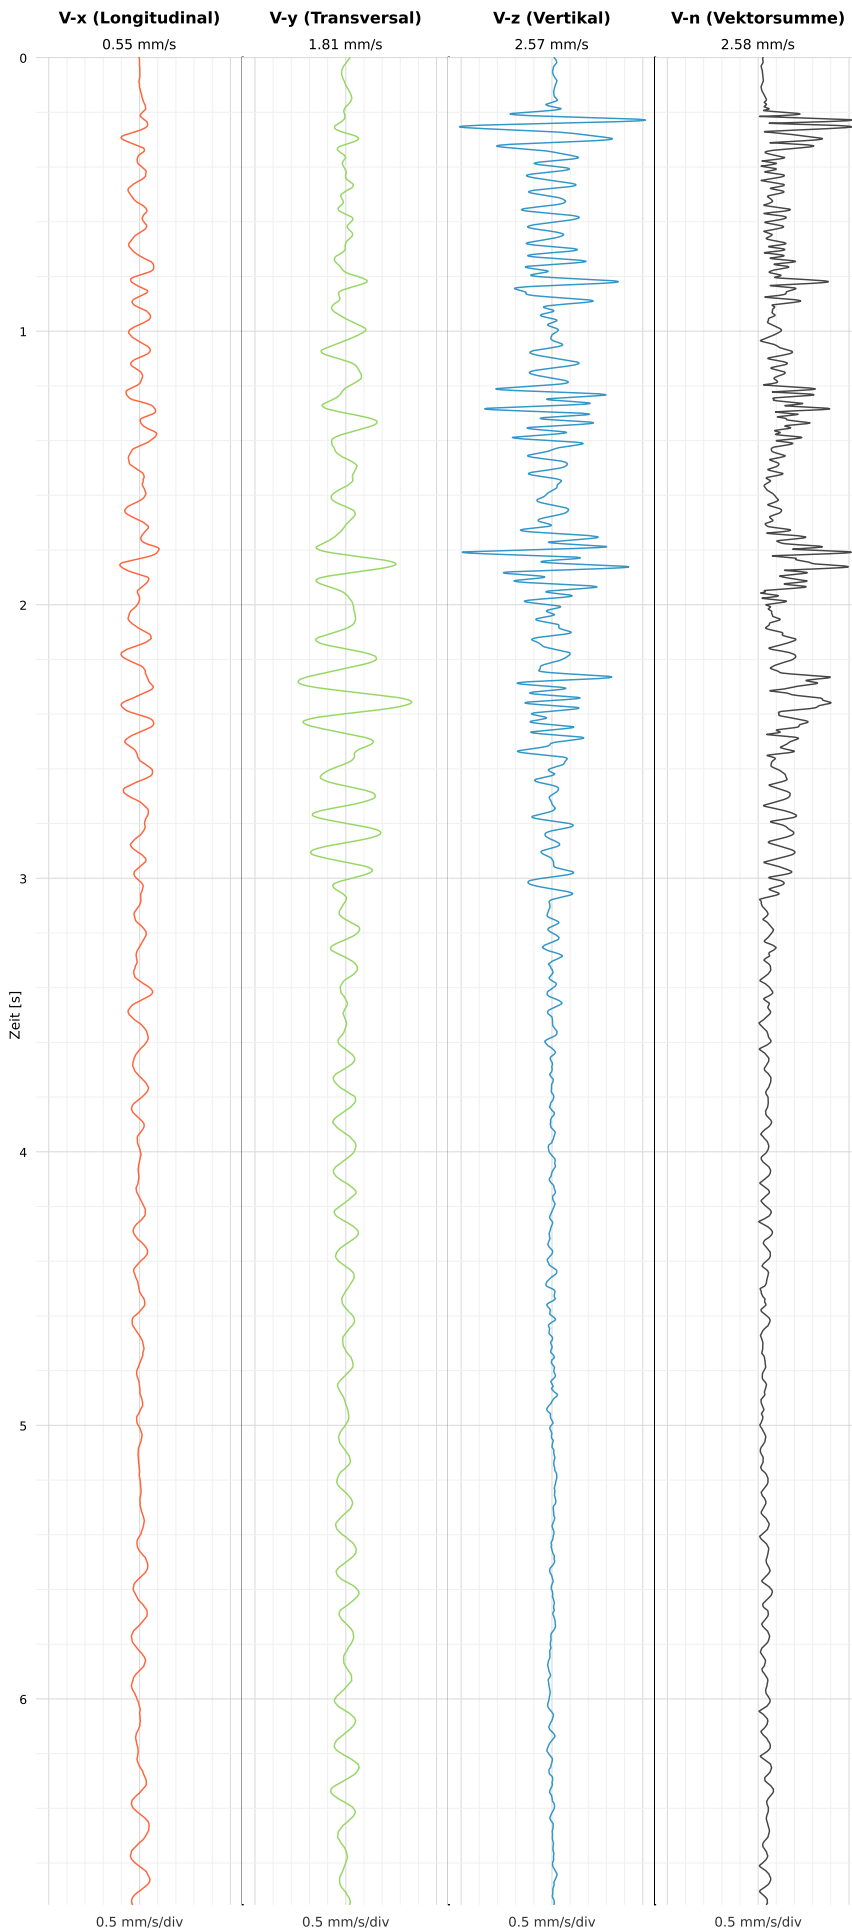


DATEI: 2492-PG-8-13052026-170845_raw.csv

Aufzeichnungsdauer: 6.75 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	19:08:45
Event-ID	2492-PG-8-13052026-170845
Status	Ereignis
X	0.55 mm/s @ 6.1 Hz
Y	1.81 mm/s @ 6.1 Hz
Z	2.57 mm/s @ 12.4 Hz
Vn	2.58 mm/s @ 12.4 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

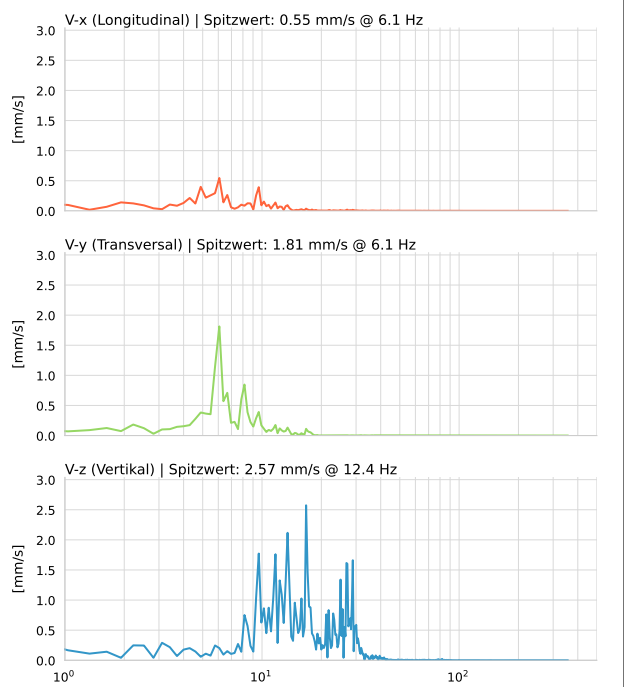

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	6.1 Hz	4.9 Hz	6.7 Hz	11.4 Hz
Y	6.1 Hz	5.8 Hz	6.7 Hz	9.0 Hz
Z	12.4 Hz	12.3 Hz	16.7 Hz	26.2 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

